

INTERNATIONAL STANDARD

NORME INTERNATIONALE

**Electricity metering – Payment systems –
Part 31: Particular requirements – Static payment meters for active energy
(classes 0,5, 1 and 2)**

**Équipements de comptage de l'électricité – Systèmes à paiement –
Partie 31: Exigences particulières – Compteurs statiques à paiement d'énergie
active (classes 0,5, 1 et 2)**

IECNORM.COM : Click to view the full PDF of IEC 62055-31:2022



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2022 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Secretariat
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

IEC Products & Services Portal - products.iec.ch

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 300 terminological entries in English and French, with equivalent terms in 19 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Recherche de publications IEC -

webstore.iec.ch/advsearchform

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études, ...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

IEC Just Published - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et une fois par mois par email.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: sales@iec.ch.

IEC Products & Services Portal - products.iec.ch

Découvrez notre puissant moteur de recherche et consultez gratuitement tous les aperçus des publications. Avec un abonnement, vous aurez toujours accès à un contenu à jour adapté à vos besoins.

Electropedia - www.electropedia.org

Le premier dictionnaire d'électrotechnologie en ligne au monde, avec plus de 22 300 articles terminologiques en anglais et en français, ainsi que les termes équivalents dans 19 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

INTERNATIONAL STANDARD

NORME INTERNATIONALE

**Electricity metering – Payment systems –
Part 31: Particular requirements – Static payment meters for active energy
(classes 0,5, 1 and 2)**

**Équipements de comptage de l'électricité – Systèmes à paiement –
Partie 31: Exigences particulières – Compteurs statiques à paiement d'énergie
active (classes 0,5, 1 et 2)**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

ICS 91.140.50

ISBN 978-2-8322-3803-5

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

CONTENTS

FOREWORD	5
INTRODUCTION	7
1 Scope	8
2 Normative references	9
3 Terms and definitions	9
3.1 General payment metering	9
3.2 Tokens	11
3.3 Token carriers	12
3.4 Tokens and token carriers	14
3.5 Switches of metering equipment	15
3.6 Timekeeping and tariff control	15
4 Nominal electrical values	17
5 Construction requirements	17
5.1 General	17
5.2 Clearance and creepage distances	17
5.3 Protection against penetration of dust and water	17
5.4 Display of measured values	17
5.4.1 General	17
5.4.2 Minimum display capability	17
5.4.3 Indicators	18
5.5 Storage of measured values	18
5.6 Output device	18
5.7 Marking of the meter	18
5.8 Token carrier interface	19
5.8.1 General	19
5.8.2 Token carrier acceptor	19
5.8.3 Keypad interface	19
6 Climatic conditions	19
6.1 General	19
6.2 Temperature range	19
6.2.1 General	19
6.2.2 Operation within the specified operating range	19
6.2.3 Operation within the limit range of operation	20
6.2.4 Storage and transport outside the limit range of operation	20
6.3 Relative humidity	20
6.4 Protection against penetration of dust and water	21
6.5 Tests of the effect of the climatic environments	21
7 Electrical requirements	21
7.1 General requirements	21
7.2 Influence of supply voltage	21
7.2.1 Voltage range(s)	21
7.2.2 Voltage dips and short interruptions	22
7.2.3 Abnormal voltage conditions	23
7.3 Heating	23
7.4 Insulation	23

7.5	Long Term Over Voltage Withstand.....	24
7.6	Electromagnetic compatibility (EMC).....	24
7.6.1	General	24
7.6.2	General test conditions	24
7.6.3	Test of immunity to electrostatic discharges.....	24
7.6.4	Test of immunity to radiated RF electromagnetic fields	24
7.6.5	Test of immunity to electrical fast transients/bursts	25
7.6.6	Test of immunity to conducted disturbances, induced by RF fields	25
7.6.7	Surge immunity test	25
7.6.8	Test of immunity to damped oscillatory waves	25
7.6.9	Radio interference suppression	25
7.7	Power consumption.....	25
7.7.1	General	25
7.7.2	Voltage circuits	26
7.7.3	Current circuits	26
7.8	Influence of self-heating on accuracy	26
7.9	Electrical tests on supply control and load control switches (SCS and LCS).....	26
7.10	Auxiliary control switches (ACS)	26
7.11	Token carrier acceptor interface test.....	26
8	Accuracy requirements	26
9	Functional requirements	27
9.1	General.....	27
9.2	Robustness of meter accounting process	27
10	Type test	28
Annex A (informative)	Functional performance	30
A.1	Basic functionalities – prepayment mode	30
A.1.1	General	30
A.1.2	Prepayment mode – core functionalities	30
A.1.3	Core functional tests within voltage and temperature range limits	33
A.1.4	Functional tests within the limit range of operation with voltage	34
A.1.5	Functional tests within the limit range of operation with temperature.....	34
A.1.6	Prepayment mode – token handling and data integrity requirements	35
A.2	Additional functionalities	36
A.2.1	General	36
A.2.2	Requirements for other modes of operation	37
A.2.3	Collection of agreed debt.....	37
A.2.4	Time-of-use tariff facilities	37
A.3	System compliance requirements	38
Annex B (informative)	Reference model for a payment meter	39
B.1	General.....	39
B.2	Generalised payment meter instance	40
B.3	Functions in a single-part payment meter.....	42
B.3.1	General	42
B.3.2	Meter application process.....	42
B.3.3	Token_Carrier_to_Meter_Interface function	42
B.3.4	Accounting function	42
B.3.5	Metering function	42
B.3.6	Delivery function.....	43

B.3.7	Time functions	43
B.3.8	Test functions	43
B.3.9	Display functions	43
B.3.10	Recording functions	44
B.3.11	Security functions	44
Annex C (normative)	Requirements for payment meters with supply control switches	46
Annex D (normative)	Requirements of timekeeping	47
D.1	General	47
D.1.1	General	47
D.1.2	Real-time clock support facilities	47
D.1.3	Operation reserve	47
D.1.4	Primary batteries	48
D.1.5	Back up battery replacement	48
D.1.6	Real-time clock setting and synchronisation facilities	48
D.2	Synchronous clocks	48
D.3	Crystal-controlled clocks	48
D.4	Tests of timekeeping accuracy	49
D.4.1	General	49
D.4.2	General test conditions	49
D.4.3	Test of synchronous clocks in payment meters	49
D.4.4	Test of crystal-controlled clocks in payment meters	49
D.5	Effects of disturbances on timekeeping	50
D.5.1	General	50
D.5.2	Electromagnetic disturbances	50
D.5.3	Voltage dips and short interruptions	51
D.5.4	Harmonics in the voltage waveform	52
Bibliography		53
Figure B.1 – Generalised block diagram of a payment meter instance		40
Table 1 – Voltage ranges		21

INTERNATIONAL ELECTROTECHNICAL COMMISSION

ELECTRICITY METERING – PAYMENT SYSTEMS –**Part 31: Particular requirements –
Static payment meters for active energy (classes 0,5, 1 and 2)****FOREWORD**

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

IEC 62055-31 has been prepared by IEC technical committee 13: Electrical energy measurement and control. It is an International Standard.

This second edition cancels and replaces the first edition published in 2005. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) Title modified.
- b) Removal of the contents of Annex C relating to the requirements for the supply control switch, and added reference to IEC 62052-31:2015 which contains the relevant requirements.

The text of this International Standard is based on the following documents:

Draft	Report on voting
13/1864/FDIS	13/1866/RVD

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this International Standard is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/standardsdev/publications.

A list of all parts in the IEC 62055 series, published under the general title *Electricity metering – Payment systems*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IECNORM.COM : Click to view the full PDF of IEC 62055-31:2022

INTRODUCTION

Payment meters are used in situations where the supply of electrical energy to the load may be interrupted or its restoration enabled under the control of the payment meter in relation to a payment tariff agreed between the customer and the supplier. The payment meter is part of a system that uses token carriers to pass payment information as tokens between a vending network and the payment meters that include the meter accounting process.

The primary reason for this edition is to align it with the requirements introduced in IEC 62052-31:2015 metering safety standard.

The functions of a payment meter are to measure electrical energy consumed and to decrement the available credit value in accordance with the metered consumption, and possibly in accordance with the passing of time. This available credit value is incremented as the result of payments made to the electricity supplier, and the meter accounting process continuously calculates the balance of available credit held by the customer. When the available credit value has been decremented to a predetermined value that is related to the payment mode in use, a switch is used to interrupt the supply to the customer's load. However, additional features may be present in the payment meter, which prevent or delay the opening of the switch, or limit further consumption to a low load level. Such "social" features may include the provision of an emergency credit facility, the possibility of operation in a fixed-payment mode, and the inhibiting of interruptions for certain periods of time.

In return for the payment (usually in cash) and depending on the particular type of system, the customer may be issued with a single-use token on a disposable token carrier for the equivalent value, or a reusable token carrier may be credited with that value, or the token may be transmitted directly to the meter via a communications network (a so-called virtual token carrier). "One-way" and "two-way" data transfer systems may be used, and the token carriers may be: physical devices such as smart cards, or other electronic devices, or magnetic cards; virtual token carriers where the token information is transferred by a remote communications system; or numeric token carriers where sequences of digits are issued on a paper receipt and entered via a keypad on the meter.

IEC 62051:1999, Clause 17 provides some details of payment metering terminology.

ELECTRICITY METERING – PAYMENT SYSTEMS –

Part 31: Particular requirements – Static payment meters for active energy (classes 0,5, 1 and 2)

1 Scope

This part of IEC 62055 applies to newly manufactured, static watt-hour payment meters of accuracy classes 0,5, 1 and 2 for direct connection, for the measurement of alternating current electrical energy consumption of a frequency in the range 45 Hz to 65 Hz that include a supply control switch for the purpose of interruption or restoration of the electricity supply to the load in accordance with the current value of the available credit maintained in the payment meter. It does not apply to static watt-hour payment meters where the voltage across the connection terminals exceeds 1 000 V (line-to-line voltage for meters for polyphase systems).

It applies to payment meters for indoor application, operating under normal climatic conditions where the payment meter is mounted as for normal service (i.e. together with a specified matching socket where applicable).

Payment meters are implementations where all the main functional elements are incorporated in a single enclosure, together with any specified matching socket. There are also multi-device payment metering installations where the various main functional elements, such as the measuring element, the user interface unit, token carrier interface, and the supply control switch are implemented in more than one enclosure, involving additional interfaces.

Functional requirements that apply to payment meters are also defined in this document, and include informative basic functional requirements and tests for the prepayment mode of operation in Annex A. Allowances are made for the relatively wide range of features, options, alternatives, and implementations that may be found in practice. The diverse nature and functionality of payment meters prevent the comprehensive specification of detailed test methods for all of these requirements. However, in this case, the requirements are stated in such a way that tests can then be formulated to respect and validate the specific functionality of the payment meter being tested.

This document does not cover specific functionality or performance requirements for circuit protection, isolation or similar purposes that may be specified through reference to other specifications or standards. Safety requirements removed from Edition 1.0 have been replaced with references to the safety requirements now contained in IEC 62052-31:2015, the product safety standard for newly manufactured electricity meters. In-service safety testing (ISST) is not covered by IEC 62052-31:2015 and is left to national best practice usually as an extension of existing in-service testing (IST) of metrology stability.

This document does not cover software requirements. This document covers type-testing requirements only. For acceptance testing, the requirements given in IEC 62058-11:2008 and IEC 62058-31:2008 may be used.

Dependability aspects are addressed in the IEC 62059 series of standards. Additional reliability, availability, maintenance and life cycle aspects are provided by IEC TC 56.

This document does not cover conformity tests and system compliance tests that may be required in connection with legal or other requirements of some markets.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60050-300:2001, *International Electrotechnical Vocabulary (IEV) – Part 300: Electrical and electronic measurements and measuring instruments – Part 311: General terms relating to measurements – Part 312: General terms relating to electrical measurements – Part 313: Types of electrical measuring instruments – Part 314: Specific terms according to the type of instrument*

IEC 60050-300:2001/AMD1:2015

IEC 60050-300:2001/AMD2:2016

IEC 60050-300:2001/AMD3:2017

IEC 60050-300:2001/AMD4:2020

IEC TR 62051:1999, *Electricity metering – Glossary of terms*

IEC 62052-11:2020, *Electricity metering equipment – General requirements, tests and test conditions – Part 11: Metering equipment*

IEC 62052-31:2015, *Electricity metering equipment (AC) – General requirements, tests and test conditions – Part 31: Product safety requirements and tests*

IEC 62053-21:2020, *Electricity metering equipment – Particular requirements – Part 21: Static meters for AC active energy (classes 0,5, 1 and 2)*

IEC 62054-21:2004, *Electricity metering (a.c.) – Tariff and load control – Part 21: Particular requirements for time switches*

IEC 62054-21:2004/AMD1:2017

IEC TR 62055-21:2005, *Electricity metering – Payment systems – Part 21: Framework for standardisation*

IEC 62058-11:2008, *Electricity metering equipment (AC) – Acceptance inspection – Part 11: General acceptance inspection methods*

IEC 62058-31:2008, *Electricity metering equipment (AC) – Acceptance inspection – Part 31: Particular requirements for static meters for active energy (classes 0,2 S, 0,5 S, 1 and 2)*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 60050-300:2001, IEC 62051:1999, IEC 62052-11:2020, and IEC 62055-21:2005, as well as the following, apply.

NOTE Where there is a difference between definitions in IEC 62055-31 and those contained in other referenced IEC standards, then those defined in IEC 62055-31 take precedence.

3.1 General payment metering

3.1.1

AC withstand voltage

RMS value of sinusoidal power frequency voltage that the equipment can withstand during tests made under specified conditions and for a specified time

[SOURCE: IEC 60050-614:2016, 614-03-22, modified]

3.1.2

available credit value

value of available credit (in monetary or energy units) usable for further consumption that is either stored in the payment meter or calculated by it whenever required which includes social credit if implemented

3.1.3

fault current

current flowing at a given point of a network resulting from a fault at another point of this network

[SOURCE: IEC 60050-603:1986, 603-02-25]

3.1.4

load control switch

LCS

SEE: IEC 62052-31:2015, 3.7.3

3.1.5

load interface

terminal(s) where the customer's load circuit is connected to the payment meter, or to a specified matching socket, where applicable

3.1.6

multi-device payment metering installation

payment metering installation where the functional elements comprising the measuring element(s); register(s), storage, and control; meter accounting process; user interface including any physical token carrier interface; any virtual token carrier interface; load switch(es); auxiliaries; plus supply interface and load interface are not arranged in the form of a payment meter, but instead are partitioned into two or more devices that require appropriate mounting, connection, and commissioning

[SOURCE: IEC 62051:1999, 17.45]

3.1.7

payment meter

electricity meter with additional functionality that can be operated and controlled to allow the flow of energy according to agreed payment modes

Note 1 to entry: It includes the following functional elements: measuring element(s); register(s), storage, and control; meter accounting process and any time-based functions; user interface including any physical token carrier interface; any virtual token carrier interface; load switch(es); auxiliaries; plus supply interface and load interface. A payment meter takes the form of a single unit, or a main unit that also employs a single specified matching socket for the supply interface and load interface. In either case, some payment meter implementations may allow for some or all of any time-based functions to be provided by an external unit connected to the payment meter, such as a time switch, a ripple control receiver, or a radio receiver.

Note 2 to entry: Refer to Figure B.1 for the generalised block diagram of a payment meter instance.

[SOURCE: IEC 62051:1999, 17.47]

3.1.8

payment metering installation

set of payment metering equipment installed and ready for use at a customer's premises

Note 1 to entry: This includes mounting the equipment as appropriate, and where a multi-device payment metering installation is involved, the connection of each unit of equipment as appropriate. It also includes the connection of the supply network to the supply interface, the connection of the customer's load circuit to the load interface, and the commissioning of the equipment into an operational state as a payment metering installation.

3.1.9**prepayment mode**

payment mode in which automatic interruption occurs when available credit value is exhausted

3.1.10**social credit**

amount of additional credit for which the consumer has not paid in advance but shall be repaid or a period of time within which supply will not be interrupted despite credit exhaustion

3.1.11**specified matching socket**

<in relation to a payment meter arranged as a plug-in unit> comprises a base with jaws to accept and connect to the plug-in unit, terminals for connection of the supply network and the consumer load circuit, and appropriate secure fixing and sealing arrangements

Note 1 to entry: The payment meter is capable of meeting the relevant type-testing requirements when it is properly installed in any specified matching socket.

3.1.12**supply control switch**

SCS

SEE: IEC 62052-31:2015, 3.7.2

3.1.13**supply interface**

terminal(s) where the supply network is connected to a payment meter, or to a specified matching socket, where applicable

3.1.14**time-based credit**

payment meter accounting functions that deal with the calculation and transacting of a (social) grant of credit that is released on a scheduled time basis

Note 1 to entry: See IEC 62055-21:2005, 13.8.3.

3.1.15**user interface**

that part of a payment meter or payment metering installation that allows the customer to monitor and operate the installation

Note 1 to entry: It may also facilitate meter reading and inspection, and metering services activities.

Note 2 to entry: Where physical token carriers are employed, it includes a token carrier interface.

3.2 Tokens**3.2.1****token**

<equipment-related definition> information content including an instruction issued on a token carrier by a vending or management system that is capable of subsequent transfer to and acceptance by a specific payment meter, or one of a group of meters, with appropriate security

Note 1 to entry: In a more general sense, the token refers to the instruction and information being transferred, while the token carrier refers to the physical device being used to carry the instruction and information, or to the communications medium in the case of a virtual token carrier.

[SOURCE: IEC 62051:1999, 17.66]

<system-related definition> subset of data elements, containing an instruction and information, that is present in the APDU of the application layer of the POS to *Token Carrier Interface*, and which is also transferred to the payment meter by means of a token carrier

3.2.2

credit token

value token

token that represents an amount of credit in monetary or energy value for transfer from the vending point to the payment meter

3.2.3

duplicate token

token that contains the same information as a token that has already been issued, and hence may also be a valid token

Note 1 to entry: This is not the same as a replacement token (refer also to 3.4.9).

Note 2 to entry: A duplicate token is a reissue of the same token that was previously issued and is identical to it in all aspects; whereas a replacement token is a newly generated token in place of a previously generated token and may not be identical to it in all aspects.

3.2.4

multiple-use token

token (such as a test token) that can be used for more than one successful session in a payment meter or possibly with each in a group of meters

Note 1 to entry: These are typically used for meter reading or service purposes on repeated occasions.

3.2.5

no-value token

token that does not result in a financial advantage or disadvantage to the consumer, which may contain meter configuration data, or instructions to perform certain tests, or to display certain values on the user interface, or to retrieve certain data from the meter and return it on a token carrier

Note 1 to entry: This is as opposed to value token.

3.2.6

replacement token

SEE: 3.4.9

Note 1 to entry: This is not the same as a duplicate token (see 3.2.3).

3.2.7

single-use token

token (such as a credit token) that can only be used for one successful session in a payment meter

3.2.8

valid token

<in relation to a specific payment meter (or group of payment meters)>, token that is capable of being processed successfully by the meter(s)

3.2.9

value token

SEE:3.2.2

3.3 Token carriers

3.3.1

token carrier

<equipment-related definition> devices or media used to transport and present token information to payment meters, such as printed paper, magnetic card, electronic memory card/key, microprocessor card, or data communications networks

Note 1 to entry: The token carrier may also carry ancillary control or monitoring information to or from the payment meter, depending upon system type and requirements.

<system-related definition> medium that is used in the physical layer of the POS to *Token Carrier Interface*, onto which the token is modulated or encoded, and which serves to carry the token from the point where it is generated to the remote payment meter, where it is received

3.3.2

blank token carrier

physical token carrier that has not been processed at the vending point or elsewhere and hence contains no specific data

3.3.3

disposable token carrier

token carrier that is not capable of further use once it has been accepted or used, such as a paper-based magnetic card

3.3.4

machine-readable token carrier

physical or virtual token carrier carrying token information that is capable of being read and processed automatically on presentation to an appropriate payment meter, without further manual operation

EXAMPLE A token employing a magnetic card as the token carrier.

3.3.5

memory token carrier

physical token carrier containing a non-volatile memory device, in which the token is electronically encoded and stored while it is being transported

3.3.6

microprocessor token carrier

physical token carrier containing a microprocessor device with non-volatile memory, in which the token is electronically encoded and stored while it is being transported

Note 1 to entry: In addition to the token information, the microprocessor token carrier may also contain an application programme and associated data.

3.3.7

numeric token carrier

token transfer method where the token information can be represented in a secure manner by a visible and human readable sequence of numeric digits (typically 20 digits printed on a receipt)

Note 1 to entry: They may be entered into a payment meter via a keypad interface for evaluation and action.

3.3.8

one-way token carrier

physical or virtual token carrier which is used for the transfer of credit and possibly tariff and configuration data in a single direction from the vending point or the management system to the payment meter

3.3.9

physical token carrier

token carrier that requires a human to transport it at least part of the way between the point where the token is loaded onto the token carrier and the point where it is retrieved from the token carrier by the payment meter

Note 1 to entry: Examples of physical token carriers are: printed numbers; magnetic cards; printed bar codes; electronic storage in memory devices such as smart cards or memory keys; and audio messages dictated by interactive voice response equipment.

3.3.10

rechargeable token carrier

SEE: 3.3.11

3.3.11

reusable token carrier

rechargeable token carrier

physical token carrier that can be used for multiple sessions for transportation of tokens

3.3.12

two-way token carrier

physical or virtual token carrier which is used for the transfer of credit and/or tariff and configuration data from the vending point or management system to the payment meter and response data from the payment meter back to the vending point or management system for further processing, where response data may possibly return on a subsequent vending transaction

Note 1 to entry: Response data may contain consumption information, tamper information, accountancy information and token status with or without time and date stamps.

3.3.13

virtual token carrier

token carrier that does not require a human to transport it between the point where the token is loaded onto the token carrier and the point where it is retrieved from the token carrier by the payment meter

Note 1 to entry: Examples of virtual token carriers are: modems on PLC, PSTN, GSM, GPRS and Radio; LAN; WAN and direct local connection.

3.4 Tokens and token carriers

3.4.1

physical token carrier interface

complete interface protocol stack that includes any token carrier acceptor or keypad for a physical token carrier, the physical layer protocol and application layer protocol, plus any intermediate protocol layers

3.4.2

token acceptance

recognition of the successful completion of the processing of any token that was presented to the payment meter

Note 1 to entry: Typically, this might involve the addition of token credit to the meter's accounting register, cancellation of the token information from the token carrier so as to prevent subsequent acceptance by any meter, and a visible indication to the user on the user interface. Similarly, this may also be applicable to any tariff or configuration data included on the token carrier.

3.4.3

token cancellation

- a) process of erasing or invalidating information contained in a valid token upon its acceptance by a payment meter, to prevent its reuse;
- b) process of erasing or invalidating information contained in a token after it has been created, but before it is presented to a payment meter

Note 1 to entry: This typically happens when the vending operator makes a mistake or if a technical problem occurs during the vending process.

3.4.4**token carrier acceptor**

physical part of a physical token carrier interface, which mechanically accepts and holds the token carrier in the correct position for the token transfer process to take place between the token carrier and the payment meter

Note 1 to entry: Examples are: smart card acceptor; magnetic card acceptor; memory key acceptor.

3.4.5**token carrier charging**

loading of a token and tariff or configuration data onto a token carrier at a vending point or a management system

3.4.6**token carrier interface**

token carrier interface permits the manual or automatic entry of tokens into a payment meter

Note 1 to entry: For example, it may be a keypad for numeric tokens, or a physical token carrier acceptor, or a communications connection to a local or remote machine for a virtual token carrier interface.

Note 2 to entry: The token carrier interface may also be used to pass additional information to or from the payment meter, such as for the purposes of payment system management.

3.4.7**token credit**

value of credit or energy to be transferred from the vending point to the payment meter in the form of a token on a token carrier

3.4.8**token rejection**

this occurs when a token has been presented to but has not been accepted by a payment meter, and has not been erased or invalidated

Note 1 to entry: In the case of a valid token not being accepted, the token may be presented and accepted at a later time when conditions allow.

3.4.9**token replacement**

token that replaces a previously issued token in value

Note 1 to entry: Physical token carriers may require a blank token carrier to be configured for the customer's meter.

Note 2 to entry: A replacement token is a newly generated token in place of a previously generated token and may not be identical to it in all aspects; whereas a duplicate token is a reissue of the same token that was previously issued and is identical to it in all aspects.

3.4.10**virtual token carrier interface**

complete interface protocol stack that includes the physical layer protocol and application layer protocol, plus any intermediate protocol layers

3.5 Switches of metering equipment

Refer to IEC 62052-31:2015, 3.7.

3.6 Timekeeping and tariff control**3.6.1****crystal-controlled timekeeping**

process of maintaining a payment meter's time by means of an internal crystal-controlled clock

3.6.2

external tariff control

control of a payment meter's time-dependent or consumption-dependent tariff regime (time-based or consumption-based charges and/or registers) by external signal(s)

3.6.3

external time signal control

control of a payment meter's internal real-time clock by an external signal

3.6.4

external time synchronisation

synchronisation of a payment meter's internal real-time clock by an external signal

3.6.5

internal tariff control

control of a payment meter's time-dependent or consumption-dependent tariff regime (time-based or consumption-based charges and/or registers) by signals from an internal real-time clock and switching programme

3.6.6

internal timekeeping

maintenance of a payment meter's time by its own internal clock facility

3.6.7

operation reserve

maximum period of time after switching off the power supply voltage, during which the payment meter is capable of maintaining correct time with a specified, relaxed timekeeping accuracy

3.6.8

reserve restoration time

period of time required for restoring the full operation reserve from the point where the operation reserve has been completely exhausted.

3.6.9

synchronous timekeeping

process of maintaining a payment meter's time by means of an internal clock synchronised to a signal derived from the power system frequency

Note 1 to entry: Payment meters employing synchronous timekeeping may defer to crystal-controlled timekeeping in the absence of the synchronising signal.

3.6.10

time indication discrepancy

difference between the time displayed by the payment meter and the actual time or, in the case of synchronous timekeeping, the difference between the time displayed by the payment meter and the time determined by the network frequency

Note 1 to entry: The actual time may be obtained by using a reference clock.

3.6.11

timekeeping accuracy

increase or decrease in the time indication discrepancy within a specified time interval

3.6.12

variation of timekeeping accuracy due to an influence quantity

difference in timekeeping accuracy of a payment meter when only one influence quantity assumes successively two specified values, one of them being the reference value

4 Nominal electrical values

Payment meters shall comply with the values given for standard voltage ranges, standard currents, and standard frequencies, including the maximum currents given for static meters for direct connection as given in IEC 62052-11:2020, Clause 4.

5 Construction requirements

5.1 General

The requirements given in IEC 62052-11:2020, Clause 5 shall apply. Where the payment meter is to be used with a specified matching socket then these requirements shall be met by the complete assembly, with the payment meter mounted as for normal service.

5.2 Clearance and creepage distances

The requirements given in IEC 62052-31:2015, 6.7.2.1 and 6.7.2.3 shall apply, to include metallic objects of the same size and shape as the token carrier when inserted into the token carrier acceptor.

For the purpose of these requirements, a metallic token shall be considered to represent an auxiliary circuit with a reference voltage below or equal to 40 V.

5.3 Protection against penetration of dust and water

The requirements given in IEC 62052-31:2015, Clause 11 shall apply.

If a token carrier acceptor is fitted to the meter, then the tests shall be carried out without any token carrier in place in the token carrier acceptor.

Immediately after the tests and without disturbing the meter, the payment meter shall operate correctly and a valid token shall be accepted on the first or subsequent presentation, up to a maximum of 4 attempts.

5.4 Display of measured values

5.4.1 General

The requirements given in IEC 62052-11:2020, 5.6 shall apply to payment meters having a display.

5.4.2 Minimum display capability

For payment meters operating in the prepayment mode, the following information shall be capable of being displayed:

- cumulative kWh energy register (energy consumption);
- available credit value.

In addition, for virtual token carrier systems, the payment meter shall be able to display details of the last purchase transaction (time, date and amount).

The height of the display characters for the numeric values shall be not less than 4,5 mm.

Where the available credit value is in monetary units, the following additional information shall be capable of being displayed:

- the price per kWh;
- any time-based charge settings, such as for standing charges or debt recovery.

In the case of a multi-rate payment meter, the following additional information shall also be capable of being displayed:

- cumulative kWh for each tariff rate;
- the price per kWh for each tariff rate.

Where a multi-rate payment meter is operated from an internal real-time clock, the time shall also be capable of being displayed.

Where any display of information considered to be private is required (e.g. debt amounts or transactions), it shall be possible to limit display access to the specific consumer (e.g. by presentation of a customer/meter-specific token or password).

5.4.3 Indicators

The following shall be indicated as a minimum and shall be visible from the front of the payment meter:

- indication of rate of kWh consumption (instantaneous loading);
- indication of token acceptance (for all manually-transported token types).

In addition, for virtual token carrier payment meters, when the supply control switch is open, an appropriate indication or message shall be capable of being shown (for example first indicating OFF, then ENABLED, and then ON).

Electronic indicating devices shall be provided with a display test function that switches all the display segments on then off for the purpose of determining whether all display segments are working.

The indicating device can be connected to the meter case physically or remotely. In the latter case the data to be displayed shall be stored in the electricity meter.

NOTE National or regional requirements may contain provisions to guarantee access to the data for customers and consumers.

5.5 Storage of measured values

The requirements given in IEC 62052-11:2020, 5.7 shall apply, but the data for correct operation shall remain stored for a minimum of 10 years. The data to be retained should be agreed between the manufacturer and testing lab and may be demonstrated by design.

In addition, refer to D.1.3 and D.1.4 for any operational reserve where a real-time clock is fitted.

5.6 Output device

The requirements given in IEC 62052-11:2020, 5.8 shall apply.

5.7 Marking of the meter

The requirements given in IEC 62052-11:2020, Clause 6 and IEC 62052-31:2015, Clause 5 shall apply.

5.8 Token carrier interface

5.8.1 General

Where a physical token carrier interface is fitted, it shall comply with the following mechanical requirements.

5.8.2 Token carrier acceptor

Where a token carrier acceptor is fitted, the insertion force required to insert a token carrier into the token carrier acceptor shall not exceed 10 N. The force required to remove a token carrier from the token carrier acceptor shall not exceed 10 N. The meter shall be designed such that under normal circumstances, and with a properly maintained token carrier, the minimum number of insertions for which a token carrier acceptor shall operate is 10 000.

5.8.3 Keypad interface

Where a keypad interface is fitted, it shall be designed to operate for a minimum of 20 000 operations of each individual key. The force required to push the button of the keypad interface shall not exceed 10 N.

6 Climatic conditions

6.1 General

Payment meters shall comply with the requirements for normal environmental conditions given in IEC 62052-31:2015, 1.4 where referenced, and augmented as follows. The payment meter shall be mounted as for normal service, including in a specified matching socket where applicable.

Where relevant, and unless otherwise specified, the tests shall be carried out with the payment meter in the prepayment mode, and with the supply control switch closed, unless otherwise stated.

Where a token carrier acceptor is fitted, then the tests shall be carried out without any token carrier in place in the token carrier acceptor during these tests.

6.2 Temperature range

6.2.1 General

For temperature range refer to IEC 62052-11:2020, 8.2 (indoor use) and IEC 62052-31:2015, 1.4.1.

6.2.2 Operation within the specified operating range

This is the range of ambient temperature (i.e. from $-10\text{ }^{\circ}\text{C}$ to $+45\text{ }^{\circ}\text{C}$) forming part of the payment meter's rated operating conditions for metrological and functional purposes, with limits of variation in meter error with ambient temperature specified in terms of maximum limits for the mean temperature coefficient. Within this temperature range, the operation of the power supply circuits, the display and any push buttons, the meter accounting process and any associated registers and parameters, the supply control switch and load control switch(es), the token interface and/or any local or remote communications interface, plus any multi-rate facility and any auxiliary input and output circuits shall all be correct; a valid token shall be accepted, and an invalid token shall be rejected or ignored without damage or cancellation.

Where an internal real-time clock is fitted for internal tariff control or time-based credit release, then reference to Annex D shall be made.

Within this temperature range and when there is no supply voltage applied to the payment meter, the status of all registers, values, and parameters associated with the meter accounting process shall continue to be valid and free from corruption and there shall be no changes to the metrological and functional characteristics of the meter when the supply voltage is subsequently restored.

6.2.3 Operation within the limit range of operation

- a) Outside the specified operating range but within the limit range of operation (i.e. from $-25\text{ }^{\circ}\text{C}$ to $-10\text{ }^{\circ}\text{C}$ and from $+45\text{ }^{\circ}\text{C}$ to $+55\text{ }^{\circ}\text{C}$) and when the supply voltage applied to the payment meter is within the extended operating range (see 7.2.1 and 7.2.1.3), the following operational requirements shall apply:

The status of all registers, values, and parameters associated with the meter accounting process shall continue to be valid and free of corruption. Where an internal real-time clock is fitted for internal tariff control or time-based credit release, then reference to Annex D shall be made. No discrepancies between the cumulative kWh register(s) and available credit value shall become evident as a result of any such ambient temperature excursions outside the specified operating range.

A valid token need not be accepted when presented, but the information on the token carrier shall then not be altered or invalidated. However, when a valid token is accepted, the credit amount shall be transferred correctly to the meter and the credit information of the token itself shall have been invalidated. An invalid token shall not be accepted, altered or damaged by presentation to the meter.

The display need not operate, or is permitted to operate erratically. The state of the supply control switch shall not alter without appropriate conditions prevailing in the meter accounting process, and any otherwise permissible restoration to the “on” state shall not occur without additional manual intervention.

Correct operation of all aspects of the payment meter shall resume when the ambient temperature has returned to within the specified operating range.

- b) Outside the specified operating range, but within the limit range of operation, and when there is no supply voltage applied to the payment meter the status of all registers, values, and parameters associated with the meter accounting process shall continue to be valid and free from corruption and there shall be no changes to the metrological and functional characteristics of the meter when the supply voltage is subsequently restored. Where an internal real-time clock is fitted for internal tariff control or time-based credit release then reference to Annex D shall be made. Correct operation of all aspects of the payment meter shall resume when the supply voltage has returned to within the extended operating range. However, where the meter is fitted with a real-time clock for tariff purposes and this no-supply-voltage condition persists for a time period longer than the operational reserve, then it is permissible that the time may need to be reset.

6.2.4 Storage and transport outside the limit range of operation

Outside the limit range of operation, but within the limit range for storage and transport (i.e. from $+55\text{ }^{\circ}\text{C}$ to $+70\text{ }^{\circ}\text{C}$) and without any supply voltage applied to the payment meter, the following requirements shall apply.

The status of all registers, values, and parameters associated with the meter accounting process shall continue to be valid and free from corruption and there shall be no resulting damage or degradation to the metrological and functional characteristics of the meter. Under these conditions the operation and timekeeping accuracy of any timekeeping facility with an operation reserve that is incorporated in the payment meter are not specified. When the ambient temperature of the payment meter has returned to the specified operating range and stabilised and after the supply voltage has been connected and then commissioning (including the resetting of any timekeeping facility) has been completed, the meter shall operate normally.

6.3 Relative humidity

The requirements given in IEC 62052-11:2020, 8.2 shall apply (indoor use).

6.4 Protection against penetration of dust and water

The requirements given in IEC 62052-31:2015, Clause 11 (indoor meters) shall apply.

6.5 Tests of the effect of the climatic environments

The requirements given in IEC 62052-11:2020, 8.3 shall apply.

7 Electrical requirements

7.1 General requirements

Payment meters shall comply with the relevant electrical requirements given in IEC 62052-11:2020 and IEC 62053-21:2020 and the safety requirements given in IEC 62052-31:2015 where referenced and augmented herein. The payment meter shall be mounted as for normal service, including in a specified matching socket where applicable.

In the case of testing a payment meter designed for use as a multi-device payment meter installation, it shall as a whole meet the requirements of this document. The connection method recommended by the manufacturer shall be used to connect the devices that make up the multi-device meter. The length of connection between the devices shall conform to the minimum length specified by the manufacturer.

Where relevant, and unless otherwise specified, the tests shall be carried out with the payment meter in the prepayment mode.

The supply control switch shall be in the closed position for each of these tests, unless otherwise specified.

Where a token carrier acceptor is fitted to the payment meter, then the tests shall be carried out without a token carrier in place in the token carrier acceptor, unless otherwise specified.

Where these requirements permit a temporary degradation of performance or loss of function during the tests then within a maximum period of 15 s after the end of the tests the payment meter shall operate correctly in accordance with the relevant requirements without any external intervention. No change of actual operating state or stored data is allowed. Refer to 9.2 for checks at beginning and end of tests. Where an internal real-time clock is fitted for internal tariff control or time-based credit release then reference to Annex D is also to be made.

7.2 Influence of supply voltage

7.2.1 Voltage range(s)

7.2.1.1 General

Payment meters shall comply with the following requirements. See Table 1.

Table 1 – Voltage ranges

Specified operating range (See 7.2.1.2)	From 0,9 to 1,1 U_n
Extended operating range (See 7.2.1.3)	From 0,8 to 1,15 U_n
Limit range of operation (See 7.2.1.4)	From 0,0 to 0,8 U_n
Withstand range (See 7.2.3)	From 0,0 to 1,9 U_n

For verification of voltage range, refer also to Clauses 8 and 9.

7.2.1.2 Specified operating range

This is the range of supply voltage forming part of the payment meter's rated operating conditions for metrological purposes, with specified limits of variation in percentage error with supply voltage.

7.2.1.3 Extended operating range

This is the range of supply voltage over which the payment meter shall operate correctly. Within this range, the operation of the power supply circuits, the display and any push buttons, the meter accounting process and any associated registers, values, parameters, and timekeeping, the supply control switch(es), the token carrier interface and/or any local or remote communications interface, plus any multi-rate facility and any auxiliary input and output circuits shall all be correct; a valid token shall be accepted, and an invalid token shall be rejected without damage or cancellation. Outside the specified operating range of supply voltage, but within the extended operating range, the limits of variation in percentage error of the meter are three times the values applicable within the specified operating range.

7.2.1.4 Limit range of operation

Outside the extended operating range of supply voltage but within the limit range of operation (i.e. from 0,0 to 0,8 U_n) and when the ambient temperature is within the specified operating range the following operational requirements shall apply.

The status of all registers, values, and parameters associated with the meter accounting process shall continue to be valid and free of corruption. Any internal timekeeping facility shall continue to maintain timekeeping until the support period applicable to any operational reserve has elapsed. The error of the meter may vary between +10 % and –100 % and no discrepancies between the cumulative kWh register(s) and available credit value shall become evident as a result of any such supply voltage excursions outside the extended operating range.

A valid token need not be accepted when presented, but the information on the token carrier shall then not be altered or invalidated. However, when a valid token is accepted the credit amount shall be transferred correctly to the meter and the credit information of the token itself shall have been invalidated. An invalid token shall not be accepted, altered or damaged by presentation to the meter.

The display need not operate, or is permitted to operate erratically. The state of the supply control switch shall not alter without appropriate conditions prevailing in the meter accounting process, and any otherwise permissible restoration to the "on" state shall not occur without additional manual intervention.

Correct operation of all aspects of the payment meter shall resume when the supply voltage has returned to within the extended operating range. However, where the meter is fitted with a real-time clock for tariff purposes and the supply voltage is below 0,8 U_n for a time period longer than the operational reserve, then it is permissible that the time may need to be reset.

Where requirements for a meter function that specifically opens the supply control switch during low or high supply voltage conditions are agreed between purchaser and supplier of the payment meter, it shall be possible for this function to be inhibited when assessing compliance with this clause, without changing any relevant firmware.

7.2.2 Voltage dips and short interruptions

The requirements given in IEC 62052-11:2020, 9.3.2 shall apply. Where the payment meter is fitted with a token carrier acceptor and the token carrier can be retained in the meter then these tests shall be carried out with and without a customer token carrier inserted in the meter during the tests. Where the token carrier cannot be so retained these tests shall be performed without any token carrier in place in the token carrier acceptor during the test. No tokens shall be presented to the meter for action during these tests.

Voltage dips and short interruptions shall not produce any loss or corruption of data in the payment meter, whether a token carrier is inserted in the meter or not. Data on the token carrier shall not be corrupted when the latter is inserted and retained in the meter for the duration of these tests.

After the tests, a valid credit token shall be presented. The token and payment meter shall then operate correctly, including operation of the supply control switch off and on.

The test shall be carried out first with the supply control switch closed and it shall be in or resume the closed position at the end of the test. The test shall be repeated with the switch open and it shall remain open throughout the test.

NOTE Refer also to A.1.2.7 for the effects of power failure, and to Annex D for further influences on the timekeeping of any internal timekeeping facility.

7.2.3 Abnormal voltage conditions

For single-phase types, the payment meter shall withstand, without a safety hazard arising, the maximum withstand voltage ($1,9 U_n$) applied between the line voltage and neutral terminals. The maximum withstand voltage shall be applied for a period of 4 h together with a current of 50 % of I_{max} and unity power factor (in the case of two-element single-phase two-wire meters 50 % of I_{max} in each measuring element simultaneously). This requirement shall also apply to single-phase three-wire payment meters, where the maximum withstand voltage shall first be applied to test the first line voltage and current, and then repeated to test the second line voltage and current – in each case without any supply voltage applied to the unused line terminal. No load current flows through to the neutral terminal in any of these testing arrangements.

For three-phase four-wire polyphase types, the payment meter shall withstand, without a safety hazard arising, the maximum withstand voltage ($1,9 U_n$) applied to any two phases and neutral with a phase angle of 60° between the two phase voltages. The maximum withstand voltage shall be applied for a period of 4 h together with a current of 50 % of I_{max} and unity power factor in each of the two phases under test. A total of three test runs is required to cover the pairs of phases, with a cooling period of 1 h between each run. This supply voltage withstand requirement does not apply to three-phase three-wire direct-connected payment meters.

For all polyphase types, the payment meter shall continue to operate with any combination of one or more phases remaining connected and supplying power when the supply voltage is within the extended operating range. In the case of a three-phase, three-wire network (where the meter is designed for this service), this requirement shall be met when any two of the three phases remain connected. Any internal timekeeping facility shall continue to maintain timekeeping under these conditions, without having to run on any operational reserve fitted.

7.3 Heating

Under rated operating conditions, electrical circuits and insulation shall not reach a temperature which might adversely affect the operation of the meter.

The requirements given in IEC 62052-31:2015, Clause 10 shall apply.

7.4 Insulation

The requirements given in IEC 62052-31:2015, 6.7, 6.8 and 6.10 shall apply. The supply switch contacts shall be in the closed position for these tests.

The meter and its incorporated auxiliary devices including any token carriers that may be inserted into the token carrier acceptor shall be designed such that they retain adequate dielectric qualities under normal conditions of use.

Where a token carrier acceptor is fitted, IEC 62052-31:2015, 4.3.2.10 shall apply.

After these tests, and when the payment meter has been restored to reference conditions, the payment meter shall operate correctly.

7.5 Long Term Over Voltage Withstand

The requirements given in IEC 62052-31:2015, 6.10.3.2 shall apply.

7.6 Electromagnetic compatibility (EMC)

7.6.1 General

The requirements given in IEC 62052-11:2020, Clause 9 shall apply subject to the following clarifications and augmentations:

7.6.2 General test conditions

The requirements given in IEC 62052-11:2020, 9.1 shall apply together with the following:

Any time-based charging shall be set to zero for the duration of these tests. The initial available credit and any settings in the payment meter shall be such that the supply control switch is not expected to operate during these tests. The supply control switch shall not operate during these tests, but for other functions a temporary degradation or loss of function or performance is acceptable unless stated otherwise.

No tokens shall be presented to the meter during these tests. Where the payment meter is fitted with a token carrier acceptor and the token carrier can be retained in the meter these tests shall be carried out with a customer token carrier in place in the meter during the tests.

Immediately after the end of each of the immunity tests, a valid credit token shall be presented. The token and payment meter shall then operate correctly, including operation of the supply control switch off and on. Any internal timekeeping facility shall continue to operate during and after these tests, and D.5.1 may also be applicable.

7.6.3 Test of immunity to electrostatic discharges

The requirements given in IEC 62052-11:2020, 9.3.3 shall apply together with the following: The test shall be carried out first with the supply control switch closed and repeated with the supply control switch open, and the supply control switch shall not operate during the tests. Where the payment meter is fitted with a token interface, the tests shall include air discharges to the keypad or to a customer token inserted into the token carrier acceptor where such a token carrier can be retained in the meter.

After the application of ESD testing, the payment meter shall revert to normal function and performance within a period of 1 min, without any external intervention.

7.6.4 Test of immunity to radiated RF electromagnetic fields

The requirements given in IEC 62052-11:2020, 9.3.4 and 9.3.5 shall apply together with the following:

The tests specified in IEC 62052-11:2020, 9.3.4 shall be performed with the supply control switch open.

The tests specified in IEC 62052-11:2020, 9.3.5 shall be performed with the supply control switch closed.

After the application of EMC testing, the payment meter shall revert to normal function and performance within a period of 1 min, without any external intervention.

7.6.5 Test of immunity to electrical fast transients/bursts

The requirements given in IEC 62052-11:2020, 9.3.6 shall apply together with the following:

The test shall be carried out first with the test load and limits of variation in percentage error as given in IEC 62053-21:2020, 7.10 and Table 4.

The test shall be repeated with the supply control switch open and therefore no test current flowing and with the load cables still connected. No change of the actual operating state or stored data is allowed. The meter shall continue to operate correctly after the test without any external intervention.

7.6.6 Test of immunity to conducted disturbances, induced by RF fields

The requirements given in IEC 62052-11:2020, 9.3.7 shall apply together with the following:

The test shall be carried out first for the test load and limits of variation in percentage error as given in IEC 62053-21:2020, 7.10 and Table 4. The test shall be carried out with the supply control switch closed and test current flowing. During the test, the normal behaviour of the payment meter shall not be disturbed.

The test shall be repeated with the supply control switch open and therefore no test current flowing and with the load cables still connected. No change of the actual operating state or stored data is allowed. The meter shall continue to operate correctly after the test without any external intervention.

7.6.7 Surge immunity test

The requirements given in IEC 62052-11:2020, 9.3.9 shall apply together with the following:

This test shall first be performed with the supply control switch closed.

The test shall then be repeated with the supply control switch open.

After the application of EMC testing the payment meter shall revert to normal function and performance within a period of 1 min, without any external intervention.

7.6.8 Test of immunity to damped oscillatory waves

The requirements given in IEC 62052-11:2020, 9.3.11 are not applicable to direct-connected payment meters.

7.6.9 Radio interference suppression

The requirements given in IEC 62052-11:2020, 9.3.14 shall apply.

7.7 Power consumption

7.7.1 General

The measurement of power consumption in the voltage and current circuits shall be determined as given in IEC 62052-11:2020, 4.4.

7.7.2 Voltage circuits

The active and apparent power consumptions are given in IEC 62052-11:2020, 4.4. Short-term increases in consumption due to the reading/writing of a token or the operation of a switch are permitted. Where the meter is fitted with a token carrier acceptor and the token carrier can be retained in the payment meter, then these power consumption requirements shall also be met with a normal token carrier retained in the meter in quiescent operation.

7.7.3 Current circuits

The apparent power taken by each current circuit of a direct-connected payment meter at maximum current, reference frequency, and reference temperature shall not exceed a value in VA equivalent to 0,08 % of U_n in volts multiplied by 100 % of $I_{\max}$ in amperes (e.g. 230 V and 60 A gives 11,0 VA; 230 V and 100 A gives 18,4 VA).

These values include consideration of the supply control switch.

7.8 Influence of self-heating on accuracy

The requirements given in IEC 62053-21:2020, 7.10 and Table 4 shall apply.

7.9 Electrical tests on supply control and load control switches (SCS and LCS)

The requirements given in IEC 62052-31:2015, 6.10.6 shall apply to all supply control switches.

The requirements given in IEC 62052-31:2015, 6.10.7 shall apply to all load control switches.

7.10 Auxiliary control switches (ACS)

Where fitted auxiliary output switches providing control signals to external equipment shall conform to the following requirements:

- Rated voltage: U_n .
- Rated current: 2 A.

Number of operations: The output switches shall be rated at U_n , 2 A, unity power factor for 10 000 contiguous make-and-break operations, together with U_n , 1 A, power factor 0,4 inductive for 10 000 contiguous make-and-break operations, so that a total of 20 000 make-and-break operations is required for a single switch specimen. This is a design requirement only, and no testing is required as part of the type testing plan for a payment meter.

7.11 Token carrier acceptor interface test

Where the payment meter is fitted with a token carrier acceptor, the meter and token carrier acceptor shall not suffer electrical damage and all the payment metering functions shall continue to operate normally when a metallic token carrier is inserted into the token aperture such that it short circuits all contacts to the token carrier. For testing purposes, the meter shall be operating at U_n , zero current, and with the supply control switch closed, when the metallic token carrier is inserted.

8 Accuracy requirements

The requirements given in IEC 62052-11:2020, Clause 7 shall apply including all subclauses, without a token carrier inserted in any token carrier acceptor fitted to the payment meter. Refer to 9.2 for checks at beginning and end of the tests.

If a token carrier acceptor is fitted and a token carrier can be retained in the payment meter then additional accuracy tests shall be carried out under reference conditions at U_n and unity power factor, with balanced loads, and at both $0,05 I_n$ and I_{max} .

The limits of variation in percentage error compared to the same load point and no token carrier present in the token carrier acceptor shall then be 0,2 for meters of Class 0,5, 0,3 for meters of Class 1, and 0,5 for meters of Class 2.

The payment meter shall be mounted as for normal service, including in a specified matching socket where applicable.

The response of the payment meter to energy flowing in the reverse direction shall be agreed between manufacturer and purchaser.

9 Functional requirements

9.1 General

The general requirements for operation of payment meter functionality over the temperature ranges and voltage ranges are given in 6.2 and 7.2.1.

When testing payment meters under Clauses 6, 7 and 8 a record of all relevant readings and status shall be made before and after each test or sequence of tests. The beginning and end readings shall then be reconciled with the testing procedure and duration to confirm the integrity of the meter accounting process. Subclause 9.2 gives further details of these requirements.

NOTE Refer to informative Annex A for some general functional requirements, tests, and testing guidelines for payment meters, which may for example be considered and applied when agreeing overall evaluation and system testing requirements between manufacturer and purchaser. Clause A.1 gives basic functional requirements and tests for the prepayment mode of operation. For additional features and options and other payment modes, the specifying of requirements and testing is more diverse and so an outline of the approaches that may be adopted is given in Clauses A.2 and A.3. Further evolution of the functional requirements and testing arrangements in Annex A is anticipated and so they do not have to be assessed during payment meter type tests.

9.2 Robustness of meter accounting process

Although acceptable error limits are defined for accuracy of energy measurement under nominal and influence conditions for electricity meters, there is not an equivalent acceptable error in the calculation of available credit on payment meters. In addition, the settings and current operating modes of the meter shall not change spontaneously as a result of testing.

Therefore when testing a payment meter under Clauses 6, 7, and 8, a record shall be made prior to each test or sequence of tests of all relevant registers, settings, status, and active modes, including:

- readings of all energy registers;
- readings of all energy-based rate settings (where monetary-based credit is used);
- readings of all credit and debt values;
- the modes that are active.

and where the meter includes a timekeeping function:

- readings of all time-based charge or credit settings (where used);
- meter time/date;
- offset of meter time from the time on the reference clock.

During each test, the amount of any token credit loaded into the meter shall be recorded.

At the end of each test or sequence of tests, these readings shall be recorded again. Further recordings may also be made when any settings are changed as part of the tests.

Unless specifically stated otherwise, a test or sequence of tests is passed only if the following conditions are also met:

- energy measurement is within the error limits specified for that test;
 - the meter's timekeeping accuracy is within acceptable limits for the timekeeping mode and the nature of the test;
 - there are no changes in any energy-based rate setting;
 - there are no changes in any time-based charge or credit setting;
 - any changes in credit and debt values are exactly accounted for by:
 - energy measured by the meter during the test x the value of the active energy-based rate setting
- and:
- duration of time recorded by the meter x the value of the active time-based charge or credit setting
- and:
- the value of any token credit accepted by the meter during the test;

NOTE 1 Verification of this value requires the ability to verify the value of valid credit on a token carrier before and after it has been presented to the meter.

- there are no changes to any active modes in the meter;
- the meter's display is functioning correctly;
- any push buttons on the meter operate correctly;
- token acceptance of a valid token occurs on the first or second presentation. This shall not be tested until satisfaction of the criteria listed above has been confirmed;
- the supply control switch operates correctly.

Unless specifically stated otherwise, a maximum of 1 energy-based rate setting and a maximum of 1 time-based charge or credit setting shall be active for the duration of any test.

NOTE 2 It is acceptable for 2 or more time-based charge settings (e.g. standing charge and debt collection) to be active during a test, provided that their combined value remains constant throughout the test.

If for some tests, it is required that the rate per kWh for the active rate is to be set to zero, then the rate per kWh for non-active rates shall be set to non-zero values.

Where the meter is operating within its limit range of operation, but outside its extended operating range, a valid credit token that is presented to the meter shall either be accepted correctly, or be rejected or ignored without modifying its information.

10 Type test

See both IEC 62052-11:2020, Clause 10 and its Annex P.

Where additional or modified test requirements are specified in this document, they may be carried out during the relevant sections of the recommended test sequence. The additional tests and checks in 9.1 and 9.2 may be carried out as part of the tests in the second group of the test schedule. A separate series of tests and specimens is required if IEC 62052-31:2015, 6.10.6 applies.

A detailed testing plan will need to be drawn up for the specific type of payment meter to be tested. The testing plan should take into consideration the following guidelines:

- Several identical specimens of the meter are likely to be required, the actual number being dependent upon the interfaces and functionality of the specific payment meter, the testing facilities and time constraints available, and the extent of any further specific type-testing that may also be applicable under Annex C or Annex D.
- The scope of the type testing carried out (including or excluding Annex C or Annex D) should be made clear at the front of the test report. This should include the nature of any specific agreements between manufacturer and purchaser, for example on timekeeping requirements.

NOTE 1 For some tests, it may be appropriate to test two specimens in parallel, with one to check accounting consistency and the other to check the operation of the supply control switch (such as for testing of climatic requirements).

NOTE 2 Where a specimen is subjected to any of the tests in 7.8 and its subclauses, then the matching requirements of D.5.1 may also be applicable.

IECNORM.COM : Click to view the full PDF of IEC 62055-31:2022

Annex A (informative)

Functional performance

A.1 Basic functionalities – prepayment mode

A.1.1 General

This Annex covers some functionalities, tests, and testing guidelines for payment meters, which may for example be considered and applied when agreeing any overall evaluation and system testing requirements between manufacturer and purchaser. The basic functionalities are given here for the prepayment mode of operation, and are separate to the normative requirements given in the main text of this document. For additional features and options and other payment modes, the specification of requirements and testing is more diverse and therefore an outline of the approaches that may be adopted is given in Clause A.2 and Clause A.3.

The core functionalities are covered in A.1.2 and their testing includes the sequence of operations and checks in A.1.3 that covers the basic functionality of the payment meter. The meter's behaviour will be dependent upon both hardware and software, as well as on influence factors. The sequence of tests is therefore repeated for combinations of the main influence factors, which are supply voltage and ambient temperature. Further basic functionalities are tested under reference conditions, unless otherwise stated, or are design considerations.

The payment meter should be mounted as for normal service, including in a specified matching socket where applicable. Verification should be carried out under reference conditions unless otherwise stated.

Where “maximum meter load” is stated, this should be taken as balanced at U_n , $I_{\max}$, and unity power factor. Where “minimum meter load” is stated, this should be taken as balanced at U_n , $0,05 I_n$ and unity power factor.

A.1.2 Prepayment mode – core functionalities

A.1.2.1 Token acceptance

The payment meter should handle valid and invalid tokens in accordance with the following requirements:

The acceptance of a valid token should always result in the exact amount of credit on the token carrier being transferred to the appropriate register(s) in the payment meter, and the available credit value in the meter should be incremented by exactly this amount (see Note 1).

Acceptance of the token should be indicated on the payment meter and should also always result in token cancellation so that this token is then invalid and cannot be accepted again. However, reusable token carriers may then be loaded with a new purchase of token credit and become valid again.

Where prevailing conditions prevent the acceptance of a valid token, it should be rejected as an invalid token, or ignored and left unchanged. A valid token that has previously been rejected or ignored should be capable of being accepted when prevailing conditions subsequently allow.

Verification of token acceptance should be carried out at both zero current and at $I_{\max}$ and unity power factor. Token acceptance should be verified at the limits of the extended operating range of supply voltage, and the limits of the specified operating range of temperature. Refer also to A.1.3, A.1.4, and A.1.5.

This should apply without the invocation of certain additional facilities that may be present in the meter, such as emergency credit, reserve credit, or token credit partially allocated for repayment of emergency credit debt.

Token acceptance should also be verified as part of some of the other requirements and tests given in Clauses 5, 6, 7 and 8.

NOTE 1 For some payment meter implementations using magnetic card token carriers, the token carrier acceptor applies a mark to the token carrier to indicate that token acceptance has been completed.

NOTE 2 For some payment meter implementations an audible signal is given to indicate that token acceptance has been completed.

A.1.2.2 Token rejection

The payment meter should handle valid and invalid tokens in accordance with the following requirements:

Under normal conditions, any invalid token should be rejected or ignored by the payment meter and should not result in any change to information in the accounting registers in the meter. Rejection or ignoring should not lead to any token cancellation or to any change of information on the token carrier, i.e. the token should remain valid for use in its intended application or with the correct meter.

The payment meter should always reject or ignore an invalid token under any prevailing conditions; there should be no prevailing conditions within the limit range of operation under which an invalid token can be accepted.

Where prevailing conditions prevent the acceptance or rejection of a token, it should be ignored and both the token and the meter's accounting register(s) should be left unchanged.

Verification of token rejection or ignoring should be carried out at both zero current and at $I_{\max}$ and unity power factor. Token rejection or ignoring should be verified at the limits of the extended operating range of supply voltage, and the limits of the specified operating range of temperature. Refer also to 6.2, 7.2.1, A.1.3.

A.1.2.3 Meter accounting process

The meter accounting process is handled in the payment meter itself. In general, in the prepayment mode, the metered kWh consumption leads to a proportionate decrementing of the available credit value. Time-based charges such as standing charges also decrement the available credit value where applicable. All such decrementing can reduce the available credit through zero to negative values unless further token credit is bought and loaded. When the available credit falls to zero, the supply control switch is opened automatically. Switching on of the supply control switch is only enabled when token credit is again loaded and the available credit becomes positive. Testing these other functions validates the meter accounting process.

The supply control switch interrupt/restore conditions may be different where there is additional functionality such as emergency credit, or token credit partially allocated for repayment of emergency credit debt; they will also be different for alternative payment modes (refer to Clause A.2).

A.1.2.4 Collection of consumption-based charges

Where application-specific non-interruption periods or emergency credit facilities are incorporated in a payment meter, they should be disabled before carrying out the following test.

The consumption-based charge function should be tested for a sufficient amount of energy consumption to ensure correct deductions from the available credit. Where the payment meter operates in monetary units, an appropriate price per kWh should be set. Where the payment meter includes time-based charging functions, they should be disabled for this test. Sufficient available credit should be provided and noted, and then maximum load should be applied to the payment meter for the necessary period of time. The advance of the cumulative kWh register should correspond to the deduction of available credit that has then taken place.

Where the payment meter operates in monetary units, the test should be repeated with a representative range of settings of price per kWh, including the maximum setting. Where the payment meter includes multi-rate kWh registers, these tests should be repeated for each rate of the kWh registers.

A.1.2.5 Collection of standing charges

Where the payment meter incorporates a standing charge collection facility the following should apply.

The available credit value should be decremented at the correct rate set for the time-based charges. The implementations of such charge deductions from available credit will vary between different payment meter types (e.g. deductions being made per hour or per day); appropriate choices of testing periods should be made.

Where the payment meter includes any other time-based charging functions, then they should be disabled for this test, and the meter load should be zero. An appropriate standing charge should then be set to permit verification of accurate deduction from available credit over a suitable test period. The choice of settings will be dependent upon the specific implementation of the standing charge facility in the payment meter.

The above test should then be repeated at maximum meter load and, where the payment meter operates in monetary units, an appropriate price per kWh should be set. The total deduction from available credit over the test period should then be correct in respect of both standing charge and kWh register advance. Where the payment meter includes multi-rate kWh registers these tests should be repeated for each rate of the kWh registers.

A.1.2.6 Interruption and restoration of the load

The meter should normally interrupt the load when the available credit has been consumed. The meter should be able to decrement the available credit value past zero, into negative values, including where for application-specific reasons the load is not interrupted when the available credit has been consumed.

Once the load is interrupted by such meter accounting process action, the supply control switch should only be operable to restore the load after a further appropriate manual intervention, e.g. by pressing a push button or by manually presenting a further credit token. This should be true for any conditions of the meter accounting process and available credit, and for any supply voltage or temperature within the limit ranges of operation.

Refer also to 5.4.3, 6.2, 7.2.1, 7.9, A.1.3, A.1.4, A.1.5.

A.1.2.7 Effect of power outages

In the event of a power system outage interrupting the power supply to the payment meter, there should be no malfunction in the operation of the meter accounting process. All registers should retain their values prior to the power outage. For test purposes, any time-based charging functions should be inhibited. Refer to A.1.3 for testing.

NOTE Refer to 7.2.2 for the influence of short voltage dips and interruptions.

A.1.3 Core functional tests within voltage and temperature range limits

The core functions of the payment meter should also be tested and requirements should be met under each of the following conditions:

- lower and upper limits of the specified operating temperature range;
- lower and upper limits of the extended operating voltage range.

The test sequence is therefore carried out four times under these conditions:

- lower temperature limit + lower voltage limit;
- lower temperature limit + upper voltage limit;
- upper temperature limit + lower voltage limit;
- upper temperature limit + upper voltage limit.

The following test sequence should be used:

- a) The payment meter should be in the prepayment mode and mounted for normal service, including in a specified matching socket where applicable. Where the meter includes collection of time-based charging functions, they should be disabled until the appropriate part of these tests. Where application-specific non-interruption periods or emergency credit facilities are incorporated, they should be disabled throughout these tests.
- b) Where the payment meter operates in monetary units, an appropriate price per kWh should be set. The meter should be prepared by applying a load until the available credit is exhausted and the supply control switch opens automatically. Readings of the cumulative kWh register and available credit value are then recorded. The supply voltage is then removed.
- c) The meter is subjected to the desired temperature limit and the temperature is allowed to stabilise. The supplied voltage is then applied with zero load current and after one minute, the register and value readings are again recorded, and checked for correct retention. An invalid token is then presented and checked for correct rejection.
- d) A valid token carrying a suitable amount of credit should then be presented to the meter to check token acceptance. The readings are then recorded and checked for the correct advance of available credit. The supply control switch should now be closed, or can be closed manually, depending on the design.
- e) The supply voltage is now removed for 5 min and then restored with zero load current. The readings are then recorded and checked for correct retention.
- f) A load of $I_{\max}$ and unity power factor is then applied so that the available credit reduces and eventually the supply control switch opens automatically. The readings are then recorded and their changes checked for correct reconciliation. In the case of a multi-rate meter, this test may be carried out for a single rate only.
- g) Where the payment meter includes a facility for collection of standing charges, the following test should apply. Where any other time-based charging functions are included, they should be disabled for this test. An appropriate standing charge should be set to permit verification of accurate deduction from available credit over a suitable test period. The choice of settings will be dependent upon the specific implementation of the standing charge facility in the payment meter.
A suitable token amount should then be loaded into the meter and the readings recorded. The meter should then remain under voltage with zero current for a suitable period of time, which should be measured with a reference clock. Upon the completion of this period, the readings should be recorded, and their changes checked for correct reconciliation.
- h) Test steps a) to g) should then be repeated for the lower temperature limit, but at the upper voltage limit.
- i) Test steps a) to h) should then be repeated at the upper temperature limit.

A.1.4 Functional tests within the limit range of operation with voltage

The requirements for payment meter operation outside the extended operating range of supply voltage but within the limit range of operation (i.e. from 0,0 to 0,8 U_n) are given in 7.2.1.4.

The following tests should be carried out under reference conditions, with the supply voltage to the payment meter varying between zero and 0,8 U_n . The following test sequence should be used:

- a) The payment meter should be in the prepayment mode and mounted for normal service, including in a specified matching socket where applicable. Where the meter includes collection of time-based charging functions, they should be disabled throughout these tests. Where application-specific non-interruption periods or emergency credit facilities are incorporated they should be disabled throughout these tests. Where the payment meter operates in monetary units, the maximum price per kWh should be set. In respect of any function covered by the note in 7.2.1.4 being included in the payment meter, this function may be inhibited where relevant.
- b) The meter should be arranged to have a negative value of available credit, such as to ensure that the supply control switch is open. Readings of the cumulative kWh register and available credit value are then recorded. The supply voltage is then removed.
- c) The supply voltage should be increased from zero at a steady and progressive rate of approximately 1 % of U_n per second with no load current, dwelling at each of the following levels for 60 s: 20 % U_n , 40 % U_n , 60 % U_n , 80 % U_n . While at 80 % U_n it should be verified that the supply control switch is in the correct position.
- d) After 60 s at 80 % U_n the supply voltage should be decreased at a steady and progressive rate of approximately 1 % of U_n per second with no load current, dwelling at each of the following levels for 60 s: 70 % U_n , 50 % U_n , 30 % U_n , 10 % U_n , before reaching zero.
- e) After 10 s at zero voltage, a supply voltage of 0,8 U_n should be applied to the meter and the readings of the cumulative kWh register and available credit value then recorded. Sufficient token credit should then be loaded to ensure that the supply control switch is closed. The readings of the cumulative kWh register and available credit value are then recorded again, and the supply voltage is then removed.

The test sequence in c), and d) is then repeated, with the supply control switch closed but no load current applied. After d) and 10 s at zero voltage, a supply voltage of 0,8 U_n should be applied to the meter and the readings of the cumulative kWh register and available credit value then recorded.

After these tests, the status of all registers, values, and parameters associated with the meter accounting process should be seen to have continued to be valid and free of corruption. Any internal timekeeping facility should be seen to have continued to maintain timekeeping. Any unexpected or uncontrolled behaviour occurring during these tests should be noted and attached to the test report for future reference.

A.1.5 Functional tests within the limit range of operation with temperature

The core functions of the payment meter should also be tested and requirements should be met under each of the following conditions:

- lower and upper limits of the limit range of operation with temperature;
- with the supply voltage at the reference voltage U_n in each case.

The test sequence is therefore carried out two times under these conditions:

- lower temperature limit + reference voltage;
- upper temperature limit + reference voltage.

The test sequence in A.1.3 items a) to f) should be used, first for the lower temperature limit, then repeated for the upper temperature limit. The test in A.1.3 g) is not required; however, any real-time clock should continue to maintain timekeeping during the test sequences.

A.1.6 Prepayment mode – token handling and data integrity requirements

A.1.6.1 Interruption to token acceptance

Where a token carrier acceptor is fitted to a payment meter, a token carrier will be inserted into the token carrier acceptor and normally the data transfer process will be completed before token carrier withdrawal takes place. Where the token carrier can be withdrawn from the acceptor before the data transfer process is completed, then the meter should be designed such that data on the token carrier should not be corrupted or lost and any data transferred to the payment meter should not be actioned until the token transaction is subsequently completed. Data corruption on the token carrier is permitted if the payment meter is able, from the information available, to reconstruct the appropriate data on the next insertion of the token carrier into the token carrier acceptor.

A.1.6.2 Rejection of duplicate tokens

A.1.6.2.1 General

Where payment system operation is based on meter-specific tokens for single use, the payment meter should ensure that no customer token intended for single use may be actioned more than once, including where token acceptance has been interrupted.

A.1.6.2.2 Test for rejection of duplicated tokens

Connect the meter as for normal use, with zero load. Generate a customer token, and a duplicate of the token.

Present the first token, and verify that the meter has accepted the token.

Then present the duplicated token. Verify that the meter rejects this token, and where a virtual token is used, that the meter issues an appropriate message.

A.1.6.3 Rejection of valid tokens when available credit is saturated

A.1.6.3.1 General

Where a valid token presented to the payment meter would result in the amount of available credit exceeding the maximum amount possible in the meter, then the token should be rejected. The token should not be erased or invalidated; presentation of a virtual token should result in an appropriate message being returned from the meter. It should be possible for the token to be presented and accepted at a later time when conditions then allow.

A.1.6.3.2 Test for saturation of available credit in the meter

Connect the payment meter as for normal use, with almost the maximum amount of available credit already present, and with zero load.

Generate a token that, when added to the current available credit, would give a total amount of available credit greater than the maximum amount that the meter is declared as being capable of handling.

Present this token to the payment meter. Verify that the meter rejects the token, and where appropriate that it has not been physically marked. For virtual tokens, verify that an appropriate message is returned from the meter.

Apply a load to reduce the available credit sufficiently to allow for acceptance of the token. Present the token again and verify that the meter now accepts it correctly.

A.1.6.4 Energy register roll-over

The cumulative kWh register should be set near to its maximum reading and sufficient available credit should be provided to allow for register roll-over. Where the payment meter operates in monetary units, the maximum price per kWh should be set. Where the payment meter includes time-based charging functions, they should be disabled for this test. Where emergency credit facilities are incorporated in a payment meter, they should not be used during this test. After noting the meter readings, the maximum meter load should then be applied sufficient to cause rollover of the cumulative kWh register. The rollover shall proceed correctly with the deduction from the available credit value corresponding to the advance of the kWh register.

Where the payment meter includes multi-rate kWh registers, this test should be repeated for each of the kWh registers.

A.1.6.5 Secure storage of credit

The payment meter should be designed such that the amount of credit stored in the meter cannot be changed other than by legitimate means, e.g. with a valid token or message.

A.1.6.6 Tariff security

Where the payment meter requires changes to tariff information held within it at any time, it should be designed such that the tariff information stored in the meter cannot be changed other than by legitimate means, e.g. with a valid token or message.

A.1.6.7 Reading and setting facilities

The payment meter may incorporate a service interface for extracting meter reading status and diagnostics information, and for making changes to payment mode, settings, security keys, or test modes to meet overall system requirements. These actions may be implemented via the token interface or via a separate service interface, possibly in conjunction with the push button(s) and display or indicators. In such cases, it should be designed such that it should not be possible to make any changes or resetting to the meter other than by legitimate means, e.g. with a valid token or message.

A.2 Additional functionalities

A.2.1 General

A payment meter may provide for additional features and options, and alternative modes of operation. The detailed specification of such additional functionality may be manufacturer-specific or of a proprietary nature, or be agreed between purchaser and supplier, or be defined by user organisations or standards.

Functional performance and testing guidelines and schedules will then need to be based on the relevant specifications, and may need to take account of the specific implementation and system requirements. In these circumstances, confirmation of compliance by the manufacturer or relevant organisation may be appropriate, or inspection and testing may be carried out jointly where so agreed between purchaser and supplier.

Details of additional functionalities and tests are under consideration and include the following aspects. Some aspects of payment system functionality may be dependent upon the associated infrastructure and management system. Such cases are not covered in this annex.

A.2.2 Requirements for other modes of operation

Since the main aspects of hardware-dependent functionality and performance are checked in the prepayment mode, the software-dependent functionality of any alternative modes of operation may be checked under reference conditions. This may apply to any of the following:

- credit limit mode;
- fixed payment mode;
- budget mode and reserved credit;
- emergency credit;
- token credit partially allocated for repayment of emergency credit debt;
- non-interruption periods;
- load-limiting mode;
- reverse-running interruption;
- multiple-block tariffs;
- collection of agreed debt.

In general, the testing of functionality for these modes and options are somewhat dependent upon the specific details of implementation and specific functional test sequences are likely to be needed. A general test sequence for the last point is given in A.2.3.

A.2.3 Collection of agreed debt

Where the payment meter incorporates a specific debt collection facility, the following should apply:

Where the payment meter includes any other time-based charging functions, they should initially be disabled for this test, and the meter load should be zero. An appropriate debt collection rate (and where applicable, an amount of agreed debt) should then be set to permit verification of accurate deduction from available credit over a suitable test period. The choice of settings will be dependent upon the specific implementation of the debt collection facility in the payment meter. Where applicable, the debt collection should cease when the agreed debt amount has been deducted from the available credit.

The above test should then be repeated at maximum meter load and maximum debt collection rate and, where the payment meter operates in monetary units, an appropriate price per kWh should be set. Where applicable, an appropriate amount of agreed debt should be set such that debt collection is to terminate before the end of the test period. The total deduction from available credit over the test period should then be correct in respect of both debt collection and kWh register advance. Where the payment meter includes multi-rate kWh registers, these tests should be repeated for each rate of the kWh registers.

Where the payment meter also includes collection of standing charges, the test at maximum load should be repeated with the standing charge also set at maximum.

A.2.4 Time-of-use tariff facilities

A.2.4.1 External tariff control

Where the meter includes arrangements for setting up the tariff register operation and displays, this should only be possible by legitimate means.

Checks of correct tariff register operation and displays should be made for each permissible combination of tariff control input signals (i.e. for each tariff rate). Checks of consumption-based charging should be made as in A.1.2.4.

A.2.4.2 Internal tariff control

Where an internal real-time clock is fitted for time-of-use tariff control, it should be possible to set the time, but only by legitimate means. It should also be possible to set the tariff time programme and tariff register displays, but only by legitimate means.

Checks of correct tariff register operation and displays should be made for each tariff rate, including checks of consumption-based charging as in A.1.2.4.

The correct operation of the tariff time programme and tariff register displays should be checked by setting appropriate test programmes that exercise each rate, weekday type, holiday type, and monthly or seasonal segment, where included. The checks should include correct roll-over for the beginning of each new type of tariff day, including at end of year and for 29th February where appropriate, as well as any summertime begins/ends dates. The manufacturer should state any restrictions that may apply when setting times or dates to make these checks. The date range over which the calendar function is tested should be consistent with the reasonable expectation of the life of the meter. The required calendar date/weekday functionality of the internal real-time clock should also be included as part of these checks.

The checks should also include unpowered operation of the meter over any relevant critical periods including change of season, change of year, over 29th February where appropriate, and over summertime begins/ends dates, with correct date/time and tariff status evident after the outage period. Where the meter includes facilities for storing a new tariff/charging programme for adoption from a defined future date, then this action should be checked, including with unpowered operation over change of year and 29th February and summertime changes during the pending period, and with power outages applied at the time the new tariff/charging programme is due to be adopted.

Where auxiliary output switches are fitted for time-of-use tariff purposes, their correct operation in response to these test programmes and rate changes should be included in these checks.

A.3 System compliance requirements

The payment meter is operated as part of an overall payment system, and the token interface, service port, or any remote communications port may be involved in data exchanges for both payment and system management purposes. The detailed specification of these data exchanges may be manufacturer-specific or of a proprietary nature, or be agreed between purchaser and supplier, or be defined by user organisations or standards.

The overall system requirements and payment meter compliance tests will then need to be based on the relevant system specification and system testing procedures. In these circumstances, confirmation of system compliance by the manufacturer or a relevant organisation may be appropriate.

The details of these system-dependent requirements and related system compliance tests are not covered in this document; they may be specified through reference to other specifications or standards.

Annex B (informative)

Reference model for a payment meter

B.1 General

This informative Annex B serves to draw attention to the core functions that are found in a payment meter, which should be taken into consideration while performing the type tests in the normative part of this document. Particular attention should be given to their proper functioning under abnormal influence conditions such as fault currents, voltage variation, temperature variation and EMC.

This annex should be read in conjunction with IEC 62055-21:2005 for more in-depth definitions of functions and processes in payment metering systems. From this perspective, the payment meter is one of the system entities that embodies certain functions and certain processes, which together create the payment meter application process. A function definition is an abstract representation of functionality and becomes concrete only once it is deployed in a specific instance of a payment meter. It essentially serves to model and define the workings of the payment meter.

A particular function may be implemented with any combination of its subclassified functions or with multiple instances of the same subclass. For example: a demand tariff may combine 3 time-based tariff rates with 2 consumption-based tariff rates with 1 monthly standing charge and a tax. Multiple instances of the same function class are also possible. For example: a payment meter may hypothetically implement a units-based accounting function together with a currency-based accounting function, the one being for consumption charges and the other for debt recovery charges. (See also B.3.4).

A clear distinction has to be made between the concept of a function and that of an object and also in understanding their mutual relationship. A function is an abstract definition of a capability that may be embodied in an object, where it then manifests as an instance of the function. An object is an entity (physical component, device or object-orientated model) that embodies one or more functions, giving it the capability to do things according to those functions.

It may also require several components in order to realise a specific function in a payment meter. For example: the load-side terminals, plus the supply control switch, plus the electronic driver circuitry, plus the firmware in the microprocessor, plus the memory storage space, all of which in combination embody the delivery function.

B.2 Generalised payment meter instance

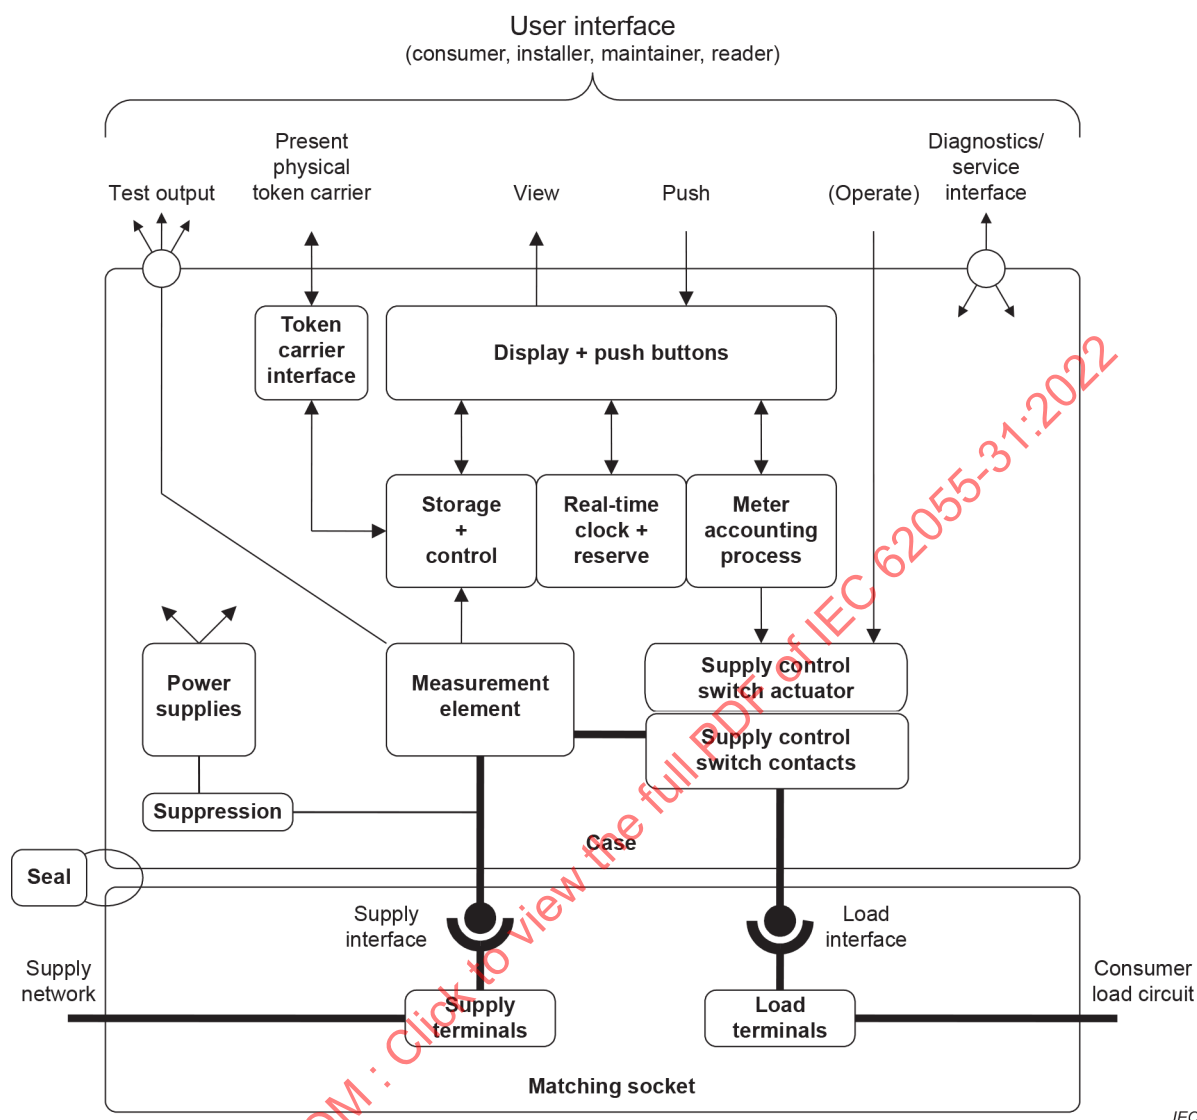


Figure B.1 – Generalised block diagram of a payment meter instance

In this instance, the single-part payment meter is arranged as a plug-in unit for use in a matching socket. The electrical connections between the two parts are made by means of suitable plugs and matching sockets. Once the two parts are properly installed and mechanically locked together, a suitable seal is installed to prevent unauthorised access to the supply terminals and load terminals in the socket.

During installation, the supply network is connected onto the supply terminals and the consumer's load circuit is connected to the load terminals in the socket. It can be seen that the load current passes through the measurement element and also through the supply control switch contacts in the active part of the payment meter, such that the electrical energy being consumed in the consumer load circuit can be measured and that the supply can be interrupted when the available credit runs out.

The power supplies for the internal workings of the payment meter are derived from the mains supply in this instance and are protected against the influence of electro-magnetic disturbances by means of suitable suppression circuits.

Measurements from the measurement element are passed on to the storage and control functions, typically realised by means of a microprocessor with supporting memory devices. The measurements are cumulatively stored and are also passed on to the meter accounting process for decrementing the available credit.

When the available credit reaches zero, the meter accounting process automatically causes the supply control switch actuator to operate such as to interrupt the supply to the consumer load circuit. The consumer then has to purchase more credit in order to replenish the available credit before he is able to consume more energy.

Credit is purchased by the consumer at a vending point, which is loaded onto a suitable token carrier for him to enter into the payment meter by means of the token carrier interface. Examples of typical token carriers are magnetic cards, barcodes, numeric strings printed on paper slips and solid-state memory devices such as smart cards and memory key devices. Correspondingly, typical token carrier interfaces are magnetic card readers, barcode readers, keypads, memory key readers and smart card readers.

The credit may also be transported to the meter via virtual token carriers over a communications link.

Certain re-usable token carriers also have the capability to be loaded with information by the payment meter and to transfer the information to the vending point on the next occasion that the consumer goes to purchase more credit. This information typically comprises consumption quantities, various accumulated charges performed by the meter accounting process and the technical status of the payment meter. This allows the management system to perform an accounting audit on, for example, credits purchased versus actual consumption and auxiliary charges transacted at the payment meter. All information loaded onto a token carrier is usually encrypted to prevent tampering and fraudulent activities.

Once the available credit is replenished, the meter accounting process will either automatically cause the supply control switch actuator to operate or to optionally enable it to be manually operated by the consumer in order to restore power to the consumer load circuit. Manual operation is usually performed by operating a mechanical lever that is accessible on the user interface of the payment meter.

The meter accounting process reduces the available credit according to tariff charges for actual consumption and optionally according to auxiliary charges, such as standing charges, debt recovery and taxes. Conversely, the meter accounting process increments the available credit in accordance with purchased credit or in accordance with other credit sources, such as emergency credit, that may be conditionally released by the meter accounting process.

A real-time clock with an operational reserve (backup battery) typically provides date and time information to the meter accounting process for the scheduling of time-based charges and release of time-based credit.

The user interface facilitates operating the meter by various users that interact with the meter from time to time. Examples of typical users are: the meter manufacturer, the installation technician, the maintenance technician, the meter inspector, the meter reader and the consumer. Besides the already described token carrier interface and the optional manually operable supply control switch actuator, various push buttons and a display are also typically provided on the front panel of the payment meter in order to input information to the various processes in the payment meter and to view the results from some of these processes. Examples of typical display values are: available credit, cumulative total consumption, date and time, tariff rates and register values.

An optional diagnostics/service interface may be provided by the payment meter, which may be located on the front or the back of the meter. An example of such an interface is an infra-red port on the front panel or an electrical connector for direct local connection to a diagnostic tool like a hand-held-unit.

A test output is usually provided on the front panel of the payment meter and takes the form of a lamp, which gives out visible light pulses in proportion to the energy being measured by the metering function. This enables external reference equipment to verify the metrological accuracy of the payment meter.

Many configuration variations of the generalised instance of a payment meter are possible. One example is a single part payment meter, where the terminals are integrated into the same case as the active part. Another example is a two-part payment meter where the user interface is separated from the active part and remotely located from each other.

B.3 Functions in a single-part payment meter

B.3.1 General

With reference to IEC 62055-21:2005, Figure 6, the supply interface connects to the supply network and the load interface to the consumer's load circuit while the user interacts with the payment meter by means of the user interface.

Subclauses B.3.2 to B.3.11 should be read in conjunction with IEC 62055-21:2005, 13.8 in order to gain a more detailed understanding of the functions and processes found in payment systems in general and in payment meters in particular.

B.3.2 Meter application process

The meter application process coherently joins together the functions deployed in the payment meter and controls the behaviour of the payment meter in response to the various inputs and outputs that are presented at its interfaces.

See also IEC 62055-21:2005, 13.8.2 for a more detailed definition of the various processes that constitute the meter application process.

B.3.3 Token_Carrier_to_Meter_Interface function

The Token_Carrier_to_Meter_Interface function deals with all activities related to the reading of information from and also the writing of information to the Token_Carrier.

It defines an application layer and physical layer in terms of the OSI reference model with possible intermediate layers, while the token carrier is defined as the carrier medium in the physical layer.

See IEC 62055-21:2005, 13.7.2 for more details on the definition and sub-classification of the Token_Carrier_to_Meter_Interface functions.

B.3.4 Accounting function

The accounting function maintains a current balance of all credit and charge transactions performed in the payment meter. These activities together constitute the meter accounting process.

See IEC 62055-21:2005, 13.8.3 for more details on the definition and sub-classification of the accounting functions.

B.3.5 Metering function

The metering function primarily deals with the measurement of the quantity of delivered electrical energy to the consumer. These measurements are made available for use by other functions in the payment meter.

See IEC 62055-21:2005, 13.8.4 for more details on the definition and sub-classification of the metering functions.

B.3.6 Delivery function

The delivery function primarily deals with the functions related to the delivery of electrical energy to the consumer's load circuit. It also monitors the status of the attributes of other functions, in response to which it interrupts or restores the supply of power.

See IEC 62055-21:2005, 13.8.5 for more details on the definition and sub-classification of the delivery functions.

B.3.7 Time functions

The time function maintains date and time information and time reference information for use by other functions. It also maintains status of any backup supply used for timekeeping during power outage of the supply network.

See IEC 62055-21:2005, 13.8.6 for more details on the definition and sub-classification of the time functions.

B.3.8 Test functions

The generic test function is a support function to all other functions embodied in the payment meter and specific instances of tests thus vary according to the particular implementations. See also IEC 62055-21:2005 Clause 6, 11.14, A.8.5.2, A.9.2.6, A.9.3.6, A.9.4.6 for more discussion on the test function and instances thereof.

Tests on a payment meter are typically initiated manually by the action of a user (consumer, service technician, installer and inspector). For example: the press of a button; entering a code; or inserting a special action token;

Examples of test functions are: testing for the correct functioning of indicators and display devices; of the supply control switch; of the token reading interface; of the integrity of the memory recording registers; of the meter accounting function; of the data transport functions; of the security functions; of the recording functions; of the metering function (optical test output for calibration) and of the system interfaces.

B.3.9 Display functions

The generic display function is a support function to all other functions embodied in the payment meter and specific instances of display activities thus vary according to the particular implementations. See also IEC 62055-21:2005, Clause 6, 11.15, A.8.5.2, A.8.6, A.9.2.3, A.9.3.3, A.9.4.3 for more discussion on the display function and instances thereof.

Examples of display devices are: alpha/numeric/graphic LCD; LED indicator; neon indicator; visible position of mechanical actuator lever; label on meter panel and terminal cover; barcode under meter serial number; printed numeric codes on paper token carriers.

Events to initiate or terminate the display process may be manually generated by a user, such as: the press of a button; entering a code; inserting a special action token. Events may also be automatically generated, such as a process state generating an indication of an alarm condition. Examples of process indicators are: the acceptance of a token; the rejection of a token; when a token is old (or expired); when a token has already been used; after a successful completion of a key change operation;

Examples of typical displayed information are: available credit; low level warning; accumulated consumption; accumulated charges; tariff rate; measured power; consumption rate; status of incoming supply; state of the supply control switch; tamper status; meter serial number; terminal cover markings; printed numeric token carrier; alarm indication.

B.3.10 Recording functions

The generic recording function is a support function to all other functions embodied in the payment meter and specific instances of recording activities thus vary according to the particular implementations. See also IEC 62055-21:2005, Clause 6, 11.16, A.8.5 (Set and Clear tokens), A.9.2.5, A.9.3.5, A.9.4.5, for more discussion on the recording function and instances thereof.

In general, the recording functions deal with recording of data into memory registers in the payment meter and are initiated by the entering of tokens and the occurrence of events within the meter application process (such as metering pulses due to consumption). It would also deal with the recording of data onto the token carrier where this is implemented and as such it would be a support function to the Token_Carrier_to_Meter_Interface function.

Examples of recording devices are: mechanical rotary registers; electronic memory in the payment meter or on the token carrier; printing on labels on the payment meter user interface.

Examples of recording registers are: cumulative token credit register; cumulative social credit register; cumulative credit advance register; cumulative emergency credit register; cumulative lifeline credit register; cumulative total consumption register; tariff rate registers, auxiliary charge rate registers; token identifier register; date and time register; supply control switch activation count register.

Examples of recorded parameters are: daylight savings; events calendar; power limit; under voltage limit; over voltage limit; phase unbalance limit; low credit warning level; accounting mode; emergency credit level; credit advance level; credit cycle; billing cycle; activation date; expiry date; schedules of tariff rates; schedules of auxiliary charge rates; token identifier; cryptographic key; meter serial number; software version; date of manufacture; manufacturer identifier.

Examples of recorded events are: credit expired; power limit exceeded; supply control switch opened/closed; over/under voltage detected; phase unbalance detected; tamper detected; internal reset occurred; memory failure detected; token entered.

B.3.11 Security functions

The generic security function is a support function to all other functions embodied in the payment meter and specific instances of security activities thus vary according to the particular implementations. See also IEC 62055-21:2005, Clause 6, 11.18, 13.7.2, A.8.4, A.8.7, A.9.2.4, A.9.3.4, A.9.4.4, for more discussion on the security function and instances thereof.

In general, the security functions deal with prevention and detection of physical access to sealed parts of the payment meter, assuring the integrity of recorded data elements and prevention of fraud in the form of tampering with data elements. The latter functions are present mainly in the application layer protocol of the Token_Carrier_to_Meter_Interface function.

Examples of physical protection and access control devices are: metal seals crimped around steel sealing wires; one-way screws; breakout plastic sealing caps for screw heads; tamper detection switch under cover plate of meter and terminal block; conformal coating of electronic components; shielding against magnetic fields; preventing entry of foreign objects; fail-safe techniques in the design of components (like the supply control switch).

Examples of data and function integrity methods are: use of CRC and parity checks with blocks of data elements; traceability of metrological certification.

Examples of data tampering prevention are: encryption/decryption techniques; message sequencing; unique token identifiers; use of MAC with data element blocks; use of public/private key signatures on data blocks and messages; token validation; token cancellation; token authentication; token erasure; key expiry; tariff expiry.

NOTE MAC is an acronym for Message Authentication Code, which is the result of a mathematical computation, performed on a set of data and may later be used to test the integrity of the set of data.

IECNORM.COM : Click to view the full PDF of IEC 62055-31:2022

Annex C (normative)

Requirements for payment meters with supply control switches

Requirements for testing of payment meters with supply control switches are given in 7.9. This annex is retained to provide compatibility for procurement specifications referring to IEC 62055-31, Annex C.

IECNORM.COM : Click to view the full PDF of IEC 62055-31:2022

Annex D (normative)

Requirements of timekeeping

D.1 General

D.1.1 General

Where a payment meter is of a type that provides for energy-based tariffs controlled from an internal real-time clock, then the timekeeping requirements of this Annex shall apply, at least as design requirements. The type-testing requirements in this Annex shall not be mandatory where testing the timekeeping of any internal real-time clock is not required for the legal metrology approval testing of payment meters.

NOTE 1 The calendar functions of any internal real-time clock are covered in A.2.4.2.

Where a payment meter is of a type that includes maximum demand tariffs and/or demand recording controlled from an internal real-time clock that is not subject to frequent synchronisation or setting via a virtual token carrier system or other external system, then the timekeeping provisions in IEC 62054-21:2004, 7.4 and 7.5 shall apply when agreed between manufacturer and purchaser.

NOTE 2 Some tariff or security applications that are not related to real time may employ an elapsed-time clock, but such applications are not covered in this document.

D.1.2 Real-time clock support facilities

Where a real-time clock is fitted and a battery or other support device is used to provide an operation reserve while no supply is available, then the following requirements shall be met. During an interruption of the supply voltage not exceeding the operation reserve, the payment meter shall keep the time within the prescribed accuracy.

An operation reserve shall be provided where the clock is used for internal tariff control or control of time-dependent credit.

In cases where a real-time clock is fitted but an operation reserve is either not fitted, or is not available when the supply voltage is restored, the manufacturer shall state what default status and indications are then adopted.

D.1.3 Operation reserve

For primary batteries and alternative support systems (e.g. a rechargeable battery or a supercapacitor), the timekeeping accuracy shall be better than a change in error of 1,5 s after running on the operation reserve for 36 h at reference temperature.

Unless otherwise stated, operational reserve use is defined as no supply voltage being applied at the payment meter terminals. For polyphase payment meters, the operation reserve shall not run while at least one of the phase-to-neutral voltages is present within the extended operating range.

NOTE If the supply voltage is below $0,8 U_n$ for a time period longer than the operation reserve, then the time may need to be readjusted.

Where the operation reserve is provided by a supercapacitor or a rechargeable battery, the maximum reserve restoration time shall not exceed 100 h.

D.1.4 Primary batteries

Where a primary battery is fitted, it shall be capable of providing reserve power for the minimum operational life of the meter, on the basis of an initial 2 years of continuous reserve use. Thereafter, the battery shall be capable of providing reserve power for 1 week per year for a minimum of 8 further years.

D.1.5 Back up battery replacement

Where the payment meter is designed to enable replacement of the back-up battery in use, it shall be designed in such a way that it does not lose the time during the replacement of the backup battery, even if a power outage occurs during this process. The time necessary for the replacement (with back-up battery disconnected) shall be less than 5 min.

D.1.6 Real-time clock setting and synchronisation facilities

It shall be possible to set the date and time (day, month, year, hours and minutes) with an accuracy of 5 s. The setting of the time shall reset the seconds to zero. If setting of the seconds is also available, then the setting of the time shall not reset the seconds to zero, but to the intended value.

If a daylight saving time function is available, the payment meter shall be capable of displaying the official time according to the regulations.

D.2 Synchronous clocks

Where fitted, a synchronous clock shall be capable of maintaining an accuracy of better than 0,15 s/24 h at reference conditions assuming that the supply frequency keeps its nominal value on average and without any power outages.

The synchronous clock shall operate normally for all values of frequency between 0,98 and 1,02 times the rated supply frequency, and for all values of voltage within the extended operating range.

Where an operation reserve based on a crystal-controlled clock is also fitted to handle timekeeping during power outage periods, the accuracy shall be better than 0,5 s/24 h, and the variation of timekeeping accuracy with temperature shall then be less than 0,15 s/°C/24 h. Testing to verify this requirement may be based on the method in D.4.4.3, or by measuring the change in time-indication discrepancy at each relevant temperature over suitable time periods.

D.3 Crystal-controlled clocks

Where fitted, a crystal-controlled time clock shall have timekeeping accuracy better than 0,5 s/24 h at reference temperature. The variation of timekeeping accuracy with temperature shall be less than 0,15 s/°C/24 h.

The crystal-controlled clock shall operate correctly for all values of frequency between 0,98 and 1,02 times the rated supply frequency.

On operation reserve, at reference temperature, the accuracy shall be better than 0,5 s/24 h, and the variation of timekeeping accuracy with temperature shall be less than 0,15 s/°C/24 h.

NOTE In applications where the payment meter is used as part of a system providing overall time synchronisation, the manufacturer and the purchaser may agree on relaxed timekeeping accuracy specifications for the payment meter when it is operating in stand-alone mode. In this case, the payment meter maintains the system time and synchronisation is performed by the system at the necessary intervals.

D.4 Tests of timekeeping accuracy

D.4.1 General

Where a payment meter includes provision for alternative timekeeping facilities (i.e. either synchronous or crystal-controlled modes may be selected for use) then the payment meter shall be tested in each of these modes.

D.4.2 General test conditions

Where the payment meter under test includes a clock it shall be placed in its normal operating position and in a climatic chamber where required, and supplied from a power source free of voltage dips and short interruptions. Unless otherwise indicated, the reference conditions specified in IEC 62052-11:2020, Table 10 shall be maintained.

For accuracy testing, the payment meter shall be able to display the real time, including the seconds, and shall allow for a means of time synchronisation where the seconds are either reset to zero, or to the intended value. The manufacturer should also provide a suitable means on the payment meter for rapid testing of the timekeeping accuracy. This could be, for example, an electrical or optical output, or, in the case of capacitor-calibrated crystal-controlled clocks, an electromagnetic coupling picking up the signal from the crystal. Where such test facilities provide for the timekeeping accuracy to be assessed over a shorter period of time, then the minimum period of time required for each test is that stated below.

D.4.3 Test of synchronous clocks in payment meters

D.4.3.1 Test of synchronous clock on AC supply

The payment meter under test is supplied in parallel with and synchronised to a synchronous reference clock. After a testing period of 6 days, the time indication discrepancy between the reference clock and the payment meter under test shall not be more than ± 1 s. The minimum period of time for this test is 144 h.

D.4.3.2 Test of synchronous clock on operation reserve

The payment meter to be tested is supplied with power in parallel with and synchronised with a crystal-controlled reference clock. Before the test, the payment meter shall be powered for a suitable length of time, so that the operation reserve is fully available.

The manufacturer should specify the time necessary for keeping the payment meter powered up before the test of operation reserve may commence.

The power supply to the payment meter under test is then switched off for 36 h. When the power supply is restored, the time-indication discrepancy between the reference clock and the payment meter under test shall not be more than $\pm 1,5$ s. The minimum period of time for this test is 36 h.

The restoration of the voltage shall be made with a switching device free from bounce.

D.4.4 Test of crystal-controlled clocks in payment meters

D.4.4.1 Test of crystal-controlled clocks on AC supplies

The payment meter under test is supplied with power and synchronised with a crystal-controlled reference clock. After a testing period of 2 days, the time-indication discrepancy between the reference clock and the payment meter under test shall not be more than 1 s. The minimum period of time for this test is 48 h.

D.4.4.2 Test of crystal-controlled clocks on operation reserve

The payment meter to be tested is supplied with power and synchronised with a crystal-controlled reference clock. Before the test, the payment meter shall be powered for a suitable length of time, so that the operation reserve is fully available.

The manufacturer should specify the time necessary for keeping the payment meter powered up before the test of operation reserve may commence.

The power supply to the payment meter under test is switched off for 36 h. When the power supply is restored, the time-indication discrepancy between the reference clock and payment meter under test shall not be more than $\pm 1,5$ s. The minimum time for this test is 36 h.

The restoration of the voltage shall be made with a switching device free from bounce.

D.4.4.3 Test of accuracy of crystal-controlled clocks with temperature

The payment meter is placed in a climatic chamber and its time base is measured at $+23$ °C. The temperature is then set at $+45$ °C. After thermal equilibrium is obtained, the timekeeping accuracy shall be better than $\pm 3,3$ s/24 h plus the timekeeping accuracy measured at reference temperature (maximum $\pm 0,5$ s/24 h).

The accuracy of the time base shall not differ from the 23 °C measurement by more than $\pm 38 \times 10^{-6}$.

The temperature is then set at -10 °C. After thermal equilibrium is obtained the timekeeping accuracy shall be better than $\pm 4,95$ s/24 h plus the timekeeping accuracy measured at reference temperature (max. $\pm 0,5$ s/24 h).

The accuracy of the time base shall not differ from the 23 °C measurement by more than $\pm 57 \times 10^{-6}$.

No minimum period of time is stated for this test.

D.5 Effects of disturbances on timekeeping

D.5.1 General

Where a payment meter includes provision for alternative timekeeping facilities (i.e. either synchronous or crystal-controlled modes may be selected for use), then the payment meter shall be tested in each of these modes.

D.5.2 Electromagnetic disturbances

The payment meter shall be designed in such a way that the electromagnetic disturbances specified in 7.6 do not have an adverse permanent effect on the timekeeping of any incorporated time function, including where the meter remains in powered operation after the disturbances have been removed.

Any internal timekeeping facility shall continue to operate during each of the EMC tests in 7.6.2 to 7.6.6, without any temporary loss of function.

For 7.6.2 Test of immunity to electrostatic discharges, during and after the test the disturbances shall not produce any change in time indication discrepancy.

For 7.6.3 a) Test of immunity to radiated RF electromagnetic fields at 10 V/m, during the test the disturbances shall not produce any change in the time displayed, and after the test there shall be no change in time indication discrepancy.

For 7.6.3 b) Test of immunity to radiated RF electromagnetic fields at 30 V/m, during the test the disturbances may result in unavailability of the setting facilities and a temporary change in timekeeping accuracy. However, after the test the time shall be preserved.

For 7.6.4 Test of immunity to electrical fast transients/bursts, during the test the disturbances may result in unavailability of the setting facilities and a temporary change in timekeeping accuracy. However, after the test the time indication discrepancy shall be preserved.

For 7.6.5 Test of immunity to conducted disturbances, induced by RF fields, during the test the disturbances shall not produce any change in the time displayed, and after the test there shall be no change in time indication discrepancy.

For 7.6.6 Surge immunity test, during the test the disturbances shall not produce any change in the time displayed, however the disturbances may result in a blinking display, unavailability of the setting facilities, and a temporary change in timekeeping accuracy. After the test the time indication discrepancy shall be preserved.

D.5.3 Voltage dips and short interruptions

D.5.3.1 General

The payment meter shall be designed in such a way that voltage dips and short interruptions, including those specified in 7.2.2 and in D.5.3.2 to D.5.3.6, do not adversely affect the timekeeping of any incorporated time function. Any internal timekeeping facility shall not be affected adversely during these tests and shall not exhibit any resulting time-indication discrepancies of more than the amounts given below.

D.5.3.2 Test of the effects of short interruptions and voltage dips

For these tests, the payment meter is supplied in parallel with and synchronised to a suitable type of reference clock before each test. Suitable equipment is inserted in the power supply line to the payment meter in order to submit the payment meter under test to programmable short interruptions and voltage dips without any switching bounce.

D.5.3.3 Effect of short interruptions on synchronous clocks

The payment meter under test is submitted to sequences of 20 successive supply interruptions with at least 5 s intervals between each interruption. The period of the interruptions to be applied shall be 100 ms in the first sequence and 1 s in the second sequence. After each test sequence, the time-indication discrepancy between the payment meter under test and the synchronous reference clock shall not be more than 2 s and 10 s respectively.

D.5.3.4 Effect of voltage dips on synchronous clocks

The supply voltage to the payment meter under test is reduced to 50 % of U_n for a period of 2 min, then restored directly to U_n . After the test, the time-indication discrepancy between the payment meter under test and the synchronous reference clock shall not be more than 1 s.

D.5.3.5 Effect of short interruptions on crystal-controlled clocks

The payment meter under test is submitted to the same sequences of supply interruptions as described in D.5.3.3. After each test, the time-indication discrepancy between the payment meter under test and the crystal-controlled reference clock shall not be more than 1 s in each case.

D.5.3.6 Effect of voltage dips on crystal-controlled clocks

The payment meter under test is powered as in D.5.3.4. After the test the time-indication discrepancy between the payment meter under test and the crystal-controlled reference clock shall not be more than 1 s.

D.5.4 Harmonics in the voltage waveform

The payment meter is supplied together with, and synchronised to, a suitable reference clock. A third harmonic content equivalent to 10 % of U_n is added to the supply voltage of the payment meter under test, symmetrically to each phase in the case of a polyphase meter.

The test is carried out for a period of 48 h under reference conditions. At the end of the test, the time-indication discrepancy between the payment meter under test and the reference clock shall not be more than ± 1 s for synchronous clocks and not more than ± 1 s for crystal-controlled clocks.

IECNORM.COM : Click to view the full PDF of IEC 62055-31:2022

Bibliography

IEC 60050-603:1986, *International Electrotechnical Vocabulary (IEV) – Part 603: Generation, transmission and distribution of electricity – Power systems planning and management*
IEC 60050-603:1986/AMD1:1998

IEC 60050-614:2016, *International Electrotechnical Vocabulary (IEV) – Part 614: Generation, transmission and distribution of electricity – Operation*

IEC 62059 (all parts), *Electricity metering equipment – Dependability*

IECNORM.COM : Click to view the full PDF of IEC 62055-31:2022

SOMMAIRE

AVANT-PROPOS	57
INTRODUCTION	59
1 Domaine d'application	60
2 Références normatives	61
3 Termes et définitions	62
3.1 Généralités sur le comptage à paiement	62
3.2 Jetons	64
3.3 Supports de jeton	65
3.4 Jetons et supports de jeton	67
3.5 Interrupteurs du matériel de comptage	68
3.6 Chronométrage et contrôle de la tarification	68
4 Valeurs électriques nominales	70
5 Exigences relatives à la construction	70
5.1 Généralités	70
5.2 Distance dans l'air et lignes de fuite	70
5.3 Protection contre la pénétration de la poussière et de l'eau	70
5.4 Affichage des valeurs mesurées	70
5.4.1 Généralités	70
5.4.2 Possibilité minimale de l'affichage	70
5.4.3 Voyants	71
5.5 Stockage des valeurs mesurées	71
5.6 Dispositif de sortie	71
5.7 Marquage du compteur	72
5.8 Interface de support de jeton	72
5.8.1 Généralités	72
5.8.2 Mécanisme d'insertion de jetons	72
5.8.3 Interface de clavier	72
6 Conditions climatiques	72
6.1 Généralités	72
6.2 Domaine de température	72
6.2.1 Généralités	72
6.2.2 Fonctionnement dans le domaine de fonctionnement spécifié	73
6.2.3 Fonctionnement dans le domaine de fonctionnement limite	73
6.2.4 Stockage et transport en dehors du domaine de fonctionnement limite	74
6.3 Humidité relative	74
6.4 Protection contre la pénétration de la poussière et de l'eau	74
6.5 Essais de l'effet des environnements climatiques	74
7 Exigences électriques	74
7.1 Exigences générales	74
7.2 Influence de la tension d'alimentation	75
7.2.1 Domaine ou domaines de tension	75
7.2.2 Creux de tension et interruptions brèves	77
7.2.3 Conditions de tension anormales	77
7.3 Echauffement	78
7.4 Isolation	78

7.5	Tenue de surtension à long terme	78
7.6	Compatibilité électromagnétique (CEM)	78
7.6.1	Généralités	78
7.6.2	Conditions générales des essais	78
7.6.3	Essai d'immunité aux décharges électrostatiques	79
7.6.4	Tenue aux champs électromagnétiques RF (radiofréquences) rayonnés	79
7.6.5	Essai d'immunité aux transitoires électriques rapides	79
7.6.6	Essai d'immunité aux perturbations conduites, induites par les champs RF	79
7.6.7	Essai d'immunité aux ondes de choc	80
7.6.8	Essai d'immunité aux ondes à oscillations amorties	80
7.6.9	Suppression des perturbations radioélectriques	80
7.7	Puissance absorbée	80
7.7.1	Généralités	80
7.7.2	Circuits de tension	80
7.7.3	Circuits de courant	80
7.8	Influence de l'échauffement propre sur la précision	80
7.9	Essais électriques sur les interrupteurs de commande de l'alimentation et de commande de charge (SCS et LCS)	80
7.10	Interrupteurs de commande auxiliaires (ACS, Auxiliary Control Switches)	81
7.11	Essai de l'interface du mécanisme d'insertion de jetons	81
8	Exigences de précision	81
9	Exigences fonctionnelles	81
9.1	Généralités	81
9.2	Robustesse du processus de comptabilité du compteur	82
10	Essai de type	83
Annexe A (informative)	Performance fonctionnelle	85
A.1	Fonctionnalités de base – mode de prépaiement	85
A.1.1	Généralités	85
A.1.2	Mode de prépaiement – fonctionnalités de base	85
A.1.3	Essais fonctionnels de base dans les limites des domaines de tension et de température	88
A.1.4	Essais fonctionnels dans le domaine de fonctionnement limite de tension	89
A.1.5	Essais fonctionnels dans le domaine de fonctionnement limite de température	90
A.1.6	Mode de prépaiement – gestion des jetons et exigences d'intégrité des données	90
A.2	Fonctionnalités supplémentaires	92
A.2.1	Généralités	92
A.2.2	Exigences pour les autres modes de fonctionnement	92
A.2.3	Collecte de créance convenue	93
A.2.4	Dispositions de tarification du temps d'utilisation	93
A.3	Exigences de conformité du système	94
Annexe B (informative)	Modèle de référence d'un compteur à paiement	95
B.1	Généralités	95
B.2	Instance de compteur à paiement généralisé	96
B.3	Fonctions d'un compteur à paiement en une seule partie	98
B.3.1	Généralités	98
B.3.2	Processus d'application du compteur	98

B.3.3	Fonction Token_Carrier_to_Meter_Interface	98
B.3.4	Fonction Accounting	99
B.3.5	Fonction Metering	99
B.3.6	Fonction Delivery	99
B.3.7	Fonctions Time	99
B.3.8	Fonctions Test	99
B.3.9	Fonctions Display	100
B.3.10	Fonctions Recording	100
B.3.11	Fonctions Security	101
Annexe C (normative) Exigences pour les compteurs de paiement avec interrupteurs de commande de l'alimentation		102
Annexe D (normative) Exigences du chronométrage		103
D.1	Généralités	103
D.1.1	Généralités	103
D.1.2	Dispositions de prise en charge d'une horloge temps réel	103
D.1.3	Réserve de fonctionnement	103
D.1.4	Piles	104
D.1.5	Remplacement de la pile de sauvegarde	104
D.1.6	Paramètre de l'horloge temps réel et dispositions de synchronisation	104
D.2	Horloges synchrones	104
D.3	Horloges pilotées par résonateur à quartz	104
D.4	Essais de précision du chronométrage	105
D.4.1	Généralités	105
D.4.2	Conditions générales des essais	105
D.4.3	Essai d'horloges synchrones dans les compteurs à paiement	105
D.4.4	Essai d'horloges pilotées par résonateur à quartz dans les compteurs à paiement	106
D.5	Effets des perturbations sur le chronométrage	107
D.5.1	Généralités	107
D.5.2	Perturbations électromagnétiques	107
D.5.3	Creux de tension et interruptions brèves	107
D.5.4	Harmoniques de la forme d'onde de tension	108
Bibliographie		109
Figure B.1 – Synoptique généralisé d'une instance de mesure de paiement		96
Tableau 1 – Domaines de tension		75

COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

ÉQUIPEMENTS DE COMPTAGE DE L'ÉLECTRICITÉ –
SYSTÈMES À PAIEMENT –Partie 31: Exigences particulières –
Compteurs statiques à paiement d'énergie active (classes 0,5, 1 et 2)

AVANT-PROPOS

- 1) La Commission Electrotechnique Internationale (IEC) est une organisation mondiale de normalisation composée de l'ensemble des comités électrotechniques nationaux (Comités nationaux de l'IEC). L'IEC a pour objet de favoriser la coopération internationale pour toutes les questions de normalisation dans les domaines de l'électricité et de l'électronique. A cet effet, l'IEC – entre autres activités – publie des Normes internationales, des Spécifications techniques, des Rapports techniques, des Spécifications accessibles au public (PAS) et des Guides (ci-après dénommés "Publication(s) de l'IEC"). Leur élaboration est confiée à des comités d'études, aux travaux desquels tout Comité national intéressé par le sujet traité peut participer. Les organisations internationales, gouvernementales et non gouvernementales, en liaison avec l'IEC, participent également aux travaux. L'IEC collabore étroitement avec l'Organisation Internationale de Normalisation (ISO), selon des conditions fixées par accord entre les deux organisations.
- 2) Les décisions ou accords officiels de l'IEC concernant les questions techniques représentent, dans la mesure du possible, un accord international sur les sujets étudiés, étant donné que les Comités nationaux de l'IEC intéressés sont représentés dans chaque comité d'études.
- 3) Les Publications de l'IEC se présentent sous la forme de recommandations internationales et sont agréées comme telles par les Comités nationaux de l'IEC. Tous les efforts raisonnables sont entrepris afin que l'IEC s'assure de l'exactitude du contenu technique de ses publications; l'IEC ne peut pas être tenue responsable de l'éventuelle mauvaise utilisation ou interprétation qui en est faite par un quelconque utilisateur final.
- 4) Dans le but d'encourager l'uniformité internationale, les Comités nationaux de l'IEC s'engagent, dans toute la mesure possible, à appliquer de façon transparente les Publications de l'IEC dans leurs publications nationales et régionales. Toutes divergences entre toutes Publications de l'IEC et toutes publications nationales ou régionales correspondantes doivent être indiquées en termes clairs dans ces dernières.
- 5) L'IEC elle-même ne fournit aucune attestation de conformité. Des organismes de certification indépendants fournissent des services d'évaluation de conformité et, dans certains secteurs, accèdent aux marques de conformité de l'IEC. L'IEC n'est responsable d'aucun des services effectués par les organismes de certification indépendants.
- 6) Tous les utilisateurs doivent s'assurer qu'ils sont en possession de la dernière édition de cette publication.
- 7) Aucune responsabilité ne doit être imputée à l'IEC, à ses administrateurs, employés, auxiliaires ou mandataires, y compris ses experts particuliers et les membres de ses comités d'études et des Comités nationaux de l'IEC, pour tout préjudice causé en cas de dommages corporels et matériels, ou de tout autre dommage de quelque nature que ce soit, directe ou indirecte, ou pour supporter les coûts (y compris les frais de justice) et les dépenses découlant de la publication ou de l'utilisation de cette Publication de l'IEC ou de toute autre Publication de l'IEC, ou au crédit qui lui est accordé.
- 8) L'attention est attirée sur les références normatives citées dans cette publication. L'utilisation de publications référencées est obligatoire pour une application correcte de la présente publication.
- 9) L'attention est attirée sur le fait que certains des éléments de la présente Publication de l'IEC peuvent faire l'objet de droits de brevet. L'IEC ne saurait être tenue pour responsable de ne pas avoir identifié de tels droits de propriété et averti de leur existence.

L'IEC 62055-31 a été établie par le comité d'études 13 de l'IEC: Comptage et pilotage de l'énergie électrique. Il s'agit d'une Norme internationale.

Cette seconde édition annule et remplace la première édition parue en 2005. Cette édition constitue une révision technique.

Cette édition inclut les modifications techniques majeures suivantes par rapport à l'édition précédente:

- a) modification du titre;
- b) suppression du contenu de l'Annexe C concernant les exigences relatives à l'interrupteur de commande de l'alimentation et ajout de la référence à l'IEC 62052-31:2015 qui contient les exigences pertinentes.

Le texte de cette Norme internationale est issu des documents suivants:

Projet	Rapport de vote
13/1864/FDIS	13/1866/RVD

Le rapport de vote indiqué dans le tableau ci-dessus donne toute information sur le vote ayant abouti à son approbation.

La langue employée pour l'élaboration de cette Norme internationale est l'anglais.

Le présent document a été rédigé selon les Directives ISO/IEC, Partie 2, il a été développé selon les Directives ISO/IEC, Partie 1 et les Directives ISO/IEC Supplément IEC, disponibles sous www.iec.ch/members_experts/refdocs. Les principaux types de documents développés par l'IEC sont décrits plus en détail sous www.iec.ch/standardsdev/publications.

Une liste de toutes les parties de la série IEC 62055, publiées sous le titre général *Equipements de comptage de l'électricité – Systèmes à paiement*, peut être consultée sur le site web de l'IEC.

Le comité a décidé que le contenu du présent document ne sera pas modifié avant la date de stabilité indiquée sur le site web de l'IEC sous webstore.iec.ch dans les données relatives au document recherché. A cette date, le document sera:

- reconduit,
- supprimé,
- remplacé par une édition révisée, ou
- amendé.

INTRODUCTION

Les compteurs à paiement sont utilisés dans des situations où la fourniture d'énergie électrique à une charge peut être coupée ou son rétablissement activé par le compteur à paiement en fonction d'un tarif de paiement ayant fait l'objet d'un accord entre le client et le fournisseur. Le compteur à paiement fait partie d'un système utilisant des supports de jeton pour transmettre les informations de paiement sous forme de jetons entre le réseau d'un fournisseur et les compteurs à paiement comprenant le processus de comptabilité du compteur.

Le principal objectif de la présente édition est de s'aligner sur les exigences introduites dans l'IEC 62052-31:2015 relative à la sécurité des compteurs.

Les fonctions d'un compteur à paiement sont la mesure de l'énergie électrique consommée et la diminution de la valeur de crédit disponible en fonction de la consommation mesurée, et en principe en fonction du temps passé. La valeur de crédit disponible est augmentée à la suite des paiements effectués au fournisseur d'électricité, le processus de comptabilité du compteur calcule en permanence le solde du crédit disponible du client. Lorsque la valeur de crédit disponible a diminué jusqu'à une valeur prédéterminée qui est associée au mode de paiement utilisé, un interrupteur est utilisé pour interrompre l'alimentation de la charge du client. Toutefois, des caractéristiques supplémentaires peuvent exister dans le compteur à paiement, empêchant ou retardant l'ouverture de l'interrupteur, ou limitant toute prochaine consommation à un faible niveau de charge. Ces dispositions "sociales" peuvent inclure la fourniture de dispositions de crédit d'urgence, la possibilité de fonctionnement dans un mode de paiement fixe et l'inhibition des interruptions pendant certaines périodes de temps.

En réponse au paiement (habituellement en numéraire) et en fonction du type de système particulier, le client peut recevoir un jeton à usage unique sur un support de jeton jetable de valeur équivalente, ou bien un support de jeton réutilisable peut être crédité de la valeur du jeton ou le jeton peut être directement transmis au compteur par l'intermédiaire d'un réseau de communication (appelé support de jeton virtuel). Des systèmes de transfert de données "unidirectionnel" et "bidirectionnel" peuvent être utilisés et les supports de jeton peuvent être des dispositifs physiques tels que des cartes à puce ou d'autres dispositifs électroniques ou des cartes magnétiques, des supports de jeton virtuels où les informations de jeton sont transférées par un système de communication distant ou des supports de jeton numériques où des séries de chiffres sont fournies sur un reçu papier et saisies sur le compteur au moyen d'un clavier.

L'IEC 62051:1999, Article 17, donne certains détails de la terminologie du comptage à paiement.

ÉQUIPEMENTS DE COMPTAGE DE L'ÉLECTRICITÉ – SYSTÈMES À PAIEMENT –

Partie 31: Exigences particulières – Compteurs statiques à paiement d'énergie active (classes 0,5, 1 et 2)

1 Domaine d'application

La présente partie de l'IEC 62055 s'applique à des compteurs à paiement statiques de wattheures nouvellement fabriqués de classe de précision 0,5, 1 et 2 pour raccordement direct, pour la mesure de la consommation d'énergie électrique en courant alternatif d'une fréquence allant de 45 Hz à 65 Hz, incluant un interrupteur de commande de l'alimentation ayant pour but d'interrompre ou de rétablir la fourniture d'électricité à la charge en fonction de la valeur courante du crédit disponible maintenu dans le compteur à paiement. Elle ne s'applique pas aux compteurs à paiement statiques de wattheures dont la tension entre bornes de raccordement dépasse 1 000 V (tension entre phases pour les compteurs de systèmes polyphasés).

Elle s'applique aux compteurs à paiement pour applications intérieures utilisées dans des conditions climatiques normales, là où le compteur à paiement est monté comme en service normal (c'est-à-dire avec un socle correspondant spécifié, le cas échéant).

Les compteurs à paiement constituent des mises en œuvre de tous les éléments fonctionnels principaux incorporés dans une enceinte unique, avec un socle correspondant spécifié. Il existe également des installations de comptage à paiement à dispositifs multiples, dans lesquelles les divers éléments fonctionnels principaux, par exemple l'élément de mesure, l'unité d'interface utilisateur, l'interface de support de jeton et l'interrupteur de commande de l'alimentation, sont mis en œuvre dans plusieurs enceintes, ce qui implique des interfaces supplémentaires.

Les exigences fonctionnelles qui s'appliquent aux compteurs à paiement sont également définies dans le présent document, et comprennent des exigences fonctionnelles informatives de base et des essais pour le mode de fonctionnement par prépaiement de l'Annexe A. Des marges sont prévues pour le domaine relativement large de caractéristiques, options, aides actives et mises en œuvre qui peuvent exister en pratique. La nature et les fonctionnalités diverses des compteurs à paiement empêchent une spécification exhaustive de méthodes d'essai détaillées pour toutes ces exigences. Dans ce cas toutefois, les exigences sont mentionnées de telle manière que des essais puissent ensuite être formulés pour respecter et valider la fonctionnalité spécifique du compteur à paiement soumis à essai.

Le présent document ne traite pas de la fonctionnalité spécifique ou des exigences de performance concernant la protection des circuits, l'isolation ou des objectifs similaires qui peuvent être spécifiés en référence à d'autres spécifications ou normes. Les exigences de sécurité supprimées de l'Edition 1.0 ont été remplacées par des références aux exigences de sécurité, qui se trouvent à présent dans l'IEC 62052-31:2015, qui est la norme de sécurité produit des compteurs électriques nouvellement fabriqués. Les essais de sécurité en service (in-service safety testing – ISST) ne sont pas couverts par l'IEC 62052-31:2015 et cèdent la place aux meilleures pratiques du pays, habituellement comme extension des essais en service (in-service testing – IST) existants concernant la stabilité métrologique.

Le présent document ne traite pas des exigences logicielles. Le présent document traite uniquement des exigences d'essai de type. Pour les essais d'acceptation, les exigences données dans l'IEC 62058-11:2008 et l'IEC 62058-31:2008 peuvent être utilisées.

Les aspects de sûreté sont traités dans la série de normes IEC 62059. Les aspects supplémentaires relatifs à la fiabilité, la disponibilité, la maintenance et la durée de vie sont donnés par l'IEC TC 56.

Le présent document ne traite pas des essais de conformité ni des essais de conformité du système qui peuvent être exigés en relation avec des exigences légales ou autres sur certains marchés.

2 Références normatives

Les documents suivants cités dans le texte constituent, pour tout ou partie de leur contenu, des exigences du présent document. Pour les références datées, seule l'édition citée s'applique. Pour les références non datées, la dernière édition du document de référence s'applique (y compris les éventuels amendements).

IEC 60050-300:2001, *Vocabulaire Electrotechnique International – Partie 300: Mesures et appareils de mesure électriques et électroniques – Partie 311: Termes généraux concernant les mesures – Partie 312: Termes généraux concernant les mesures électriques – Partie 313: Types d'appareils électriques de mesure – Partie 314: Termes spécifiques selon le type d'appareil*

IEC 60050-300:2001/AMD1:2015

IEC 60050-300:2001/AMD2:2016

IEC 60050-300:2001/AMD3:2017

IEC 60050-300:2001/AMD4:2020

IEC TR 62051:1999, *Electricity metering – Glossary of terms* (disponible en anglais seulement)

IEC 62052-11:2020, *Equipement de comptage de l'électricité – Exigences générales, essais et conditions d'essai – Partie 11: Equipement de comptage*

IEC 62052-31:2015, *Equipement de comptage de l'électricité (CA) – Exigences générales, essais et conditions d'essai – Partie 31: Exigences et essais sur la sécurité de produit*

IEC 62053-21:2020, *Equipement de comptage de l'électricité – Exigences particulières – Partie 21: Compteurs statiques d'énergie active en courant alternatif (classes 0,5, 1 et 2)*

IEC 62054-21:2004, *Equipement de comptage d'électricité (C.A.) – Tarification et contrôle de charge – Partie 21: Exigences particulières pour les horloges de tarification*

IEC 62054-21:2004/AMD1:2017

IEC TR 62055-21:2005, *Electricity metering – Payment systems – Part 21: Framework for standardisation* (disponible en anglais seulement)

IEC 62058-11:2008, *Equipement de comptage de l'électricité (c.a.) – Contrôle de réception – Partie 11: Méthodes générales de contrôle de réception*

IEC 62058-31:2008, *Equipement de comptage de l'électricité (c.a.) – Contrôle de réception – Partie 31: Exigences particulières pour compteurs statiques d'énergie active (de classes 0,2 S, 0,5 S, 1 et 2)*

3 Termes et définitions

Pour les besoins du présent document, les termes et définitions donnés dans l'IEC 60050-300:2001, l'IEC 62051:1999, l'IEC 62052-11:2020 et l'IEC 62055-21:2005, ainsi que les suivants, s'appliquent.

NOTE En cas de différence entre les définitions de l'IEC 62055-31 et celles renfermées dans d'autres normes IEC de référence, les définitions de l'IEC 62055-31 ont priorité.

3.1 Généralités sur le comptage à paiement

3.1.1

tension de tenue en courant alternatif

valeur efficace de la tension sinusoïdale à fréquence industrielle que le matériel peut supporter pendant des essais faits dans des conditions spécifiées et pendant une durée spécifiée

[SOURCE: IEC 60050-614:2016, 614-03-22, modifiée]

3.1.2

valeur de crédit disponible

valeur du crédit disponible (en unités monétaires ou d'énergie) utilisable pour consommation ultérieure, enregistrée dans le compteur à paiement ou calculée par celui-ci à chaque fois qu'elle est exigée, qui comprend le crédit social si celui-ci est mis en œuvre

3.1.3

courant de défaut

courant circulant en un point donné d'un réseau résultant d'un défaut en un autre point de ce réseau

[SOURCE: IEC 60050-603:1986, 603-02-25]

3.1.4

interrupteur de commande de charge

LCS

Voir IEC 62052-31:2015, 3.7.3.

3.1.5

interface de charge

borne ou bornes par lesquelles le circuit de charge du client est raccordé au compteur à paiement ou à un socle correspondant spécifié le cas échéant

3.1.6

installation de comptage à paiement à dispositifs multiples

installation de comptage à paiement où les éléments fonctionnels comprenant l'élément ou les éléments de mesure, le ou les registres, la mémoire et la commande, le processus de comptabilité du compteur, l'interface utilisateur incluant toute interface de support de jeton physique, toute interface de support de jeton virtuel, le ou les interrupteurs de charge, les accessoires, l'interface de l'alimentation positive et l'interface de charge ne sont pas disposés sous la forme d'un compteur à paiement, mais sont partagés en un ou plusieurs dispositifs exigeant un raccordement de montage et une mise en service appropriés

[SOURCE: IEC 62051:1999, 17.45]

3.1.7

compteur à paiement

compteur électrique possédant une fonctionnalité supplémentaire qui peut être actionnée et commandée pour permettre la fourniture d'énergie en fonction du mode de paiement convenu

Note 1 à l'article: Il comporte les éléments fonctionnels suivants: élément ou éléments de mesures, registre ou registres, mémoire et commande, processus de comptabilité de compteur et toute fonction basée sur le temps, interface utilisateur incluant toute interface de support de jeton physique, toute interface de support de jeton virtuel, le ou les interrupteurs de charge, les accessoires, l'interface de l'alimentation positive et l'interface de charge. Un compteur à paiement prend la forme d'une unité unique ou d'une unité principale utilisant également un socle correspondant spécifié unique pour l'interface d'alimentation et l'interface de charge. Dans les deux cas, certaines mises en œuvre de compteur à paiement peuvent permettre la fourniture de certaines ou de la totalité des fonctions basées sur le temps par une unité externe raccordée au compteur à paiement, telle qu'une minuterie, une télécommande centralisée ou un récepteur radio.

Note 2 à l'article: Se référer à la Figure B.1 pour le synoptique généralisé d'un exemple de compteur à paiement.

[SOURCE: IEC 62051:1999, 17.47]

3.1.8

installation de comptage à paiement

mise en place d'un matériel de comptage à paiement installé et prêt à l'usage dans les locaux du client

Note 1 à l'article: Elle comporte le montage approprié du matériel et, si une installation de comptage à paiement à plusieurs dispositifs existe, le raccordement approprié de chaque unité de matériel. Elle comporte également le raccordement du réseau de distribution électrique à l'interface d'alimentation, le raccordement du circuit de charge du client à l'interface de charge et la mise en service du matériel dans un état fonctionnel d'installation de comptage à paiement.

3.1.9

mode de prépaiement

mode de paiement dans lequel une interruption automatique se produit lorsque la valeur du crédit disponible est épuisée

3.1.10

crédit social

valeur de crédit supplémentaire qui n'a pas été payée à l'avance par le client, mais qui doit être payée, ou durée au cours de laquelle il n'y a pas d'interruption de l'alimentation bien que le crédit soit épuisé

3.1.11

socle correspondant spécifié

<en relation avec un compteur à paiement agencé sous forme d'unité enfichable> comprend une embase avec des mâchoires permettant d'accepter l'unité enfichable et de s'y raccorder, des bornes de raccordement au réseau de distribution électrique et au circuit de charge du client et des éléments de fixation et de scellé sécurisés appropriés

Note 1 à l'article: Le compteur à paiement est capable de satisfaire aux exigences d'essai de type pertinentes lorsqu'il est correctement installé dans n'importe quel socle correspondant spécifié.

3.1.12

interrupteur de commande de l'alimentation

SCS

Voir IEC 62052-31:2015, 3.7.2.

3.1.13

interface d'alimentation

borne ou bornes par lesquelles le réseau de distribution électrique est raccordé au compteur à paiement ou à un socle correspondant spécifié, le cas échéant

3.1.14

crédit basé sur le temps

fonction de comptabilité de compteur à paiement qui tient compte du calcul et de la transaction d'une allocation (sociale) de crédit accordée sur une base temporelle programmée

Note 1 à l'article: Voir IEC 62055-21:2005, 13.8.3.

3.1.15

interface utilisateur

partie d'un compteur à paiement ou d'une installation de comptage à paiement permettant au client de surveiller l'installation et de l'exploiter

Note 1 à l'article: Elle peut également faciliter la lecture et l'inspection du compteur, ainsi que les activités d'entretien du compteur.

Note 2 à l'article: Si des supports de jeton physiques sont utilisés, elle comprend une interface de support de jeton.

3.2 Jetons

3.2.1

jeton

<définition relative au matériel> contenu d'information incluant une instruction fournie à un support de jeton par un fournisseur ou un système de gestion, capable d'un transfert ultérieur et d'une acceptation par un compteur à paiement spécifique ou un compteur d'un groupe de compteurs avec une sécurité appropriée

Note 1 à l'article: Dans un sens plus général, le jeton se réfère à l'instruction et à l'information transférée, tandis que le support de jeton se réfère au dispositif physique utilisé pour acheminer l'instruction et l'information ou au support de communication dans le cas d'un support de jeton virtuel.

[SOURCE: IEC 62051:1999, 17.66]

<définition relative au système> sous-ensemble d'éléments de données, contenant une instruction et une information, présentes dans l'APDU (Unité de données de protocole d'application, en anglais "Application Protocol Data Unit") de la couche application de l'*Interface POS-jeton*, et qui est également transférée au compteur à paiement au moyen d'un support de jeton

3.2.2

jeton de crédit

jeton de valeur

jeton représentant la valeur d'un crédit en valeur monétaire ou d'énergie, destiné à être transféré du point de vente au compteur à paiement

3.2.3

jeton dupliqué

jeton contenant les mêmes informations qu'un jeton qui a déjà été fourni et qui peut donc également être un jeton valable

Note 1 à l'article: Ce jeton n'est pas identique à un jeton de remplacement (se référer également à 3.4.9).

Note 2 à l'article: Un jeton dupliqué est une réédition du même jeton que celui qui a été précédemment édité et qui est identique à celui-ci dans tous ses aspects, tandis qu'un jeton de remplacement est un jeton nouvellement créé à la place d'un jeton créé précédemment, qui peut ne pas lui être identique dans tous ses aspects.

3.2.4

jeton à usages multiples

jeton (par exemple jeton d'essai) qui peut être utilisé pour plusieurs sessions réussies dans un compteur à paiement ou éventuellement avec chaque compteur d'un groupe de compteurs

Note 1 à l'article: Ces jetons sont généralement utilisés pour les besoins du relevé ou de l'entretien d'un compteur à des occasions répétées.

3.2.5

jeton sans valeur

jeton qui ne contient aucun résultat d'avantage ou de désavantage financier pour le client, qui peut contenir des données de configuration du compteur ou des instructions pour exécuter certains essais ou pour afficher certaines valeurs sur l'interface utilisateur ou pour récupérer certaines données du jeton et les renvoyer sur un support de jeton

Note 1 à l'article: Ceci est à opposer à un jeton de valeur.

3.2.6

jeton de remplacement

Voir 3.4.9.

Note 1 à l'article: Ce jeton n'est pas identique à un jeton dupliqué (voir 3.2.3).

3.2.7

jeton à usage unique

jeton (tel qu'un jeton de crédit) qui ne peut être utilisé que pour une session réussie dans un compteur à paiement

3.2.8

jeton valable

<en relation avec un compteur à paiement spécifique (ou un groupe de compteurs à paiement)>
jeton qui peut être traité avec succès par le ou les compteurs

3.2.9

jeton de valeur

Voir 3.2.2.

3.3 Supports de jeton

3.3.1

support de jeton

<définition relative au matériel> dispositifs ou supports utilisés pour transporter et présenter des informations de jeton à des compteurs à paiement, par exemple du papier imprimé, une carte magnétique, une carte/clé de mémoire électronique, une carte à microprocesseur ou des réseaux de communication de données

Note 1 à l'article: Le support de jeton peut également comporter des informations auxiliaires de commande ou de surveillance vers ou depuis le compteur à paiement, en fonction du type de système et des exigences.

<définition relative au système> support utilisé dans la couche physique de l'*Interface POS-jeton*, sur laquelle le jeton est modulé ou codé, et servant à acheminer le jeton du point où il a été généré jusqu'au compteur à paiement distant où il est reçu

3.3.2

support de jeton vierge

support de jeton physique n'ayant pas été traité au point de vente ou ailleurs et ne contenant donc aucune donnée spécifique

3.3.3

support de jeton jetable

support de jeton impossible à réutiliser une fois qu'il a été accepté ou utilisé, par exemple une carte magnétique sur papier

3.3.4

support de jeton lisible par une machine

support de jeton physique ou virtuel comportant des informations de jeton qui peuvent être lues et traitées automatiquement sur présentation à un compteur à paiement approprié sans autre opération manuelle

EXEMPLE Jeton utilisant une carte magnétique servant de support de jeton.

3.3.5

support de jeton à mémoire

support de jeton physique contenant un dispositif de mémoire non volatile dans lequel le jeton est codé électroniquement et mémorisé lorsqu'il est transporté

3.3.6

support de jeton à microprocesseur

support de jeton physique contenant un dispositif à microprocesseur avec une mémoire non volatile dans lequel le jeton est codé électroniquement et est mémorisé lorsqu'il est transporté

Note 1 à l'article: Outre les informations de jeton, le support de jeton à microprocesseur peut également contenir un programme d'application et des données associées.

3.3.7

support de jeton numérique

méthode de transfert de jeton dans laquelle les informations du jeton peuvent être représentées d'une manière sécurisée par une série de chiffres numériques (généralement 20 chiffres imprimés sur un reçu) visible et lisible par un être humain

Note 1 à l'article: Ils peuvent être saisis dans un compteur à paiement par l'intermédiaire d'une interface à clavier en vue d'une évaluation et d'une action.

3.3.8

support de jeton unidirectionnel

support de jeton physique ou virtuel utilisé pour transférer un crédit et éventuellement un tarif et des données de configuration dans une seule direction à partir du point de vente ou du système de gestion vers le compteur à paiement

3.3.9

support de jeton physique

support de jeton exigeant d'être transporté par un être humain au moins sur une partie du trajet entre le point où le jeton est chargé sur le support de jeton et le point où il est récupéré sur le support de jeton par le compteur à paiement

Note 1 à l'article: Des exemples de supports de jeton physiques sont des nombres imprimés, des cartes magnétiques, des codes-barres imprimés, un enregistrement électronique dans des dispositifs à mémoire tels que des cartes à puce ou des clés de mémoire et des messages audio dictés par un matériel interactif de réponse vocale.

3.3.10

support de jeton rechargeable

Voir 3.3.11.

3.3.11

support de jeton réutilisable

support de jeton rechargeable

support de jeton physique qui peut être utilisé dans plusieurs sessions pour le transport de jetons

3.3.12

support de jeton bidirectionnel

support de jeton physique ou virtuel utilisé pour transférer un crédit et/ou un tarif et des données de configuration depuis le point de vente ou le système de gestion jusqu'au compteur à paiement et des données de réponse du compteur à paiement retournant vers le point de vente ou un système de gestion pour traitement ultérieur, où les données de réponse peuvent probablement revenir à une transaction ultérieure du fournisseur

Note 1 à l'article: Les données de réponse peuvent contenir des informations de consommation, des informations relatives aux tentatives de falsification, des informations de comptabilité et l'état du jeton avec ou sans horodatage.

3.3.13

support de jeton virtuel

support de jeton n'exigeant pas d'être transporté par un être humain au moins sur une partie du trajet entre le point où le jeton est chargé sur le support de jeton et le point où il est récupéré sur le support de jeton par le compteur à paiement

Note 1 à l'article: Des exemples de supports de jeton virtuels sont des modems à courants porteurs en ligne (CPL), réseau téléphonique public commuté (RTC), GSM (Global System for Mobile), service GPRS (General Packet Radio Service) et radio, réseau local (LAN, Local Area Network), réseau étendu (WAN, Wide Area Network) et raccordement local direct.

3.4 Jetons et supports de jeton

3.4.1

interface de support de jeton physique

pile de protocoles d'interface complète incluant tout mécanisme d'insertion de jetons ou clavier pour un support de jeton physique, le protocole de couche physique et le protocole de couche application, plus n'importe quelle couche de protocole intermédiaire

3.4.2

acceptation de jeton

reconnaissance de la réussite du traitement de tout jeton ayant été présenté au compteur à paiement

Note 1 à l'article: Celle-ci peut impliquer généralement d'ajouter un crédit de jeton au registre de comptabilité du compteur, d'annuler du support de jeton les informations du jeton, de façon à empêcher toute acceptation ultérieure par un quelconque compteur et une indication visible à l'utilisateur sur l'interface utilisateur. Celle-ci peut également être applicable de façon similaire à n'importe quelle donnée de tarification ou de configuration incluse sur le support de jeton.

3.4.3

annulation de jeton

- a) processus consistant à effacer ou invalider des informations contenues dans un jeton valable lors de son acceptation par un compteur à paiement, pour empêcher sa réutilisation;
- b) processus consistant à effacer ou invalider des informations contenues dans un jeton après sa création, mais avant qu'il ne soit présenté à un compteur à paiement

Note 1 à l'article: Cela se produit généralement lorsque le fournisseur fait une erreur ou si un problème technique survient pendant le processus de vente.

3.4.4

mécanisme d'insertion de jetons

partie physique d'une interface de support de jeton physique acceptant et maintenant mécaniquement le support de jeton dans la bonne position pour que le processus de transfert de jeton s'effectue entre le support de jeton et le compteur à paiement

Note 1 à l'article: Des exemples sont un mécanisme d'insertion de cartes à puce, un mécanisme d'insertion de cartes magnétiques, un mécanisme d'insertion de clés USB.

3.4.5

chargement d'un support de jeton

chargement d'un jeton et de données de tarification ou de configuration sur un support de jeton en un point de vente ou un système de gestion

3.4.6

interface de support de jeton

une interface de support de jeton permet d'insérer des jetons manuellement ou automatiquement dans un compteur à paiement

Note 1 à l'article: Elle peut être constituée par exemple d'un clavier pour jetons numériques ou d'un mécanisme d'insertion de jetons physique ou d'une liaison de communication à une machine locale ou distante pour une interface de support de jeton virtuel.

Note 2 à l'article: L'interface de support de jeton peut également être utilisée pour transmettre des informations supplémentaires vers ou depuis le compteur à paiement, par exemple pour les besoins de la gestion d'un système de paiement.

3.4.7

crédit de jeton

valeur de crédit ou d'énergie à transférer du point de vente au compteur à paiement sous forme de jeton sur un support de jeton

3.4.8

rejet de jeton

celui-ci se produit lorsqu'un jeton a été présenté par un compteur à paiement, mais n'a pas été accepté ni effacé ou invalidé

Note 1 à l'article: Dans le cas où un jeton valable n'a pas été accepté, le jeton peut être présenté et accepté ultérieurement lorsque les conditions le permettent.

3.4.9

jeton de remplacement

jeton dont la valeur remplace celle d'un jeton précédemment créé

Note 1 à l'article: Les supports de jeton physiques peuvent exiger la configuration d'un support de jeton vierge pour le compteur du client.

Note 2 à l'article: Un jeton de remplacement est un jeton nouvellement créé à la place d'un jeton créé précédemment et peut ne pas être identique à celui-ci dans tous ses aspects, tandis qu'un jeton dupliqué est une réédition du même jeton que celui qui a été précédemment édité, et qui lui est identique dans tous ses aspects.

3.4.10

interface de support de jeton virtuel

pile de protocoles d'interface complète incluant le protocole de couche physique et le protocole de couche application, plus n'importe quelle couche de protocole intermédiaire

3.5 Interrupteurs du matériel de comptage

Se référer à l'IEC 62052-31:2015, 3.7.

3.6 Chronométrage et contrôle de la tarification

3.6.1

chronométrage piloté par résonateur à quartz

processus de maintien de l'heure d'un compteur à paiement au moyen d'une horloge interne pilotée par résonateur à quartz

3.6.2

commande externe de la tarification

commande du régime de tarification d'un compteur à paiement en fonction du temps ou en fonction de la consommation (coûts et/ou registres basés sur le temps ou la consommation) par un ou plusieurs signaux externes

3.6.3**commande externe de signal horaire**

commande d'une horloge temps réel interne du compteur à paiement par un signal externe

3.6.4**synchronisation externe du temps**

synchronisation d'une horloge temps réel interne du compteur à paiement par un signal externe

3.6.5**commande interne de la tarification**

commande du régime de tarification d'un compteur à paiement en fonction du temps ou en fonction de la consommation (coûts et/ou registres basés sur le temps ou la consommation) par des signaux provenant d'une horloge temps réel interne et d'un programme de commutation

3.6.6**chronométrage interne**

maintien de l'heure d'un compteur à paiement par sa propre installation d'horloge interne

3.6.7**réserve de fonctionnement**

période de temps maximale après coupure de la tension d'alimentation, pendant laquelle le compteur à paiement est capable de maintenir une heure correcte avec une précision de chronométrage assouplie spécifiée

3.6.8**temps de rétablissement de réserve**

durée exigée pour rétablir la réserve de fonctionnement complète à partir du moment où la réserve de fonctionnement a été entièrement épuisée

3.6.9**chronométrage synchrone**

processus de maintien de l'heure d'un compteur à paiement au moyen d'une horloge interne synchronisée sur un signal dérivé de la fréquence du réseau électrique

Note 1 à l'article: Les compteurs à paiement utilisant un chronométrage synchrone peuvent s'en remettre à un chronométrage piloté par résonateur à quartz en l'absence du signal de synchronisation.

3.6.10**divergence d'indication de l'heure**

différence entre l'heure affichée par le compteur à paiement et l'heure réelle ou, dans le cas d'un chronométrage synchrone, différence entre l'heure affichée par le compteur à paiement et l'heure déterminée par la fréquence du réseau électrique

Note 1 à l'article: L'heure réelle peut être obtenue au moyen d'une horloge de référence.

3.6.11**précision du chronométrage**

augmentation ou diminution de la divergence d'indication de l'heure dans un intervalle de temps spécifié

3.6.12**variation de la précision du chronométrage due à une grandeur d'influence**

différence entre la précision du chronométrage d'un compteur à paiement, lorsqu'une seule grandeur d'influence prend successivement deux valeurs spécifiées, l'une d'elles étant la valeur de référence

4 Valeurs électriques nominales

Les compteurs à paiement doivent être conformes aux valeurs données pour les domaines de tension, les courants et les fréquences normalisés, ainsi que pour les courants maximaux donnés pour des compteurs statiques à raccordement direct, tels que définis dans l'IEC 62052-11:2020, Article 4.

5 Exigences relatives à la construction

5.1 Généralités

Les exigences données dans l'IEC 62052-11:2020, Article 5, doivent s'appliquer. Si le compteur à paiement est à utiliser avec un socle correspondant spécifié, ces exigences doivent alors être satisfaites par l'ensemble complet, le compteur à paiement étant monté comme pour une utilisation normale.

5.2 Distance dans l'air et lignes de fuite

Les exigences données dans l'IEC 62052-31:2015, 6.7.2.1 et 6.7.2.3, doivent s'appliquer pour inclure les objets métalliques de même taille et de même forme que le support de jeton lorsqu'ils sont insérés dans le mécanisme d'insertion de jetons.

Pour les besoins de ces exigences, un jeton métallique doit être considéré comme représentant un circuit auxiliaire avec une tension de référence inférieure ou égale à 40 V.

5.3 Protection contre la pénétration de la poussière et de l'eau

Les exigences données dans l'IEC 62052-31:2015, Article 11, doivent s'appliquer.

Si un mécanisme d'insertion de jetons est monté sur le compteur, les essais doivent alors être effectués sans aucun support de jeton dans le mécanisme d'insertion de jetons.

Immédiatement après les essais et sans perturber le compteur, le compteur à paiement doit fonctionner correctement et un jeton valable doit être accepté à la première présentation ou aux suivantes, en allant jusqu'à un maximum de 4 tentatives.

5.4 Affichage des valeurs mesurées

5.4.1 Généralités

Les exigences données dans l'IEC 62052-11:2020, 5.6, doivent s'appliquer aux compteurs de paiement ayant un affichage.

5.4.2 Possibilité minimale de l'affichage

Pour les compteurs à paiement fonctionnant en mode de prépaiement, les informations suivantes doivent pouvoir être affichées:

- registre d'énergie cumulée en kilowattheures (consommation d'énergie);
- valeur du crédit disponible.

De plus, pour les systèmes à support de jeton virtuel, le compteur à paiement doit pouvoir afficher les détails de la dernière transaction d'achat (heure, date et valeur).

La hauteur des caractères de l'affichage pour les valeurs numériques doit être supérieure ou égale à 4,5 mm.

Si la valeur de crédit disponible est en unités monétaires, les informations supplémentaires suivantes doivent pouvoir être affichées:

- prix du kilowattheure;
- tous les paramètres de tarification basés sur le temps, par exemple les redevances d'abonnement ou le recouvrement de créances.

Dans le cas d'un compteur à tarifs multiples, les informations supplémentaires suivantes doivent également pouvoir être affichées:

- nombre de kilowattheures cumulés pour chaque tarif;
- prix du kilowattheure pour chaque tarif.

Si un compteur à paiement à tarifs multiples est piloté par une horloge temps réel interne, l'heure doit également pouvoir être affichée.

Si l'affichage d'informations considérées comme privées est exigé (par exemple le montant des créances ou des transactions), il doit être possible de limiter l'accès à l'affichage au client spécifique (en présentant par exemple un jeton ou un mot de passe spécifique au client/au compteur).

5.4.3 Voyants

Au minimum, ce qui suit doit être indiqué et visible à l'avant du compteur à paiement:

- indication du tarif de consommation en kilowattheures (chargement instantané);
- indication de l'acceptation d'un jeton (pour tous les types de jetons transportés manuellement).

De plus, pour les compteurs à paiement à support de jeton virtuel, lorsque l'interrupteur de commande de l'alimentation est ouvert, une indication ou un message approprié doit pouvoir être présenté [par exemple indiquant d'abord ARRET (OFF), puis AUTORISE (ENABLED), puis MARCHE (ON)].

Les dispositifs indicateurs électroniques doivent être équipés d'une fonction d'essai d'affichage qui allume et éteint tous les segments d'affichage afin de déterminer si la totalité des segments d'affichage fonctionne ou non.

Le dispositif indicateur peut être relié au boîtier du compteur physiquement ou à distance. Dans le deuxième cas, les données à afficher doivent être enregistrées dans le compteur électrique.

NOTE Les exigences nationales ou régionales peuvent contenir des dispositions garantissant l'accès aux données pour les clients.

5.5 Stockage des valeurs mesurées

Les exigences données dans l'IEC 62052-11:2020, 5.7, doivent s'appliquer, mais les données pour un fonctionnement correct doivent rester stockées pendant au moins 10 ans. Il convient que les données à conserver fassent l'objet d'un accord entre le fabricant et le laboratoire d'essai, et qu'elles puissent être démontrées par conception.

De plus, se référer à D.1.3 et à D.1.4 pour toute réserve de fonctionnement si une horloge temps réel est montée.

5.6 Dispositif de sortie

Les exigences données dans l'IEC 62052-11:2020, 5.8, doivent s'appliquer.

5.7 Marquage du compteur

Les exigences données dans l'IEC 62052-11:2020, Article 6, et dans l'IEC 62052-31:2015, Article 5, doivent s'appliquer.

5.8 Interface de support de jeton

5.8.1 Généralités

Si une interface de support de jeton physique est montée, elle doit satisfaire aux exigences mécaniques suivantes.

5.8.2 Mécanisme d'insertion de jetons

Si un mécanisme d'insertion de jetons est monté, la force d'insertion exigée pour insérer un support de jeton dans le mécanisme d'insertion de jetons doit être inférieure ou égale à 10 N. La force exigée pour retirer un support de jeton du mécanisme d'insertion de jetons doit être inférieure ou égale à 10 N. Le compteur doit être conçu de telle sorte que dans les circonstances normales et avec un support de jeton convenablement entretenu, le nombre minimal d'insertions pendant lesquelles un mécanisme d'insertion de jetons doit fonctionner est de 10 000.

5.8.3 Interface de clavier

Si une interface de clavier est installée, elle doit être conçue pour fonctionner pendant au moins 20 000 manœuvres de chaque clé individuelle. La force exigée pour appuyer sur le bouton de l'interface de clavier ne doit pas dépasser 10 N.

6 Conditions climatiques

6.1 Généralités

Les compteurs de paiement doivent satisfaire aux exigences relatives aux conditions d'environnement normales données dans l'IEC 62052-31:2015, 1.4, si elles sont référencées, et augmentées comme suit. Le compteur à paiement doit être monté comme en service normal, y compris dans un socle correspondant spécifié, le cas échéant.

Le cas échéant et sauf spécification contraire, les essais doivent être effectués, le compteur à paiement étant en mode de prépaiement et l'interrupteur de commande de l'alimentation étant fermé, sauf indication contraire.

Si un mécanisme d'insertion de jetons est monté, les essais doivent alors être effectués sans aucun support de jeton dans le mécanisme d'insertion de jetons pendant ces essais.

6.2 Domaine de température

6.2.1 Généralités

Pour le domaine de température, se référer à l'IEC 62052-11:2020, 8.2 (utilisation intérieure), et à l'IEC 62052-31:2015, 1.4.1.

6.2.2 Fonctionnement dans le domaine de fonctionnement spécifié

Il s'agit du domaine des températures ambiantes (c'est-à-dire de -10 °C à 45 °C) faisant partie des conditions de fonctionnement assignées du compteur à paiement pour les besoins métrologiques et fonctionnels, les limites de variation de l'erreur du compteur avec la température ambiante étant spécifiées en ce qui concerne les limites maximales pour le coefficient moyen de température. Dans ce domaine de température, le fonctionnement de tous les circuits d'alimentation, de l'affichage et de tous les boutons-poussoirs, du processus de comptabilité du compteur et de tous les registres et paramètres associés, de l'interrupteur de commande de l'alimentation et de l'interrupteur ou des interrupteurs de commande de charge, de l'interface à jetons et/ou de toute interface de communication locale ou distante, ainsi que de toute disposition à tarifs multiples et de tous les circuits auxiliaires d'entrée et de sortie, doit être correct, un jeton valable doit être accepté et un jeton non valable doit être rejeté ou ignoré sans détérioration ou annulation.

Si une horloge temps réel interne est équipée d'une commande interne de tarification ou du déblocage de crédit basé sur le temps, il doit être fait référence à l'Annexe D.

Dans ce domaine de température et lorsqu'aucune tension d'alimentation n'est appliquée au compteur à paiement, l'état de tous les registres, les valeurs et les paramètres associés au processus de comptabilité du compteur doivent toujours être valables et exempts de corruption et il ne doit y avoir aucune modification des caractéristiques métrologiques et fonctionnelles du compteur lorsque la tension d'alimentation est rétablie par la suite.

6.2.3 Fonctionnement dans le domaine de fonctionnement limite

- a) En dehors du domaine de température spécifié, mais dans le domaine de fonctionnement limite (c'est-à-dire entre -25 °C et -10 °C et entre $+45\text{ °C}$ et $+55\text{ °C}$) et lorsque la tension d'alimentation appliquée au compteur à paiement se trouve dans le domaine de fonctionnement étendu (voir 7.2.1 et 7.2.1.3), les exigences opérationnelles suivantes doivent s'appliquer:

L'état de tous les registres, valeurs et paramètres associés au processus de comptabilité du compteur doit continuer à être valable et exempt de corruption. Si une horloge temps réel interne est équipée d'une commande interne de tarification ou du déblocage de crédit basé sur le temps, il doit être fait référence à l'Annexe D. Aucune divergence entre le ou les registres de kilowattheures cumulés et la valeur de crédit disponible ne doit apparaître à la suite de quelconques excursions de la température ambiante en dehors du domaine de fonctionnement spécifié.

Il n'est pas nécessaire qu'un jeton valable soit accepté lorsqu'il est présenté, mais les informations présentes sur le support de jeton ne doivent alors pas être modifiées ou invalidées. Toutefois, lorsqu'un jeton valable est accepté, la valeur du crédit doit être correctement transférée au compteur et les informations relatives au crédit du jeton lui-même doivent avoir été invalidées. Un jeton non valable ne doit pas être accepté, modifié ou détérioré lorsqu'il est présenté au compteur.

Il n'est pas nécessaire que l'affichage fonctionne, il est aussi admis qu'il fonctionne de manière erratique. L'état de l'interrupteur de commande de l'alimentation ne doit pas être modifié sans que des conditions appropriées prédominantes dans le processus de comptabilité du compteur, et aucun rétablissement admissible par ailleurs dans l'état "marche" ne doit se produire sans intervention manuelle supplémentaire.

Le fonctionnement correct de tous les aspects du compteur à paiement doit reprendre lorsque la température ambiante est revenue dans le domaine de fonctionnement spécifié.

- b) En dehors du domaine de température spécifié, mais dans le domaine de fonctionnement limite et lorsqu'aucune tension d'alimentation n'est appliquée au compteur à paiement, l'état de tous les registres, les valeurs et les paramètres associés au processus de comptabilité du compteur doivent toujours être valables et exempts de corruption, et il ne doit y avoir aucune modification des caractéristiques métrologiques et fonctionnelles du compteur lorsque la tension d'alimentation est ensuite rétablie. Si une horloge temps réel interne est équipée d'une commande interne de tarification ou du déblocage de crédit basé sur le temps, il doit être fait référence à l'Annexe D. Le bon fonctionnement de tous les aspects du compteur à paiement doit reprendre lorsque la tension d'alimentation est revenue dans le domaine de fonctionnement étendu. Toutefois, si le compteur est équipé d'une horloge temps réel pour les besoins de la tarification et si cette condition d'interruption de la tension d'alimentation persiste pendant une durée supérieure à la réserve de fonctionnement, il est alors admis qu'une remise à l'heure peut être nécessaire.

6.2.4 Stockage et transport en dehors du domaine de fonctionnement limite

En dehors du domaine de fonctionnement limite, mais dans le domaine de stockage et de transport limite (c'est-à-dire de +55 °C à +70 °C) et sans aucune tension d'alimentation appliquée au compteur à paiement, les exigences de fonctionnement suivantes doivent s'appliquer.

L'état de tous les registres, valeurs et paramètres associés au processus de comptabilité du compteur doit continuer à être valable et exempt de corruption, et aucune détérioration ou dégradation résultante des caractéristiques métrologiques et fonctionnelles du compteur ne doit se produire. Dans ces conditions, le fonctionnement et la précision de chronométrage de toute fonction de chronométrage avec une réserve de fonctionnement incorporée dans le compteur à paiement ne sont pas spécifiés. Lorsque la température ambiante du compteur à paiement est revenue dans le domaine de fonctionnement spécifié et s'est stabilisée et après que la tension d'alimentation a été raccordée, puis que la mise en service (ce qui inclut la réinitialisation de toute fonction de chronométrage) est terminée, le compteur doit fonctionner normalement.

6.3 Humidité relative

Les exigences données dans l'IEC 62052-11:2020, 8.2, doivent s'appliquer (utilisation intérieure).

6.4 Protection contre la pénétration de la poussière et de l'eau

Les exigences données dans l'IEC 62052-31:2015, Article 11 (compteurs intérieurs), doivent s'appliquer.

6.5 Essais de l'effet des environnements climatiques

Les exigences données dans l'IEC 62052-11:2020, 8.3, doivent s'appliquer.

7 Exigences électriques

7.1 Exigences générales

Les compteurs à paiement doivent satisfaire aux exigences électriques pertinentes données dans l'IEC 62052-11:2020 et l'IEC 62053-21:2020 et aux exigences de sécurité données dans l'IEC 62052-31:2015, telles que référencées et complétées dans le présent document. Le compteur à paiement doit être monté comme en service normal, y compris dans un socle correspondant spécifié, le cas échéant.

Dans le cas d'un essai destiné à une installation de comptage à paiement à dispositifs multiples, l'ensemble de l'essai doit satisfaire aux exigences du présent document. Les dispositifs qui constituent le compteur à dispositifs multiples doivent être raccordés selon la méthode de raccordement préconisée par le fabricant. La longueur du branchement entre les dispositifs doit être conforme à la longueur minimale spécifiée par le fabricant.

Le cas échéant et sauf spécification contraire, les essais doivent être effectués, le compteur à paiement se trouvant en mode de prépaiement.

L'interrupteur de commande de l'alimentation doit être en position fermée pour chacun de ces essais, sauf spécification contraire.

Si un mécanisme d'insertion de jetons est monté sur le compteur à paiement, les essais doivent alors être effectués sans aucun support de jeton dans le mécanisme d'insertion de jetons, sauf spécification contraire.

Si ces exigences permettent une dégradation temporaire des performances ou une perte de fonctionnalité pendant les essais pendant une période maximale de 15 s après la fin des essais, le compteur à paiement doit ensuite fonctionner correctement conformément aux exigences pertinentes sans aucune intervention externe. Aucune modification de l'état de fonctionnement réel ou des données enregistrées n'est admise. Se référer à 9.2 pour ce qui concerne les contrôles au début et à la fin des essais. Si une horloge temps réel interne est montée pour le contrôle interne de la tarification ou du déblocage de crédit basé sur le temps, une référence à l'Annexe D est également à faire.

7.2 Influence de la tension d'alimentation

7.2.1 Domaine ou domaines de tension

7.2.1.1 Généralités

Les compteurs à paiement doivent satisfaire aux exigences suivantes. Voir Tableau 1.

Tableau 1 – Domaines de tension

Domaine de fonctionnement spécifié (voir 7.2.1.2)	De 0,9 à 1,1 U_n
Domaine de fonctionnement étendu (voir 7.2.1.3)	De 0,8 à 1,15 U_n
Domaine de fonctionnement limite (voir 7.2.1.4)	De 0,0 à 0,8 U_n
Domaine de tenue (voir 7.2.3)	De 0,0 à 1,9 U_n

En ce qui concerne la vérification du domaine de tension, se référer également aux Articles 8 et 9.

7.2.1.2 Domaine de fonctionnement spécifié

Il s'agit du domaine de tension d'alimentation faisant partie des conditions de fonctionnement assignées du compteur à paiement pour les besoins métrologiques, avec des limites de variation spécifiées en pourcentage d'erreur par rapport à la tension d'alimentation.

7.2.1.3 Domaine de fonctionnement étendu

Il s'agit du domaine de tension d'alimentation dans lequel le compteur à paiement doit fonctionner correctement. Dans ce domaine, le fonctionnement des circuits d'alimentation, l'affichage et les boutons-poussoirs, le processus de comptabilité du compteur et les registres associés, les valeurs, les paramètres et le chronométrage, l'interrupteur ou les interrupteurs de commande de l'alimentation, l'interface à jetons et/ou toute interface de communication locale ou distante, ainsi que toute disposition à tarifs multiples et tous les circuits auxiliaires d'entrée et de sortie, doivent tous être corrects, un jeton valable doit être accepté et un jeton non valable doit être rejeté sans détérioration ou annulation. En dehors du domaine de fonctionnement spécifié de tension d'alimentation, mais dans le domaine de fonctionnement étendu, les limites de variation du pourcentage d'erreur du compteur sont trois fois plus grandes que les valeurs applicables dans le domaine de fonctionnement spécifié.

7.2.1.4 Domaine de fonctionnement limite

En dehors du domaine de fonctionnement étendu de tension d'alimentation, mais dans le domaine de fonctionnement limite (c'est-à-dire de 0,0 à 0,8 U_n) et lorsque la température ambiante appartient au domaine de fonctionnement spécifié, les exigences de fonctionnement suivantes doivent s'appliquer.

L'état de tous les registres, valeurs et paramètres associés au processus de comptabilité du compteur doit continuer à être valable et exempt de corruption. Toutes les fonctions de chronométrage interne doivent continuer à maintenir le chronométrage jusqu'à ce que la période de support applicable à toute réserve de fonctionnement se soit écoulée. L'erreur du compteur peut varier entre +10 % et –100 % et aucune divergence entre le ou les registres de kilowattheures cumulés et la valeur de crédit disponible ne doit apparaître à la suite de toute excursion de la tension d'alimentation en dehors du domaine de fonctionnement étendu.

Il n'est pas nécessaire qu'un jeton valable soit accepté lorsqu'il est présenté, mais les informations présentes sur le support de jeton ne doivent alors pas être modifiées ou invalidées. Toutefois, lorsqu'un jeton valable est accepté, la valeur du crédit doit être correctement transférée au compteur et les informations relatives au crédit du jeton lui-même doivent avoir été invalidées. Un jeton non valable ne doit pas être accepté, modifié ou détérioré lorsqu'il est présenté au compteur.

Il n'est pas nécessaire que l'affichage fonctionne, il est aussi admis qu'il fonctionne de manière erratique. L'état de l'interrupteur de commande de l'alimentation ne doit pas être modifié sans que des conditions appropriées prédominantes dans le processus de comptabilité du compteur, et aucun rétablissement admissible par ailleurs dans l'état "marche" ne doit se produire sans intervention manuelle supplémentaire.

Le bon fonctionnement de tous les aspects du compteur à paiement doit reprendre lorsque la tension d'alimentation est revenue dans le domaine de fonctionnement étendu. Toutefois, si le compteur est équipé d'une horloge temps réel pour les besoins de la tarification et que la tension d'alimentation est inférieure à 0,8 U_n pendant une durée plus grande que la réserve de fonctionnement, il est alors admis qu'il peut être nécessaire d'effectuer une remise à l'heure.

Si les exigences de fonctionnement d'un compteur, qui ouvre spécifiquement l'interrupteur de commande de l'alimentation lorsque l'état de la tension d'alimentation est bas ou haut, font l'objet d'un accord entre l'acheteur et le fournisseur du compteur à paiement, il doit être possible d'inhiber cette fonction lors de l'évaluation de la conformité à cet article, sans modifier aucun progiciel correspondant.

7.2.2 Creux de tension et interruptions brèves

Les exigences données dans l'IEC 62052-11:2020, 9.3.2, doivent s'appliquer. Si le compteur à paiement est équipé d'un mécanisme d'insertion de jetons et que le support de jeton peut être retenu dans le compteur, ces essais doivent alors être effectués avec et sans support de jeton de client inséré dans le compteur pendant les essais. Si le support de jeton ne peut pas être retenu de la sorte, ces essais doivent être effectués sans aucun support de jeton dans le mécanisme d'insertion de jetons pendant l'essai. Aucun jeton ne doit être présenté au compteur en vue d'une action pendant ces essais.

Les creux et interruptions brèves de tension ne doivent produire aucune perte ou corruption des données dans le compteur à paiement, qu'un support de jeton soit inséré dans le compteur ou non. Les données présentes sur le support de jeton ne doivent pas être corrompues lorsque ce dernier est inséré et retenu dans le compteur pendant la durée de ces essais.

Après les essais, un jeton de crédit valable doit être présenté. Le jeton et le compteur à paiement doivent ensuite fonctionner correctement, ce qui inclut l'ouverture et la fermeture de l'interrupteur de commande de l'alimentation.

L'essai doit être effectué d'abord l'interrupteur de commande de l'alimentation étant fermé; celui-ci doit être en position fermée ou la reprendre à la fin de l'essai. L'essai doit être répété avec l'interrupteur ouvert et il doit le rester pendant tout l'essai.

NOTE Se référer également à A.1.2.7 pour ce qui concerne les effets d'une panne d'alimentation et à l'Annexe D pour ce qui concerne les autres influences sur le chronométrage de toute fonction de chronométrage interne.

7.2.3 Conditions de tension anormales

Pour les types monophasés, le compteur à paiement doit supporter, sans danger affectant la sécurité, la tension de tenue maximale ($1,9 U_n$) appliquée entre les bornes de tension de ligne et de neutre. La tension de tenue maximale doit être appliquée pendant une période de 4 h avec un courant égal à 50 % de I_{max} et un facteur de puissance unitaire (dans le cas des compteurs à deux fils monophasés à deux éléments, 50 % de I_{max} simultanément dans chaque élément de mesure). Cette exigence doit également s'appliquer aux compteurs à paiement monophasés à trois fils, la tension de tenue maximale doit être d'abord appliquée pour effectuer l'essai de la tension et du courant de la première ligne, puis répétée pour effectuer l'essai de la tension et du courant de la seconde ligne, dans chaque cas sans appliquer aucune tension d'alimentation à la borne de ligne inutilisée. Aucun courant de charge ne circule par la borne de neutre dans n'importe laquelle de ces configurations d'essais.

Pour les types polyphasés à quatre fils triphasés, le compteur à paiement doit supporter, sans danger affectant la sécurité, la tension de tenue maximale ($1,9 U_n$) appliquée à deux phases quelconques et au neutre avec un angle de phase de 60° entre les tensions des deux phases. La tension de tenue maximale doit être appliquée pendant une période de 4 h avec un courant égal à 50 % de I_{max} et un facteur de puissance unitaire dans chacune des deux phases soumises à l'essai. Trois passages au total sont exigés pour traiter les paires de phases, une période de refroidissement de 1 h étant observée entre deux passages. L'exigence de tenue de tension d'alimentation ne s'applique pas aux compteurs à paiement à raccordement direct triphasés à trois fils.

Pour tous les types polyphasés, le compteur à paiement doit continuer de fonctionner avec n'importe quelle combinaison d'une ou de plusieurs phases raccordées et fournissant de l'énergie lorsque la tension d'alimentation se trouve dans le domaine de fonctionnement étendu. Dans le cas d'un réseau triphasé à trois fils (si le compteur est conçu pour ce service), cette exigence doit être satisfaite lorsque deux des trois phases restent raccordées. Toute fonction de chronométrage interne doit continuer à maintenir le chronométrage dans ces conditions, sans devoir utiliser une réserve de fonctionnement prévue.

7.3 Echauffement

Dans les conditions de fonctionnement assignées, les circuits électriques et l'isolation ne doivent pas atteindre une température susceptible d'altérer le fonctionnement du compteur.

Les exigences données dans l'IEC 62052-31:2015, Article 10, doivent s'appliquer.

7.4 Isolation

Les exigences données dans l'IEC 62052-31:2015, 6.7, 6.8 et 6.10, doivent s'appliquer. Les contacts de l'interrupteur d'alimentation doivent être en position fermée pour ces essais.

Le compteur et ses dispositifs auxiliaires incorporés y compris tous les supports de jeton qui peuvent être insérés dans le mécanisme d'insertion de jetons doivent être conçus de façon qu'ils conservent des qualités diélectriques adéquates dans les conditions normales d'utilisation.

Si un mécanisme d'insertion de jetons est monté, l'IEC 62052-31:2015, 4.3.2.10, doit s'appliquer.

Après ces essais et lorsque les conditions de référence du compteur à paiement ont été rétablies, le compteur à paiement doit fonctionner correctement.

7.5 Tenue de surtension à long terme

Les exigences données dans l'IEC 62052-31:2015, 6.10.3.2, doivent s'appliquer.

7.6 Compatibilité électromagnétique (CEM)

7.6.1 Généralités

Les exigences données dans l'IEC 62052-11:2020, Article 9, doivent s'appliquer sous réserve des clarifications et des augmentations suivantes:

7.6.2 Conditions générales des essais

Les exigences données dans l'IEC 62052-11:2020, 9.1 doivent s'appliquer avec les suivantes:

Toute facturation basée sur le temps doit être remise à zéro pendant la durée de ces essais. Le crédit initial disponible et tous les paramètres du compteur à paiement doivent être tels que l'interrupteur de commande de l'alimentation n'est pas supposé fonctionner pendant ces essais. L'interrupteur de commande de l'alimentation ne doit pas fonctionner pendant ces essais, mais pour les autres fonctions, sauf indication contraire, une dégradation temporaire ou une perte de fonction ou de performance est acceptable.

Aucun jeton ne doit être présenté au compteur pendant ces essais. Si le compteur à paiement est équipé d'un mécanisme d'insertion de jetons et que le support de jeton peut être retenu dans le compteur, ces essais doivent être effectués avec et sans support de jeton de client inséré dans le compteur pendant l'essai.

Immédiatement après la fin de chacun des essais d'immunité, un jeton de crédit valable doit être présenté. Le jeton et le compteur à paiement doivent ensuite fonctionner correctement, ce qui inclut l'ouverture et la fermeture de l'interrupteur de commande de l'alimentation. Toute fonction de chronométrage interne doit continuer à fonctionner pendant et après ces essais et D.5.1 peut également être applicable.

7.6.3 Essai d'immunité aux décharges électrostatiques

Les exigences données dans l'IEC 62052-11:2020, 9.3.3, doivent s'appliquer avec les suivantes: l'essai doit être effectué d'abord avec l'interrupteur de commande de l'alimentation fermé, puis répété avec l'interrupteur de commande de l'alimentation ouvert; celui-ci ne doit pas être actionné pendant les essais. Si le compteur à paiement est équipé d'une interface de jeton, les essais doivent inclure les décharges dans l'air vers le clavier ou vers un jeton de client inséré dans le mécanisme d'insertion de jetons si ce support de jeton peut être retenu dans le compteur.

Après l'essai de décharges électrostatiques, le compteur à paiement doit retrouver un fonctionnement et une performance normaux en moins de 1 min, sans aucune intervention externe.

7.6.4 Tenue aux champs électromagnétiques RF (radiofréquences) rayonnés

Les exigences données dans l'IEC 62052-11:2020, 9.3.4 et 9.3.5, doivent s'appliquer avec les éléments suivants:

Les essais spécifiés dans l'IEC 62052-11:2020, 9.3.4, doivent être effectués, l'interrupteur de commande de l'alimentation étant ouvert.

Les essais spécifiés dans l'IEC 62052-11:2020, 9.3.5, doivent être effectués, l'interrupteur de commande de l'alimentation étant fermé.

Après l'essai de CEM, le compteur à paiement doit retrouver un fonctionnement et une performance normaux en moins de 1 min sans aucune intervention externe.

7.6.5 Essai d'immunité aux transitoires électriques rapides

Les exigences données dans l'IEC 62052-11:2020, 9.3.6, doivent s'appliquer avec les éléments suivants:

L'essai doit d'abord être réalisé avec la charge d'essai et les limites de variation du pourcentage d'erreur, comme indiqué dans l'IEC 62053-21:2020, 7.10 et le Tableau 4.

L'essai doit être répété avec l'interrupteur de commande de l'alimentation ouvert, et donc sans courant d'essai, les câbles de charge étant toujours raccordés. Aucune modification de l'état de fonctionnement réel ou des données enregistrées n'est admise. Le compteur doit continuer à fonctionner correctement après l'essai sans aucune intervention externe.

7.6.6 Essai d'immunité aux perturbations conduites, induites par les champs RF

Les exigences données dans l'IEC 62052-11:2020, 9.3.7, doivent s'appliquer avec les suivantes:

L'essai doit d'abord être réalisé pour la charge d'essai et les limites de variation du pourcentage d'erreur, comme indiqué dans l'IEC 62053-21:2020, 7.10 et le Tableau 4. L'essai doit être effectué l'interrupteur de commande de l'alimentation étant fermé et le courant d'essai circulant. Pendant l'essai, le comportement normal du compteur à paiement ne doit pas être perturbé.

L'essai doit être répété avec l'interrupteur de commande de l'alimentation ouvert, et donc sans courant d'essai, les câbles de charge étant toujours raccordés. Aucune modification de l'état de fonctionnement réel ou des données enregistrées n'est admise. Le compteur doit continuer à fonctionner correctement après l'essai sans aucune intervention externe.

7.6.7 Essai d'immunité aux ondes de choc

Les exigences données dans l'IEC 62052-11:2020, 9.3.9, doivent s'appliquer avec les éléments suivants:

L'essai doit d'abord être effectué avec l'interrupteur de commande de l'alimentation fermé.

L'essai doit ensuite être répété avec l'interrupteur de commande de l'alimentation ouvert.

Après l'essai de CEM, le compteur à paiement doit retrouver un fonctionnement et une performance normaux en moins de 1 min sans aucune intervention externe.

7.6.8 Essai d'immunité aux ondes à oscillations amorties

Les exigences données dans l'IEC 62052-11:2020, 9.3.11, ne sont pas applicables aux compteurs à paiement à raccordement direct.

7.6.9 Suppression des perturbations radioélectriques

Les exigences données dans l'IEC 62052-11:2020, 9.3.14, doivent s'appliquer.

7.7 Puissance absorbée

7.7.1 Généralités

La mesure de la puissance absorbée dans les circuits de tension et de courant doit être déterminée comme indiqué dans l'IEC 62052-11:2020, 4.4.

7.7.2 Circuits de tension

Les puissances absorbées active et apparente sont données dans l'IEC 62052-11:2020, 4.4. Des augmentations de consommation de courte durée dues à la lecture/écriture d'un jeton ou à l'actionnement d'un interrupteur sont autorisées. Si le compteur est équipé d'un mécanisme d'insertion de jetons et si le support de jeton peut être retenu dans le compteur à paiement, ces exigences de puissance absorbée doivent également être satisfaites avec un support de jeton normal retenu dans le compteur au repos.

7.7.3 Circuits de courant

La puissance apparente consommée par chaque circuit de courant d'un compteur à paiement à raccordement direct au courant maximal, à la fréquence de référence et à la température de référence, ne doit pas dépasser une valeur en VA équivalente à 0,08 % de U_n en volts multipliée par 100 % de I_{max} en ampères (par exemple 230 V et 60 A donnent 11,0 VA, 230 V et 100 A donnent 18,4 VA).

Ces valeurs comportent la prise en compte de l'interrupteur de commande de l'alimentation.

7.8 Influence de l'échauffement propre sur la précision

Les exigences données dans l'IEC 62053-21:2020, 7.10 et Tableau 4, doivent s'appliquer.

7.9 Essais électriques sur les interrupteurs de commande de l'alimentation et de commande de charge (SCS et LCS)

Les exigences données dans l'IEC 62052-31:2015, 6.10.6, doivent s'appliquer à tous les interrupteurs de commande de l'alimentation.

Les exigences données dans l'IEC 62052-31:2015, 6.10.7, doivent s'appliquer à tous les interrupteurs de commande de charge.

7.10 Interrupteurs de commande auxiliaires (ACS, Auxiliary Control Switches)

S'ils sont montés, les commutateurs de sortie auxiliaires fournissant des signaux de commande à du matériel externe doivent être conformes aux exigences suivantes:

- tension assignée: U_n ;
- courant assigné: 2 A.

Nombre d'opérations: les interrupteurs de sortie doivent être assignés à U_n , 2 A, facteur de puissance unitaire pour 10 000 opérations consécutives d'établissement et de rupture, ainsi que U_n , 1 A, facteur de puissance de 0,4 inductif pour 10 000 opérations consécutives d'établissement et de rupture, de sorte qu'un total de 20 000 opérations d'établissement et de rupture est exigé pour un spécimen à interrupteur unique. Ceci n'est qu'une exigence de conception, et aucun essai n'est exigé en tant que partie du plan d'essai type pour un compteur à paiement.

7.11 Essai de l'interface du mécanisme d'insertion de jetons

Si le compteur à paiement est équipé d'un mécanisme d'insertion de jetons, le compteur et le mécanisme d'insertion de jetons ne doivent subir aucune détérioration électrique, et toutes les fonctions de comptage à paiement doivent continuer à s'effectuer normalement lorsqu'un support de jeton métallique est inséré dans l'ouverture à jeton de telle manière qu'il court-circuite tous les contacts du support de jeton. Pour les besoins des essais, le compteur doit fonctionner à U_n , courant nul et interrupteur de commande de l'alimentation fermé, lorsque le support de jeton métallique est inséré.

8 Exigences de précision

Les exigences mentionnées dans l'IEC 62052-11:2020, Article 7, doivent s'appliquer, tous les paragraphes compris, sans insertion de support de jeton dans un quelconque mécanisme d'insertion de jetons monté sur le compteur à paiement. Se référer à 9.2 pour ce qui concerne les contrôles au début et à la fin des essais.

Si un mécanisme d'insertion de jetons est monté et qu'un support de jeton peut être retenu dans le compteur à paiement, des essais de précision supplémentaires doivent être effectués dans les conditions de référence à U_n et un facteur de puissance unitaire, avec des charges équilibrées, et à la fois à $0,05 I_n$ et I_{max} .

Les limites de variation de pourcentage d'erreur comparées au même point de charge, et sans qu'un support de jeton ne soit présent dans le mécanisme d'insertion de jetons, doivent alors être de 0,2 pour les compteurs de classe 0,5, de 0,3 pour les compteurs de classe 1 et de 0,5 pour les compteurs de classe 2.

Le compteur à paiement doit être monté comme en service normal, y compris dans un socle correspondant spécifié, le cas échéant.

La réponse du compteur à paiement à une circulation d'énergie en sens inverse doit faire l'objet d'un accord entre le fabricant et l'acheteur.

9 Exigences fonctionnelles

9.1 Généralités

Les exigences générales concernant l'utilisation de la fonctionnalité du compteur à paiement dans les domaines de température et les domaines de tension sont données en 6.2 et en 7.2.1.

Lors de l'essai des compteurs à paiement selon les Articles 6, 7 et 8, un enregistrement de tous les relevés pertinents et de l'état doit être effectué avant et après chaque essai ou série d'essais. Les relevés au début et à la fin doivent ensuite être réconciliés avec le mode opératoire d'essai et la durée pour confirmer l'intégrité du processus de comptabilité du compteur. Le paragraphe 9.2 donne davantage de détails concernant ces exigences.

NOTE Voir Annexe A informative pour connaître les exigences fonctionnelles générales, les essais et les lignes directrices d'essais relatifs aux compteurs de paiement, qui peuvent, par exemple, être pris en compte et appliqués lors de l'acceptation des exigences d'évaluation globale et d'essais du système entre le fabricant et l'acheteur. L'Article A.1 indique les exigences fonctionnelles de base et les essais pour le mode de fonctionnement en prépaiement. Pour des caractéristiques et options supplémentaires et d'autres modes de paiement, la spécification des exigences et de l'essai est plus variée et une vue d'ensemble des approches qui peuvent être adoptées est ainsi donnée dans les Articles A.2 et A.3. Une évolution ultérieure des exigences fonctionnelles et des dispositions d'essai de l'Annexe A est prévue, elles ne sont donc pas à évaluer pendant les essais de type du compteur à paiement.

9.2 Robustesse du processus de comptabilité du compteur

Bien que des limites d'erreur acceptables soient définies pour la précision de la mesure de l'énergie dans des conditions nominales et son influence pour les compteurs électriques, il n'existe pas d'erreur équivalente acceptable dans le calcul du crédit disponible sur les compteurs à paiement. De plus, les paramètres et les modes de fonctionnement courants du compteur ne doivent pas changer spontanément à la suite d'un essai.

Lorsque l'essai d'un compteur à paiement est effectué selon les Articles 6, 7 et 8, chaque relevé, paramètre, état et mode actif doit donc être consigné avant chaque essai ou série d'essais, notamment:

- les relevés de tous les registres d'énergie;
- les relevés de tous les paramètres de tarification d'énergie (si un crédit monétaire est utilisé);
- les relevés de toutes les valeurs de crédits et de créances;
- les modes qui sont actifs;

et si le compteur comporte une fonction de chronométrage:

- les relevés de tous les paramètres de tarification ou de crédits basés sur le temps (le cas échéant);
- l'heure/la date du compteur;
- le décalage de l'heure du compteur par rapport à l'heure de l'horloge de référence.

Pendant chaque essai, la valeur du crédit de chaque jeton chargé dans le compteur doit être enregistrée.

A la fin de chaque essai ou série d'essais, ces relevés doivent être de nouveau enregistrés. D'autres enregistrements peuvent également être effectués lors de la modification de tout paramètre au cours des essais.

Sauf mention spécifique, un essai ou une série d'essais n'est réussi que si les conditions suivantes sont également satisfaites:

- la mesure d'énergie se trouve dans les limites d'erreur spécifiées pour cet essai;
 - la précision de chronométrage du compteur se trouve dans les limites acceptables pour le mode de chronométrage et la nature de l'essai;
 - aucune modification du paramètre de tarification d'énergie;
 - aucune modification de paramètres de coûts ou crédits basés sur le temps;
 - toute variation des valeurs de crédit et de créances est comptabilisée exactement par:
 - l'énergie mesurée par le compteur pendant l'essai $\times$ la valeur du paramètre de tarification d'énergie active;
- et:
- la durée du temps enregistrée par le compteur $\times$ la valeur du paramètre de tarification ou de crédits basé sur le temps actif;
- et:
- la valeur de tout crédit de jeton accepté par le compteur pendant l'essai;

NOTE 1 la vérification de cette valeur exige la possibilité de vérifier la valeur du crédit valable sur un support de jeton avant et après présentation au compteur;

- aucun mode actif dans le compteur n'a été modifié;
- l'affichage du compteur fonctionne correctement;
- tous les boutons-poussoirs du compteur fonctionnent correctement;
- l'acceptation d'un jeton valable se produit à la première ou à la seconde présentation. Ceci ne doit pas être vérifié avant d'avoir confirmé la satisfaction aux critères énoncés ci-dessus;
- l'interrupteur de commande de l'alimentation fonctionne correctement.

Sauf mention spécifiquement contraire, au plus un paramètre de tarification d'énergie et au plus un paramètre de tarification ou de crédits basés sur le temps doivent être actifs pendant la durée de n'importe quel essai.

NOTE 2 Il est acceptable que deux paramètres de tarification basés sur le temps ou plus (par exemple la collecte de redevances d'abonnement et de créances) soient actifs pendant un essai, à condition que leur valeur combinée reste constante pendant tout l'essai.

Si, pour certains essais il est exigé que le tarif par kilowattheure pour le tarif actif soit mis à zéro, alors le tarif par kilowattheure pour les tarifs non actifs doit être mis à des valeurs non nulles.

Si le compteur fonctionne dans son domaine de fonctionnement limite, mais en dehors de son domaine de fonctionnement étendu, un jeton de crédit valable présenté au compteur doit, soit être accepté correctement, soit être rejeté ou ignoré sans modification de ses informations.

10 Essai de type

Voir l'IEC 62052-11:2020, Article 10, ainsi que son Annexe P.

Si des exigences d'essai supplémentaires ou modifiées sont spécifiées dans le présent document, elles peuvent être effectuées pendant les parties correspondantes de la série d'essais recommandée. Les essais et les contrôles supplémentaires de 9.1 et de 9.2 peuvent être réalisés dans le cadre des essais du second groupe du programme d'essais. Une série distincte d'essais et de spécimens est exigée si l'IEC 62052-31:2015, 6.10.6, s'applique.

Il est nécessaire d'établir un plan d'essais détaillé pour le type spécifique de compteur à paiement à soumettre à essai. Il convient que le plan d'essais tienne compte des lignes directrices suivantes:

- plusieurs spécimens identiques du compteur sont vraisemblablement exigés, le nombre réel dépendant des interfaces de la fonctionnalité du compteur à paiement spécifique, des dispositions d'essais et des contraintes de temps disponibles et de l'étendue de tout autre essai de type spécifique qui peut également être applicable selon l'Annexe C ou l'Annexe D;
- il convient de clarifier au début du rapport d'essai le domaine d'application de l'essai de type effectué (incluant ou excluant l'Annexe C ou l'Annexe D). Il convient que cette clarification comporte la nature de tous les accords spécifiques entre fabricant et acheteur, par exemple concernant les exigences de chronométrage.

NOTE 1 Pour certains essais, il peut se révéler approprié d'effectuer l'essai de deux spécimens en parallèle, le premier pour vérifier la cohérence de la comptabilité et l'autre pour vérifier le fonctionnement de l'interrupteur de commande de l'alimentation (par exemple pour l'essai des exigences climatiques).

NOTE 2 Si un spécimen est soumis à l'un des essais de 7.8 et de ses paragraphes, les exigences d'adaptation de D.5.1 peuvent également être applicables.

IECNORM.COM : Click to view the full PDF of IEC 62055-31:2022

Annexe A (informative)

Performance fonctionnelle

A.1 Fonctionnalités de base – mode de prépaiement

A.1.1 Généralités

La présente annexe couvre certaines fonctionnalités, essais et lignes directrices d'essais pour les compteurs à paiement, qui peuvent par exemple être pris en compte et appliqués après accord concernant n'importe quelle évaluation globale et exigence d'essai du système entre le fabricant et l'acheteur. Les fonctionnalités de base sont ici données pour le mode de fonctionnement par prépaiement et sont distinctes des exigences normatives indiquées dans le corps du texte du présent document. Pour des caractéristiques et options supplémentaires et d'autres modes de paiement, la spécification des exigences et de l'essai est plus variée et une vue d'ensemble des approches qui peuvent être adoptées est donnée à l'Article A.2 et à l'Article A.3.

Les fonctionnalités de base sont traitées en A.1.2 et leur essai comporte la série d'opérations et de contrôles de A.1.3 couvrant la fonctionnalité de base du compteur à paiement. Le comportement du compteur dépend à la fois du matériel et des logiciels, ainsi que des facteurs d'influence. La série d'essais est donc répétée pour des combinaisons des facteurs d'influence principaux que sont la tension d'alimentation et la température ambiante. D'autres fonctionnalités de base sont soumises à essai dans des conditions de référence, sauf indication contraire, ou sont des considérations de conception.

Il convient que le compteur à paiement soit monté comme en service normal, y compris dans un socle correspondant spécifié, le cas échéant. Il convient d'effectuer une vérification dans les conditions de référence sauf indication contraire.

Si une "charge maximale du compteur" est indiquée, il convient de la considérer comme équilibrée à U_n , $I_{\max}$ et un facteur de puissance unitaire. Si une "charge minimale du compteur" est indiquée, il convient de la considérer comme équilibrée à U_n , $0,05 I_n$ et un facteur de puissance unitaire.

A.1.2 Mode de prépaiement – fonctionnalités de base

A.1.2.1 Acceptation de jeton

Il convient que le compteur à paiement traite les jetons valables et non valables conformément aux exigences suivantes:

Il convient que l'acceptation d'un jeton valable produise toujours la valeur de crédit exacte sur le support de jeton transféré au ou aux registres appropriés du compteur à paiement et il convient que la valeur de crédit disponible dans le compteur soit incrémentée exactement de ce montant (voir Note 1).

Il convient d'indiquer l'acceptation du jeton sur le compteur à paiement et il convient également que celle-ci produise toujours une annulation du jeton de sorte que ce jeton soit alors non valable et ne puisse plus être de nouveau accepté. Toutefois, les supports de jeton réutilisables peuvent ensuite être chargés avec un nouvel achat de crédit de jeton et redevenir valables.

Si les conditions régnaient empêchent l'acceptation d'un jeton valable, il convient de le rejeter en tant que jeton non valable ou de l'ignorer et de le laisser inchangé. Il convient qu'un jeton valable ayant été précédemment rejeté ou ignoré puisse être accepté lorsque les conditions régnaient le permettent par la suite.

Il convient d'effectuer la vérification de l'acceptation d'un jeton à la fois à courant nul et à $I_{\max}$ et un facteur de puissance unitaire. Il convient de vérifier l'acceptation d'un jeton aux limites du domaine de fonctionnement étendu de tension d'alimentation et aux limites du domaine de fonctionnement spécifié de température. Se référer aussi à A.1.3, A.1.4 et A.1.5.

Il convient d'appliquer ceci sans mettre en œuvre certaines dispositions supplémentaires qui peuvent être présentes dans le compteur, par exemple un crédit d'urgence, un crédit de réserve ou un crédit de jeton partiellement alloué pour un nouveau paiement ou une créance de crédit d'urgence.

Il convient également de vérifier l'acceptation d'un jeton en tant que partie de certaines des autres exigences et essais indiqués dans les Articles 5, 6, 7 et 8.

NOTE 1 Pour certaines mises en œuvre de compteur à paiement utilisant des supports de jeton à carte magnétique, le mécanisme d'insertion de jetons applique une marque au support de jeton pour indiquer que l'acceptation de ce jeton a été réalisée.

NOTE 2 Pour certaines mises en œuvre de compteur à paiement, un signal sonore est émis pour indiquer que l'acceptation du jeton a été réalisée.

A.1.2.2 Rejet de jeton

Il convient que le compteur à paiement traite les jetons valables et non valables conformément aux exigences suivantes:

Dans les conditions normales, il convient que le compteur à paiement rejette ou ignore tout jeton non valable et il convient qu'il n'en résulte aucune modification des informations contenues dans les registres de comptabilité du compteur. Il convient que le fait qu'un jeton soit rejeté ou ignoré ne conduise jamais à son annulation ou à une quelconque modification des informations contenues sur le support du jeton, c'est-à-dire qu'il convient que le jeton reste valable pour être utilisé avec son application prévue ou avec le compteur correct.

Il convient que le compteur à paiement rejette ou ignore systématiquement un jeton non valable, quelles que soient les conditions régnantes; il convient qu'il n'y ait pas de conditions régnantes dans le domaine de fonctionnement limite dans lequel un jeton non valable peut être accepté.

Si les conditions régnantes empêchent l'acceptation ou le rejet d'un jeton, il convient de l'ignorer et il convient de laisser inchangés à la fois le jeton et le ou les registres de comptabilité du compteur.

Il convient de vérifier le fait qu'un jeton est rejeté ou ignoré, à courant nul et à $I_{\max}$ et un facteur de puissance unitaire. Il convient de vérifier le fait qu'un jeton est rejeté ou ignoré, aux limites du domaine de fonctionnement étendu de tension d'alimentation et aux limites du domaine de fonctionnement spécifié de température. Se référer aussi à 6.2, 7.2.1 et A.1.3.

A.1.2.3 Processus de comptabilité du compteur

Le processus de comptabilité du compteur est géré dans le compteur à paiement lui-même. En général, en mode de prépaiement, la consommation mesurée en kilowattheures conduit à une diminution proportionnelle de la valeur de crédit disponible. Les coûts basés sur le temps, par exemple les redevances d'abonnement, diminuent également la valeur de crédit disponible le cas échéant. L'ensemble de ces diminutions peut faire baisser le crédit disponible jusqu'à des valeurs négatives, en passant par zéro, sauf si un autre crédit de jeton est acheté et chargé. Lorsque le crédit tombe à zéro, l'interrupteur de commande de l'alimentation s'ouvre automatiquement. La fermeture de l'interrupteur de commande de l'alimentation n'est effectuée que lorsque le crédit de jeton est rechargé et que le crédit disponible devient positif. L'essai de ces autres fonctions valide le processus de comptabilité du compteur.

Les conditions d'interruption/rétablissement de l'interrupteur de commande de l'alimentation peuvent être différentes s'il existe une fonctionnalité supplémentaire, telle qu'un crédit d'urgence ou un crédit de jeton partiellement alloué pour un nouveau paiement de créance de crédit d'urgence; elles sont également différentes pour les autres modes de paiement (se référer à l'Article A.2).

A.1.2.4 Collecte des coûts de consommation

Si des périodes sans interruption spécifiques à une application ou des dispositions de crédit d'urgence sont incorporées dans un compteur à paiement, il convient de les désactiver avant d'exécuter l'essai suivant.

Il convient de soumettre à essai la fonction de coûts de consommation pour une consommation d'énergie suffisante pour assurer des déductions correctes du crédit disponible. Si le compteur à paiement fonctionne en unités monétaires, il convient de fixer un prix approprié par kilowattheure. Si le compteur à paiement comporte des fonctions de facturation basées sur le temps, il convient de les désactiver pour cet essai. Il convient de prévoir un crédit disponible suffisant et de le consigner, et il convient d'appliquer la charge maximale au compteur à paiement pendant la durée nécessaire. Il convient que l'avance du registre kWh cumulé corresponde à la déduction du crédit disponible qui a alors eu lieu.

Si le compteur à paiement fonctionne en unités monétaires, il convient de répéter l'essai avec un domaine de paramètres représentatif du prix du kilowattheure, incluant le paramètre maximal. Si le compteur à paiement comporte des registres multitarifs de kilowattheures, il convient de répéter ces essais pour chaque tarif des registres de kilowattheures.

A.1.2.5 Collecte des redevances d'abonnement

Si le compteur à paiement comporte une disposition de collecte de redevance d'abonnement, il convient d'appliquer ce qui suit.

Il convient de décrémenter la valeur de crédit disponible au tarif correct réglé pour les coûts basés sur le temps. Les mises en œuvre de ces déductions de coûts par rapport au crédit disponible varient entre différents types de compteurs à paiement (par exemple les déductions étant effectuées chaque heure ou chaque jour); il convient d'effectuer un choix approprié des périodes d'essai.

Si le compteur à paiement comporte d'autres fonctions de facturation basées sur le temps, il convient alors de les désactiver pendant cet essai et il convient de mettre la charge du compteur à zéro. Il convient alors de déterminer une redevance d'abonnement appropriée pour permettre la vérification d'une déduction précise du crédit disponible pendant une période d'essai appropriée. Le choix des paramètres dépend de la mise en œuvre spécifique du dispositif de redevance d'abonnement dans le compteur à paiement.

Il convient alors de répéter l'essai ci-dessus pour une charge maximale du compteur et, si le compteur à paiement fonctionne en unités monétaires, il convient de fixer un prix approprié du kilowattheure. Il convient ensuite de corriger la déduction totale du crédit disponible pendant la période d'essai à la fois en ce qui concerne la redevance d'abonnement et l'avance du registre de kilowattheures. Si le compteur à paiement comporte des registres multitarifs de kilowattheures, il convient de répéter ces essais pour chaque tarif des registres de kilowattheures.

A.1.2.6 Interruption et rétablissement de la charge

Il convient que le compteur interrompe normalement la charge lorsque le crédit disponible a été consommé. Il convient que le compteur soit capable de décrémenter la valeur de crédit disponible au-delà de zéro, en valeur négative, y compris si pour des raisons spécifiques à une application la charge n'est pas interrompue lorsque le crédit disponible a été consommé.

Lorsque la charge est interrompue par une telle action du processus de comptabilité du compteur, il convient que l'interrupteur de commande de l'alimentation ne puisse être actionné que pour rétablir la charge après une intervention manuelle complémentaire appropriée, par exemple en appuyant sur un bouton-poussoir ou en présentant manuellement un autre jeton de crédit. Il convient qu'il en soit ainsi pour toute condition du processus de comptabilité du compteur et crédit disponible, et pour toute tension d'alimentation ou température dans les domaines limites de fonctionnement.

Se référer aussi à 5.4.3, 6.2, 7.2.1, 7.9, A.1.3, A.1.4 et A.1.5.

A.1.2.7 Effet des interruptions de service

Dans le cas où une interruption de service du réseau électrique interrompt l'alimentation du compteur à paiement, il convient qu'il n'y ait aucun dysfonctionnement dans l'exploitation du processus de comptabilité du compteur. Il convient que tous les registres conservent la valeur qu'ils avaient avant l'interruption de service. Pour les besoins des essais, il convient d'inhiber toutes les fonctions de facturation basées sur le temps. Pour l'essai, se référer à A.1.3.

NOTE Se référer à 7.2.2 pour ce qui concerne l'influence des creux de tension et des interruptions brèves.

A.1.3 Essais fonctionnels de base dans les limites des domaines de tension et de température

Il convient de procéder également aux essais des fonctions de base du compteur à paiement et il convient de satisfaire aux exigences dans chacune des conditions suivantes:

- limites inférieures et supérieures du domaine de température de fonctionnement spécifié;
- limites inférieures et supérieures du domaine de tension de fonctionnement étendu.

La série d'essais est donc exécutée quatre fois dans ces conditions:

- limite de température inférieure + limite de tension inférieure;
- limite de température inférieure + limite de tension supérieure;
- limite de température supérieure + limite de tension inférieure;
- limite de température supérieure + limite de tension supérieure.

Il convient d'utiliser la série d'essais suivante:

- a) il convient que le compteur à paiement soit en mode de prépaiement et monté comme en service normal, y compris dans un socle correspondant spécifié, le cas échéant. Si le compteur comporte une série de fonctions de facturation basées sur le temps, il convient de les désactiver jusqu'à la partie appropriée de ces essais. Si des périodes sans interruption spécifiques à une application ou des dispositions de crédit d'urgence sont incorporées, il convient de les désactiver pendant tous ces essais;
- b) si le compteur à paiement fonctionne en unités monétaires, il convient de fixer un prix approprié par kilowattheure. Il convient de préparer le compteur en appliquant une charge jusqu'à épuisement du crédit disponible et que l'interrupteur de commande de l'alimentation s'ouvre automatiquement. Les relevés du registre de kilowattheures cumulés et de la valeur de crédit disponible sont ensuite enregistrés. La tension d'alimentation est ensuite coupée;
- c) le compteur est soumis à la limite de température souhaitée, jusqu'à stabilisation de la température. La tension fournie est ensuite appliquée à courant de charge nul et au bout d'une minute, les relevés du registre et de la valeur sont de nouveau enregistrés et leur bonne conservation est vérifiée. Un jeton invalide est ensuite présenté et son rejet correct est contrôlé;
- d) il convient ensuite de présenter au compteur un jeton valable comportant une valeur appropriée de crédit pour contrôler l'acceptation du jeton. Les relevés sont ensuite enregistrés et la bonne progression du crédit disponible est contrôlée. Il convient que l'interrupteur de commande de l'alimentation soit alors fermé, ou bien il peut être fermé manuellement, selon la conception;

- e) la tension d'alimentation est alors interrompue pendant 5 min, puis rétablie à courant de charge nul. Les relevés sont ensuite enregistrés et leur bonne conservation est contrôlée;
- f) une charge de $I_{\max}$ et un facteur de puissance unitaire sont alors appliqués de façon que le crédit disponible diminue et finalement, l'interrupteur de commande de l'alimentation s'ouvre automatiquement. Les relevés sont ensuite enregistrés et la correspondance de leurs modifications vérifiée. Dans le cas d'un compteur à tarifs multiples, cet essai peut être exécuté pour un seul tarif;
- g) si le compteur à paiement comporte une disposition pour recueillir les redevances d'abonnement, il convient d'effectuer l'essai suivant. Si d'autres fonctions de facturation basées sur le temps sont incluses, il convient de les désactiver pendant cet essai. Il convient de fixer une redevance d'abonnement appropriée pour permettre la vérification de la déduction précise du crédit disponible pendant une période d'essai appropriée. Le choix des paramètres dépend de la mise en œuvre spécifique du dispositif de redevance d'abonnement dans le compteur à paiement.
Il convient ensuite de charger une valeur de jeton appropriée dans le compteur et d'enregistrer les relevés. Il convient ensuite de laisser le compteur sous tension à courant nul pendant une durée appropriée, qu'il convient de mesurer avec une horloge de référence. A l'issue de cette période, il convient d'enregistrer les relevés et de vérifier la correspondance de leurs modifications;
- h) il convient alors de répéter les étapes d'essai a) à g) pour la limite de température inférieure, mais à la limite de tension supérieure;
- i) il convient alors de répéter les étapes d'essai a) à h) à la limite de température supérieure.

A.1.4 Essais fonctionnels dans le domaine de fonctionnement limite de tension

Les exigences de fonctionnement du compteur à paiement en dehors du domaine de fonctionnement étendu de la tension d'alimentation, mais dans le domaine de fonctionnement limite (c'est-à-dire de 0,0 à 0,8 U_n), sont données en 7.2.1.4.

Il convient d'exécuter l'essai suivant dans des conditions de référence, la tension d'alimentation du compteur à paiement variant entre zéro et 0,8 U_n . Il convient d'utiliser la série d'essais suivante:

- a) il convient que le compteur à paiement soit en mode de prépaiement et monté comme en service normal, y compris dans un socle correspondant spécifié, le cas échéant. Si le compteur comporte un ensemble de fonctions de facturation basées sur le temps, il convient de les désactiver pendant tous ces essais. Si des périodes sans interruption spécifiques à une application ou des dispositions de crédit d'urgence sont incorporées, il convient de les désactiver pendant tous ces essais. Si le compteur à paiement fonctionne en unités monétaires, il convient de déterminer un prix maximal par kilowattheure. En ce qui concerne toute fonction couverte par la note de 7.2.1.4 incluse dans le compteur à paiement, cette fonction peut être inhibée le cas échéant;
- b) il convient de faire en sorte que le compteur ait une valeur de crédit négative disponible, de façon à s'assurer que l'interrupteur de commande de l'alimentation est ouvert. Les relevés du registre de kilowattheures cumulés et de la valeur de crédit disponible sont ensuite enregistrés. La tension d'alimentation est ensuite coupée;
- c) il convient d'augmenter la tension d'alimentation à partir de zéro à une vitesse fixe et progressive approximativement de 1 % de U_n par seconde sans courant de charge, avec une pause à chacun des niveaux suivants pendant 60 s: 20 % de U_n , 40 % de U_n , 60 % de U_n , 80 % de U_n . A 80 % U_n , il convient de vérifier que l'interrupteur de commande de l'alimentation est dans la bonne position;
- d) après 60 s à 80 % U_n , il convient de diminuer la tension d'alimentation à une vitesse fixe et progressive approximativement de 1 % de U_n par seconde sans courant de charge, avec une pause à chacun des niveaux suivants pendant 60 s: 70 % de U_n , 50 % de U_n , 30 % de U_n , 10 % de U_n , avant d'atteindre zéro;