

TECHNICAL SPECIFICATION

**Selection and dimensioning of high-voltage insulators intended for use in
polluted conditions –
Part 2: Ceramic and glass insulators for a.c. systems**

IECNORM.COM : Click to view the full PDF of IEC TS 60815-2:2008



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2008 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.

If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de la CEI ou du Comité national de la CEI du pays du demandeur.

Si vous avez des questions sur le copyright de la CEI ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de la CEI de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland
Email: inmail@iec.ch
Web: www.iec.ch

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

- Catalogue of IEC publications: www.iec.ch/searchpub

The IEC on-line Catalogue enables you to search by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, withdrawn and replaced publications.

- IEC Just Published: www.iec.ch/online_news/justpub

Stay up to date on all new IEC publications. Just Published details twice a month all new publications released. Available on-line and also by email.

- Electropedia: www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 20 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary online.

- Customer Service Centre: www.iec.ch/webstore/custserv

If you wish to give us your feedback on this publication or need further assistance, please visit the Customer Service Centre FAQ or contact us:

Email: csc@iec.ch
Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00

TECHNICAL SPECIFICATION

**Selection and dimensioning of high-voltage insulators intended for use in
polluted conditions –
Part 2: Ceramic and glass insulators for a.c. systems**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

PRICE CODE

S

ICS 29.080.10

ISBN 978-2-88910-302-7

CONTENTS

FOREWORD.....	4
1 Scope and object.....	6
2 Normative references	6
3 Terms, definitions and abbreviations	6
3.1 Terms and definitions	7
3.2 Abbreviations	7
4 Principles	7
5 Materials	8
6 Site severity determination	8
7 Determination of the reference unified specific creepage distance (RUSCD).....	8
8 Choice of profile	9
8.1 General recommendations for porcelain and glass profiles	9
8.2 Profile suitability.....	12
9 Checking the profile parameters	12
9.1 Alternating sheds and shed overhang.....	15
9.2 Spacing versus shed overhang.....	15
9.3 Minimum distance between sheds	16
9.4 Creepage distance versus clearance	16
9.5 Shed angle.....	17
9.6 Creepage factor	17
10 Correction of the RUSCD.....	17
10.1 Correction for altitude K_a	18
10.2 Correction for insulator diameter K_{ad}	18
11 Determination of the required minimum nominal creepage distance.....	19
12 Confirmation by testing.....	19
12.1 Determination of the long-duration withstand voltage.....	19
12.2 Selection of the standard pollution withstand test type.....	19
12.3 Artificial pollution test parameters.....	20
12.4 Criteria of confirmation	21
Bibliography.....	22
Figure 1 – RUSCD as a function of SPS class	9
Figure 2 – Typical “standard” profiles.....	10
Figure 3 – Typical “open” profiles.....	11
Figure 4 – Typical “anti-fog” profiles.....	11
Figure 5 – Typical “alternating” profiles.....	11
Figure 6 – Typical pin insulator shed profiles	12
Figure 7 – K_{ad} as a function of insulator diameter	18

Table 1 – Principal advantages (+) and disadvantages (-) of main profile types	10
Table 2 – Profile suitability, relative to a standard profile, for porcelain and glass insulators assuming the same creepage distance per unit or string	13
Table 3 – Profile suitability, relative to a standard profile, for porcelain and glass insulators assuming the same insulating length	14
Table 4 – Artificial pollution test parameters for confirmation by testing	20

IECNORM.COM : Click to view the full PDF of IEC TS 60815-2:2008

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**SELECTION AND DIMENSIONING OF HIGH-VOLTAGE INSULATORS
INTENDED FOR USE IN POLLUTED CONDITIONS –****Part 2: Ceramic and glass insulators for a.c. systems**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. In exceptional circumstances, a technical committee may propose the publication of a technical specification when

- the required support cannot be obtained for the publication of an International Standard, despite repeated efforts, or
- the subject is still under technical development or where, for any other reason, there is the future but no immediate possibility of an agreement on an International Standard.

Technical specifications are subject to review within three years of publication to decide whether they can be transformed into International Standards.

IEC/TS 60815-2, which is a technical specification, has been prepared by technical committee 36: Insulators.

This first edition of IEC/TS 60815-2, together with IEC/TS 60815-1, cancels and replaces IEC/TR 60815, which was issued as a technical report in 1986. It constitutes a technical

revision and now has the status of a technical specification. The text of this technical specification is based on the following documents:

Enquiry draft	Report on voting
36/265/DTS	36/271A/RVC

Full information on the voting for the approval of this technical specification can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2

A list of all the parts in the future IEC 60815 series, under the general title *Selection and dimensioning of high-voltage insulators intended for use in polluted conditions*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- transformed into an International standard,
- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

A bilingual version of this publication may be issued at a later date.

IECNORM.COM : Click to view the full PDF of IEC TS 60815-2:2008

SELECTION AND DIMENSIONING OF HIGH-VOLTAGE INSULATORS INTENDED FOR USE IN POLLUTED CONDITIONS –

Part 2: Ceramic and glass insulators for a.c. systems

1 Scope and object

IEC/TS 60815-1, which is a technical specification, is applicable to the selection of ceramic and glass insulators for a.c. systems, and the determination of their relevant dimensions, to be used in high-voltage systems with respect to pollution.

This part of IEC 60815 gives specific guidelines and principles to arrive at an informed judgement on the probable behaviour of a given insulator in certain pollution environments.

The basis for the structure and approach of this part of IEC 60815 is fully explained in IEC/TS 60815-1.

The object of this technical specification is to give the user means to:

- determine the reference unified specific creepage distance (RUSCD) from site pollution severity (SPS) class;
- evaluate the suitability of different insulator profiles;
- determine the necessary USCD by applying corrections for insulator shape, size, position, etc. to the RUSCD;
- if required, determine the appropriate test methods and parameters to verify the performance of the selected insulators.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60050-471, *International Electrotechnical Vocabulary – Part 471: Insulators*

IEC 60507, *Artificial pollution tests on high-voltage insulators to be used on a.c. systems*

IEC/TS 60815-1, *Selection and dimensioning of high-voltage insulators for polluted conditions – Part 1: Definitions information and general principles*

3 Terms, definitions and abbreviations

For the purposes of this document, the following terms, definitions and abbreviations apply. The definitions given below are those which either do not appear in IEC 60050-471 or differ from those given in IEC 60050-471.

3.1 Terms and definitions

3.2

unified specific creepage distance

USCD

creepage distance of an insulator divided by the r.m.s. value of the highest operating voltage across the insulator

NOTE 1 This definition differs from that of specific creepage distance where the line-to-line value of the highest voltage for the equipment is used (for a.c. systems usually $U_m/\sqrt{3}$). For line-to-earth insulation, this definition will result in a value that is $\sqrt{3}$ times that given by the definition of specific creepage distance in IEC/TR 60815 (1986).

NOTE 2 For ' U_m ' see IECV 604-03-01 [1]¹.

NOTE 3 It is generally expressed in mm/kV and usually expressed as a minimum.

3.3

reference unified specific creepage distance

RUSCD

initial value of unified specific creepage distance for a pollution site before correction for size, profile, mounting position, etc. according to this technical specification and generally expressed in mm/kV

3.4 Abbreviations

CF	creepage factor
ESDD	equivalent salt deposit density
NSDD	non soluble deposit density
SDD	salt deposit density
SES	site equivalent salinity
SPS	site pollution severity
USCD	unified specific creepage distance
RUSCD	reference unified specific creepage distance

4 Principles

The overall process of insulation selection and dimensioning can be summarized as follows:

Firstly, using IEC/TS 60815-1:

- determine the appropriate approach: 1, 2 or 3 as a function of available knowledge, time and resources;
- collect the necessary input data, notably system voltage, insulation application type (line, post, bushing, etc.);
- collect the necessary environmental data, notably site pollution severity and class.

At this stage, a preliminary choice of possible candidate insulators suitable for the applications and environment may be made.

Then, using this technical specification:

- refine the choice of possible candidate ceramic or glass insulators suitable for the environment;

¹ References in square brackets refer to the bibliography.

- determine the reference USCD for the insulator types and materials, either using the indications given in this technical specification, or from service or test station experience in the case of approach 1 (Clause 7);
- choose suitable profiles for the type of environment (Clause 8);
- verify that the profile satisfies certain parameters, with correction or action according to the degree of deviation (Clause 9);
- modify, where necessary (approaches 2 and 3), of the RUSCD by factors depending on the size, profile, orientation, etc. of the candidate insulator (Clauses 10 and 11);
- verify that the resulting candidate insulators satisfy the other system and line requirements such as those given in Table 2 of IEC/TS 60815-1 (e.g. imposed geometry, dimensions, economics);
- verify the dimensioning, if required in the case of approach 2, by laboratory tests (see Clause 12).

NOTE Without sufficient time and resources (i.e. using approach 3), the determination of the necessary USCD will have less accuracy.

5 Materials

This technical specification is applicable to ceramic and glass insulators. The guidance given here assumes that the insulators are of standard manufacture without any surface modification or treatment.

Technologies exist intended to improve the performance of such insulators under pollution, for example, semi-conducting glaze and hydrophobic coatings. At present it is not possible to give specific information on the degree and durability of the improvement given by such technologies.

As far as the relative performance of ceramic and glass insulators under pollution is concerned, there is no notable consistent difference between these materials; hence the choice of either glass or ceramic material with respect to the other depends purely on factors (e.g. ageing, operating experience, maintenance procedures) which are out of the scope of this technical specification.

6 Site severity determination

For the purposes of standardization, five classes of pollution characterizing the site severity are qualitatively defined in IEC/TS 60815-1, from very light pollution to very heavy pollution, as follows:

- a – Very light;
- b – Light;
- c – Medium;
- d – Heavy;
- e – Very heavy.

NOTE These letter classes do not correspond directly to the previous number classes of IEC/TR 60815:1986.

The SPS class for the site is determined according to IEC/TS 60815-1 and is used to determine the reference USCD for glass and ceramic insulators.

7 Determination of the reference unified specific creepage distance (RUSCD)

Figure 1 shows the relation between SPS class and RUSCD for glass and ceramic insulators. The bars are preferred values representative of a minimum requirement for each class and

are given for use with approach 3 as described in IEC/TS 60815-1. If the estimation of SPS class tends towards the neighbouring higher class, then the curve may be followed.

If exact SPS measurements are available (approach 1 or 2), it is recommended to take a RUSCD which corresponds to the position of the SPS measurements within the class by following the curve in Figure 1.

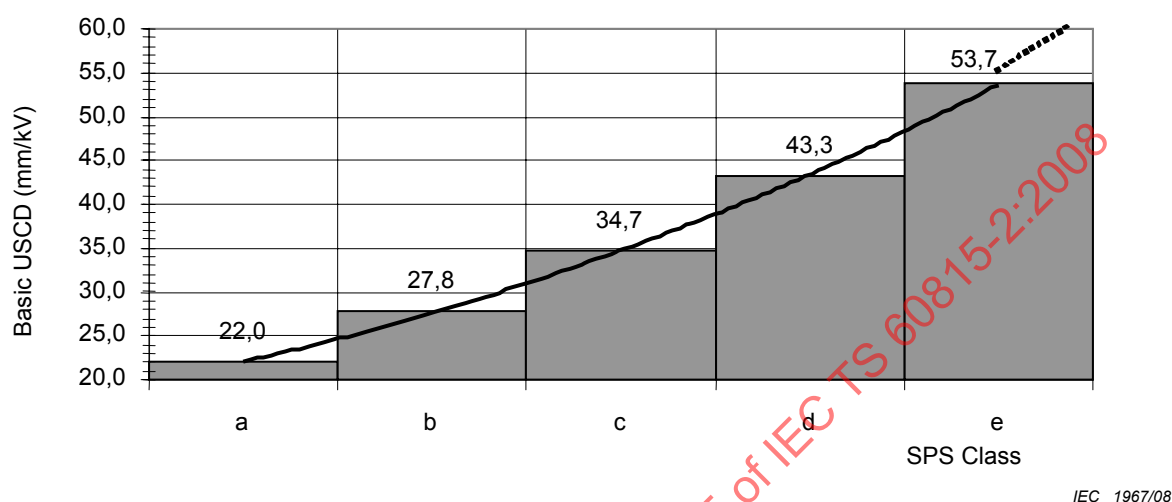


Figure 1 – RUSCD as a function of SPS class

In cases of exceptionally high SPS in, or beyond, class e (see IEC/TS 60815-1, 8.2) the minimum RUSCD may not be adequate. Depending on service experience and/or laboratory test results a higher USCD can be used; in some instances mitigation may be useful (see IEC/TS 60815-1, 9.5.5).

NOTE It is assumed that the final USCD resulting from the application of the corrections given hereafter to the RUSCD will not correspond exactly to a creepage distance available for catalogue insulators. Hence it is preferred to work with exact figures and to round up to an appropriate value at the end of the correction process.

8 Choice of profile

8.1 General recommendations for porcelain and glass profiles

Table 1 below shows a brief summary of the principal advantages and disadvantages of the main profile types with respect to pollution performance.

For standard profiles see Figure 2.

NOTE In the case of long rods, posts and hollows, the typical standard profile shed inclinations are 14° - 24° for the shed top angle α and 8° - 16° for the shed bottom angle β (illustrated in Figure 2b). Smaller angles are generally considered as being aerodynamic, while larger angles are considered as being anti-fog.

Table 1 – Principal advantages (+) and disadvantages (-) of main profile types

Mounting		Standard profile	Open profile	Anti-fog profile	Alternating shed arrangements
Vertical	+	Good experience from use in very light to medium SPS classes where a long creepage distance or aerodynamically effective profile is not required	Collects less pollution, due to aerodynamic profile and good natural cleaning	Prevents wetting of whole under side during rain, mist, etc. Long creepage distance per unit	Represents the relevant advantages and disadvantages of the individual profile types: standard, open or anti-fog with the benefits of - increased creepage distance per unit - good withstand capability under heavy wetting - good withstand capability under icing
	-	Does not avoid collection of wind-born deposits	Total surface collects more pollution in rapid accumulation conditions, such as storms, typhoons, etc., requires longer strings. Good experience from use in very light to medium SPS classes (in particular dry and semidry regions) where aerodynamically effective profile is required	More wind born deposit accumulates on the under-side due to reduced natural cleaning	
Horizontal	+	Collects less pollution because of natural cleaning by wetting	Collects less pollution, as the aerodynamic profile gives a better self-cleaning by wetting and wind	Long creepage distance per unit	
	-	Total surface becomes polluted but is accessible for natural cleaning	Total surface collects more pollution under rapid accumulation conditions, such as storms, typhoons, etc. Requires a longer string length	Wind born deposit accumulates on surfaces with deep under-rib due to reduced natural cleaning	

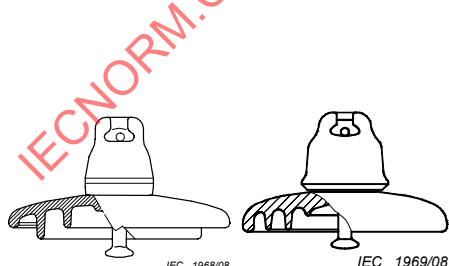


Figure 2a – Cap and pin standard disc insulators


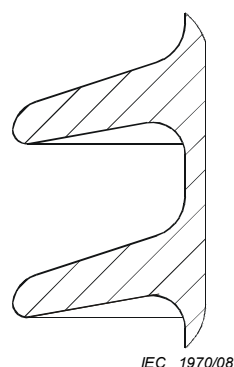



Figure 2b – Standard shed profile – long rod insulators, post insulators, hollow insulators

Figure 2 – Typical “standard” profiles


Aerodynamic or open profiles are shown in Figure 3 and anti-fog profiles are shown in Figure 4.

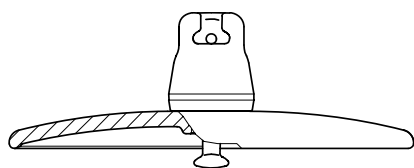

IEC 1971/08

Figure 3a – Aerodynamic disc insulators


IEC 1972/08

Figure 3b – Aerodynamic sheds – Long rod insulators, post insulators, hollow insulators**Figure 3 – Typical “open” profiles**


IEC 1973/08

Figure 4a – Steep anti-fog disc insulators

IEC 1974/08

Figure 4b – Steep anti-fog – long rod insulators, post insulators, hollow insulators


IEC 1975/08

Figure 4c – Deep under-ribs disc insulators


IEC 1976/08

Figure 4d – Deep under-ribs on long rod insulators, post insulators, hollow insulators**Figure 4 – Typical “anti-fog” profiles**

For the purposes of this technical specification, an alternating shed arrangement is defined as having a minimum difference in shed overhang of at least 15 mm (see Figure 5 and 9.4).




IEC 1977/08

Figure 5a – Alternating shed disc insulators

IEC 1978/08


Figure 5b – Alternating sheds on long rod insulators, post insulators, hollow insulators**Figure 5 – Typical “alternating” profiles**

Typical pin insulator shed profiles are shown in Figure 6. In general, pin insulator profiles can be assimilated to anti-fog profiles and are therefore not dealt with separately in the following.



IEC 1979/08

Figure 6a – Single-piece pin insulator

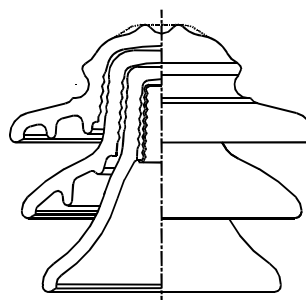

IEC 1980/08

Figure 6b – Multi-element pin insulator

Figure 6 – Typical pin insulator shed profiles

8.2 Profile suitability

Tables 2 and 3 give simple merit values for insulator profiles. In each case the merit value of each profile, relative to a standard profile, for use in specific areas is given as follows:

- ++ suitable, best choice;
- + suitable;
- 0 neutral, no particular advantage or disadvantage;
- unsuitable, but can be used;
- unsuitable, avoid this choice if possible.

Pollution is often not the sole parameter used for the choice of insulator profile. The insulator material, design, manufacturing process or application may preclude certain profiles. Hence the optimal profile may not be available for the combination of insulator/pollution type. Therefore, the choice or use of a less suitable profile is not excluded.

If an unsuitable profile is chosen, then it is recommended that the RUSCD be chosen from Figure 1 towards the upper end of the SPS class or even for the next higher class, unless such a change would cause, or aggravate, a deviation of the profile parameters in Clause 9. If an unsuitable profile is chosen which also has a minor deviation in profile parameters, then it is recommended to treat this profile as if it has a major deviation in profile parameters (see Clause 9).

9 Checking the profile parameters

9.1 Introductory remark

NOTE The profile parameters used in the following sub-clauses are based on the nominal design dimensions figuring on the detailed insulator drawing. They are not intended for verification during normal acceptance testing specified by product standards.

The following profile parameters have a normal (white) range, a grey range where they can reduce performance (minor deviation) and a black range where they can have a serious negative effect on performance under pollution (major deviation). Each parameter shall be calculated and checked according to the following. It is allowed for one parameter to deviate into a grey area, i.e. to have a minor deviation. In the case of a minor deviation, it is recommended that the RUSCD be chosen from Figure 1 towards the upper end of the SPS class or even for the next higher class, unless such a change would further aggravate the deviation. If more than one parameter is in a grey area, or any parameter in a black area, then this is considered as a major deviation and it is recommended to do one of the following:

- consult data from service or test station experience to confirm the performance of the profile;

- find an alternative profile or insulator technology;
- verify the performance of the profile by testing (see Clause 12).


Table 2 – Profile suitability, relative to a standard profile, for porcelain and glass insulators assuming the same creepage distance per unit or string

Environment type	Profile suitability	Standard profile ^a All types	Open profile ^b		Anti-fog profile All types
			Disc/ long rod	Post/hollow	
Desert	++				
	+		●		
	0	●□	□	●□	□ (Both)
	-				● (Vertical)
	--				● (Horizontal)
Coastal	++				□ (Vertical)
	+				● (Vertical)
	0	●□	● ^c	●□	●□ (Horizontal)
	-		□		
	--				
Industrial	++				
	+		●		
	0	●□	□	●□	□
	-				●
	--				
Agricultural	++				
	+				
	0	●		●	
	-		●		● (Vertical)
	--				● (Horizontal)
Inland (low pollution)	++				
	+				
	0	●	●	●	●
	-				
	--				
KEY		^a The standard profile is taken as the reference "0" level. This does not automatically make the standard profile suitable for all applications, since in certain cases it cannot supply the necessary creepage distance within the required insulating length ^b Alternating shed arrangements are mainly categorized in open profile. ^c For the areas where rapid pollution due to typhoons or similar events are anticipated, an open profile will collect more pollutants in a short period than a standard or anti-fog profile, hence its suitability may be reduced.			
● Type A pollution					
□ Type B pollution					

Table 3 – Profile suitability, relative to a standard profile, for porcelain and glass insulators assuming the same insulating length



Environment type	Profile suitability	Standard profile ^a All types	Open profile ^b		Anti-fog profile All types
			Disc/ long rod	Post/hollow	
Desert	++		●		
	+		□	●□	● (Vertical) □ (Both)
	0	●□			● (Horizontal)
	-				
	--				
Coastal	++				● (Vertical) □ (Vertical)
	+		● ^c	●□	● (Horiz.) □ (Horiz.)
	0	●□	□		
	-				
	--				
Industrial	++				
	+		●		● (Vertical) □
	0	●□	□	●□	● (Horizontal)
	-				
	--				
Agricultural	++				
	+				● (Vertical)
	0	●	●	●	
	-				● (Horizontal)
	--				
Inland (low pollution)	++				
	+				
	0	●	●	●	●
	-				
	--				
KEY		^a The standard profile is taken as the reference "0" level. This does not automatically make the standard profile suitable for all applications, since in certain cases it cannot supply the necessary creepage distance within the required insulating length. ^b Alternating shed arrangements are mainly categorized in open profile. ^c For the areas where rapid pollution due to typhoons or similar events are anticipated, an open profile will collect more pollutants in a short period than a standard or anti-fog profile, hence its suitability may be reduced.			
● Type A pollution □ Type B pollution					

9.2 Alternating sheds and shed overhang

	The classification of a profile as being alternating or not is based on difference in shed overhang measured from the insulator trunk to the tips of the largest and smallest sheds. <i>Shed overhang alone is not an important parameter, as long as the shed angle is not essentially flat ($< 5^\circ$), or excessive ($> 35^\circ$). The parameter is useful for defining uniform shed diameter profiles compared to alternating shed diameter profiles. However larger values of difference in shed overhang may be beneficial for vertical insulators in ice, snow and heavy rain conditions.</i> Not applicable to cap and pin insulators or multi-shed pin insulators
---	--



Classification of profile		
	Non-alternating	Alternating
All insulators	$p_1 = p_2$ or $p_1 - p_2 < 15 \text{ mm}$	$p_1 - p_2 \geq 15 \text{ mm}$

9.3 Spacing versus shed overhang



 Uniform sheds	 Alternating sheds	Spacing versus shed overhang is ratio of the vertical distance between two similar points of successive sheds of the same diameter (spacing) and the maximum shed overhang. <i>This parameter, as well as those described in 9.5, 9.6 and 9.7, involve shed-to-shed spacing and are important for the avoidance of "shorting out" creepage distance bridged by a shed-to-shed arc.</i> Not applicable to cap and pin insulators or multi-shed pin insulators
--	--	---

		Deviations for s/p									
		Major									
							Minor			None	
Sheds with under ribs		Major					Minor			None	
Sheds without under ribs		Major					Minor			None	
s/p		0,4	0,5	0,6	0,65	0,7	0,75	0,8	0,9	1	


9.4 Minimum distance between sheds

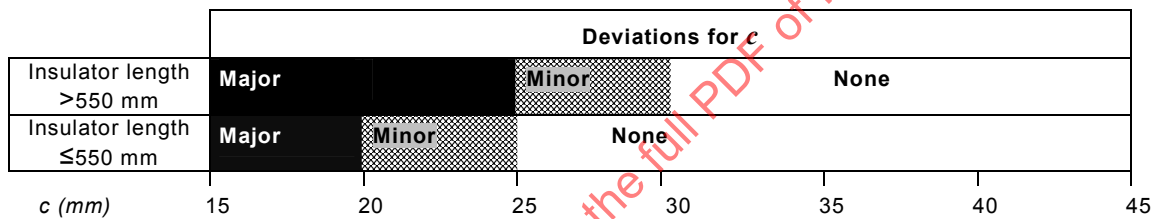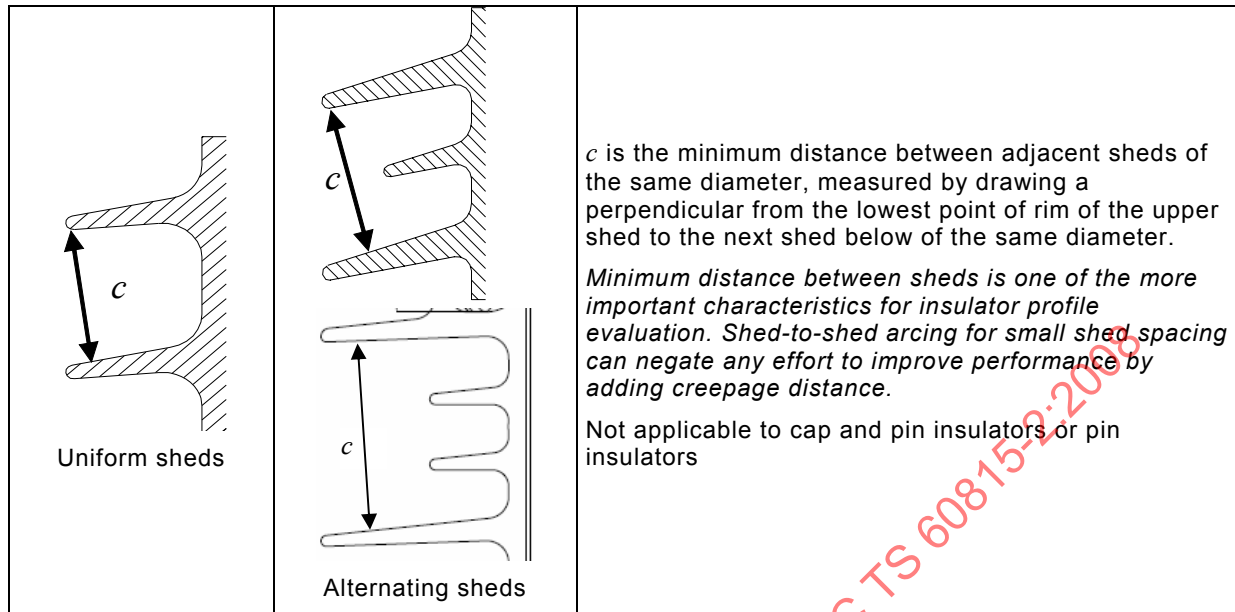

9.5 Creepage distance versus clearance

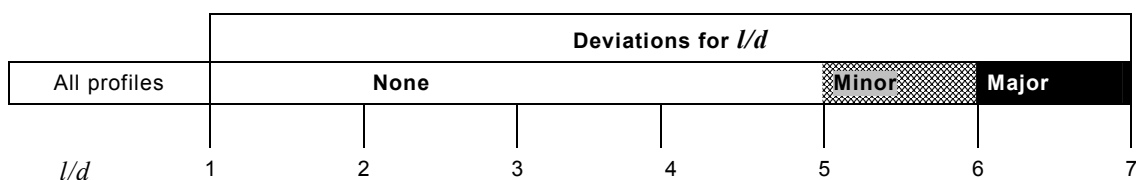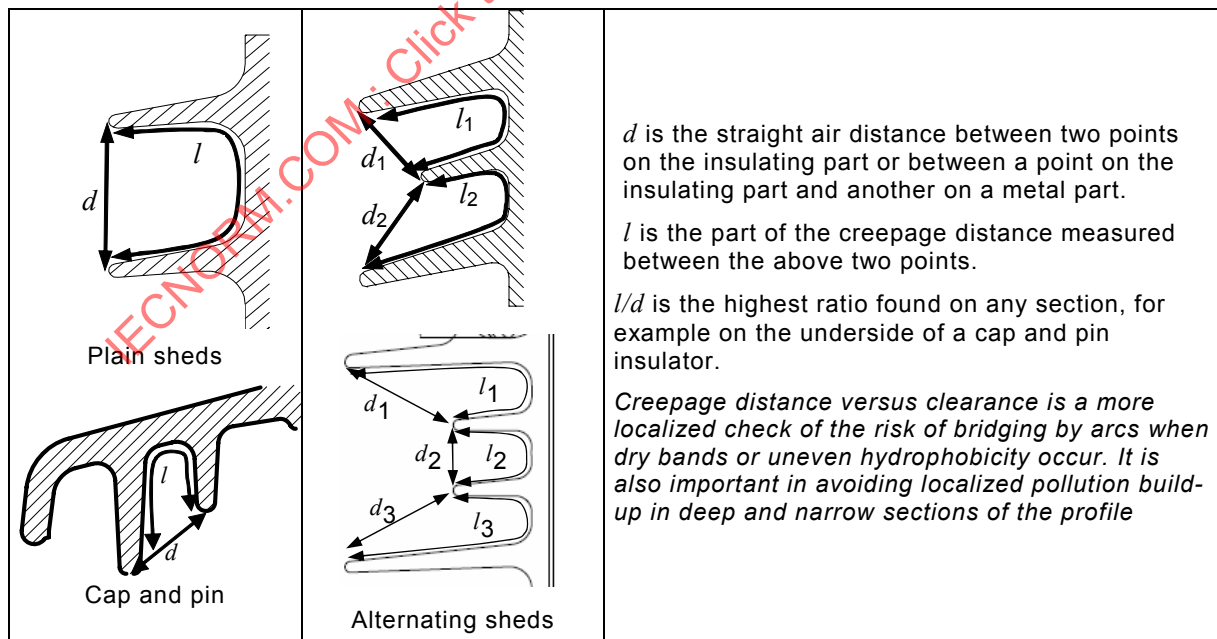

9.6 Shed angle



For rounded sheds, α is measured at the mid-point.

Open profiles allow for more efficient natural washing of insulator surfaces, provided the shed angle is not so low as to impede excess water run-off.

Not applicable to pin insulators

	Deviations for shed angle α				
Vertical insulators	Minor 0° Major	None		Minor	Major
Other positions	None		Minor	Major	

α °051020253035405060

315-2:2008

9.7 Creepage factor

CF is equal to l/S

where

l is the total nominal creepage distance of the insulator;

S is the arcing distance of the insulator.

For cap and pin insulators, CF is determined for a string of 5 insulators or more.

Creepage factor is a global check of the overall density of creepage distance. If the requirements in 9.1, 9.2 and 9.3 are met, the creepage factor requirement is usually automatically respected

	Deviations for CF					
SPS Class a	None	3,5 Minor	4,25 Major			
SPS Class b	None	3,625 Minor	4,4 Major			
SPS Class c	None	3,75 Minor	4,55 Major			
SPS Class d	None	3,875 Minor	4,7 Major			
SPS Class e	None	4,0 Minor	4,85 Major			
CF	2,5	3	3,5	4	4,5	5

10 Correction of the RUSCD

10.1 Introductory remark

The following corrections, where applicable, shall be applied to the reference unified specific creepage distance (RUSCD) determined after analysis according to Clause 9 above. All the factors are multipliers, as follows:

$$\text{Corrected USCD} = \text{RUSCD} \times K_a \times K_{ad}$$

10.2 Correction for altitude K_a

The influence of altitude on impulse withstand voltages is generally much greater than on pollution withstand performance. In general, the increase in insulation length necessary for impulse voltages at higher altitudes results in more than sufficient increase in creepage distance. This means, if not otherwise clearly stated by the purchaser of the insulator, usually $K_{ad} = 1$. If nevertheless, correction is required, notably for altitudes above 1 500 m where there is no previous operating experience, then correction can be used based on [1].

10.3 Correction for insulator diameter K_{ad}

For long rod, post and hollow insulators correct for average diameter D_a by:

$K_{ad} = 1$ when D_a is smaller than 300 mm;

$K_{ad} = 0,000\ 5\ D_a + 0,85$ when D_a is equal to or larger than 300 mm

The average diameter D_a is given by

$$D_a = \frac{\int_0^l D(x) dx}{l}$$

where $D(x)$ is the value of the diameter at a creepage distance x , measured from one electrode and l is the total nominal creepage distance of the insulator.

The above formula may be approximated in general by the following simple relation:

$$D_a = (2D_t + D_{s1} + D_{s2})/4$$

($D_{s1} = D_{s2}$ for non-alternating sheds)

For complex shed repetitions, add each extra diameter to the numerator and add 2 to the denominator.

In case of conflict or doubt this approximation shall not be used.

NOTE This correction takes into account both the reduced withstand performance and the reduced pollution accumulation of larger diameter insulators. The dotted line in the following Figure 7 shows the equivalent correction without the influence of reduced pollution accumulation, e.g. for artificial pollution testing.

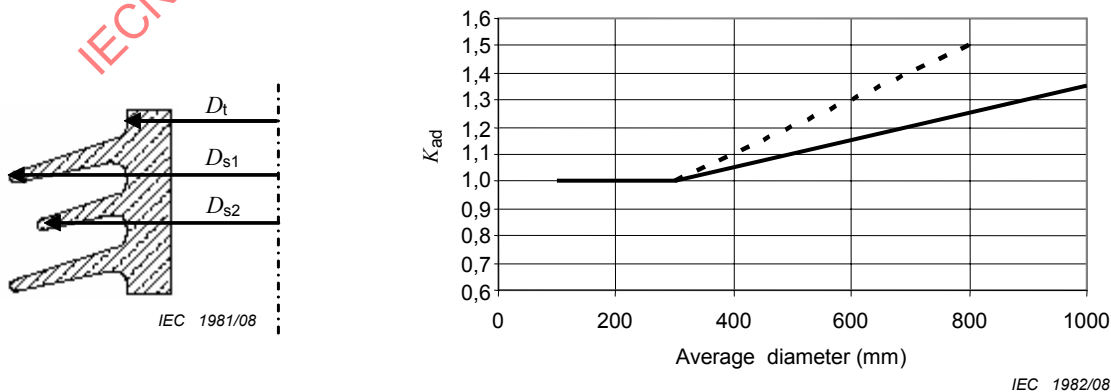


Figure 7 – K_{ad} as a function of insulator diameter