
**Thermoplastics piping systems for non-
pressure applications — Test method for
watertightness**

*Systèmes de canalisations thermoplastiques pour applications sans
pression — Méthode d'essai de l'étanchéité à l'eau*

STANDARDSISO.COM : Click to view the full PDF of ISO 13254:2010



PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

STANDARDSISO.COM : Click to view the full PDF of ISO 13254:2010



COPYRIGHT PROTECTED DOCUMENT

© ISO 2010

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 13254 was prepared by Technical Committee ISO/TC 138, *Plastics pipes, fittings and valves for the transport of fluids*, Subcommittee SC 1, *Plastics pipes and fittings for soil, waste and drainage (including land drainage)*.

STANDARDSISO.COM : Click to view the full PDF of ISO 13254:2010

Thermoplastics piping systems for non-pressure applications — Test method for watertightness

1 Scope

This International Standard specifies a test method for watertightness of thermoplastics products fabricated from more than one piece for non-pressure applications, and joints of thermoplastics piping systems for non-pressure applications.

2 Principle

A test assembly comprising either a fabricated product or an assembly of pipes and/or fittings is subjected to a given internal hydrostatic pressure for a given time period during which the leaktightness of the fabricated product or the joint is verified by inspection.

NOTE It is assumed that the following test parameters are set by the referring standard:

- a) the sampling procedure (see 4.1 and Clause 5);
- b) the number of test pieces (see 4.2).

3 Apparatus

3.1 End-sealing devices, having a size and using a sealing method that are appropriate to the type of joint assembly under test. The devices shall be restrained in such a manner that does not exert longitudinal forces on the joint assembly and prevents the devices or the assembly under test from separating under pressure. The mass of the devices shall not be permitted to influence the angular deflection to be applied (see 5.2).

3.2 Hydrostatic pressure source, connected to one end of at least one end-sealing device, capable of applying the required pressure gradually and evenly in accordance with 5.4, and then of keeping it constant to within $\pm 2\%$ for the required duration of test (see Clause 5).

3.3 Bleed valve, capable of venting air when the hydrostatic pressure is applied to the test piece.

3.4 Pressure-measuring device, capable of checking conformity to the required test pressure (see 3.2 and Clause 5).


4 Test pieces

4.1 Preparation of test pieces

The test piece shall comprise either a fabricated fitting or an assembly of (a) pipe section(s) (with or without sockets) and/or fitting(s), including at least one joint of the type under test (see Figure 1).

To assist air removal, the test pieces may be inclined by up to 12° .

Dimensions in millimetres

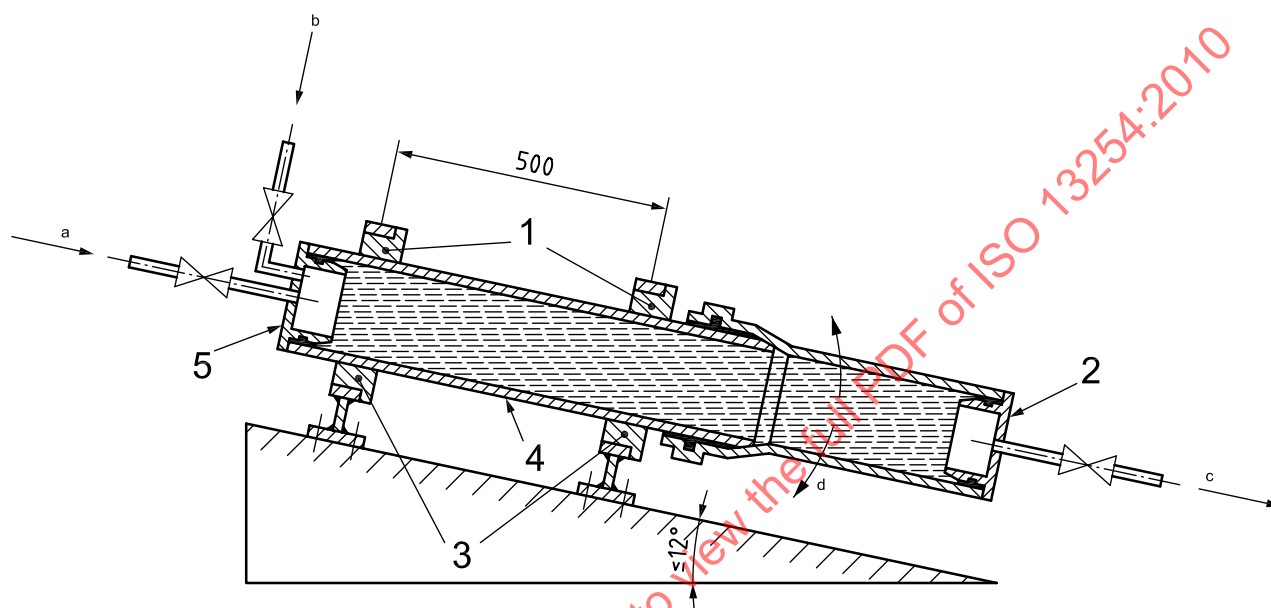

Key

- 1 fixed points
- 2 sealing plug with water outlet and end restraint (see 3.1)
- 3 loose bushes enabling all sizes of pipes to be accommodated on the same test fixture
- 4 fixed component
- 5 sealing plug with water inlet, air outlet and end restraint

- a Water inlet.
- b Air outlet.
- c Water outlet.
- d Direction of movement for angular deflection, if applicable (see 5.2).

Figure 1 — Typical arrangement

The assembly of the joint(s) shall be carried out in accordance with the manufacturer's instructions.

The assembly shall comprise the combination of the smallest available spigot end and the largest available socket or socket groove diameter within the applicable tolerance(s) and obtained by sampling in accordance with the referring standard.

The relevant diameters of the selected spigots and sockets shall be measured and recorded.

4.2 Number of test pieces

The number of test pieces shall be specified in the referring standard.