

---

---

**Hygrothermal performance of  
building equipment and industrial  
installations — Calculation of  
water vapour diffusion — Cold pipe  
insulation systems**

*Performance hygrothermique des équipements de bâtiments et  
installations industrielles — Calcul de la diffusion de vapeur d'eau —  
Systèmes d'isolation de tuyauteries froides*



STANDARDSISO.COM : Click to view the full PDF of ISO 15758:2014



**COPYRIGHT PROTECTED DOCUMENT**

© ISO 2014

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
Case postale 56 • CH-1211 Geneva 20  
Tel. + 41 22 749 01 11  
Fax + 41 22 749 09 47  
E-mail [copyright@iso.org](mailto:copyright@iso.org)  
Web [www.iso.org](http://www.iso.org)

Published in Switzerland

# Contents

|                                                                                                                                                       | Page      |
|-------------------------------------------------------------------------------------------------------------------------------------------------------|-----------|
| Foreword .....                                                                                                                                        | iv        |
| Introduction .....                                                                                                                                    | v         |
| <b>1 Scope</b> .....                                                                                                                                  | <b>1</b>  |
| <b>2 Normative references</b> .....                                                                                                                   | <b>1</b>  |
| <b>3 Terms, definitions and symbols</b> .....                                                                                                         | <b>1</b>  |
| <b>4 Calculation formulae</b> .....                                                                                                                   | <b>3</b>  |
| 4.1 General .....                                                                                                                                     | 3         |
| 4.2 Homogeneous insulation .....                                                                                                                      | 3         |
| 4.3 Multi-layer insulation systems .....                                                                                                              | 4         |
| 4.4 Systems with capacity for drying .....                                                                                                            | 4         |
| <b>5 Boundary conditions</b> .....                                                                                                                    | <b>5</b>  |
| <b>6 Calculation procedure</b> .....                                                                                                                  | <b>6</b>  |
| 6.1 General .....                                                                                                                                     | 6         |
| 6.2 Calculation of rate of condensation in single homogenous insulation layer .....                                                                   | 6         |
| 6.3 Calculation of rate of condensation in multi-layer insulation system .....                                                                        | 6         |
| <b>Annex A (informative) Examples</b> .....                                                                                                           | <b>9</b>  |
| <b>Annex B (informative) System with capacity for drying and experimental determination of evaporation rate from surface of wet wick fabric</b> ..... | <b>11</b> |
| <b>Bibliography</b> .....                                                                                                                             | <b>15</b> |

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2. [www.iso.org/directives](http://www.iso.org/directives)

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received. [www.iso.org/patents](http://www.iso.org/patents)

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the WTO principles in the Technical Barriers to Trade (TBT) see the following URL: Foreword - Supplementary information

The committee responsible for this document is ISO/TC 163, *Thermal performance and energy use in the built environment*, Subcommittee SC 2, *Calculation methods*.

This second edition cancels and replaces the first edition (ISO 15758:2004), which has been technically revised. The main changes are the following:

- in [Clause 5, b\)](#), the alternative of using annual mean temperature and vapour pressure has been removed;
- the method of calculation given in [6.3](#) has been changed such that the total amount of condensation water in the whole pipe system is calculated based only on the outermost tangent to the saturation pressure,  $p_{\text{sat}}$ ;
- [Figure 1](#) has been modified;
- the example given in [A.3](#) has been changed;
- in [Annex B](#), an explanation of the system with capacity for drying has been added;
- references have been added to the Bibliography.

## Introduction

If the thermal insulation of a cold pipe system is not completely water vapour tight, there will be a flow of water vapour from the warm environment to the surface of the pipe, whenever the temperature of the surface of the cold pipe is below the dew point of the ambient air. This flow of water vapour leads to an interstitial condensation in the insulation layer and/or dew formation on the surface of the pipe itself. Interstitial condensation may cause the insulation material to deteriorate and dew formation on the surface of a metal pipe may cause corrosion over time. If the temperature is below 0 °C ice will be formed and the methods of this standard will not apply.

In period, when the dew point of the ambient air is higher than the temperature of the outer surface of the insulation, surface condensation will occur. This is dealt with in ISO 12241.

Different measures are available to control water vapour transfer and reduce the amount of condensation. The following are normally applied:

- a) Installation of a vapour retarder;
- b) Use of insulation materials with a high water vapour resistance factor (low permeability);
- c) Use of a vapour retarder and a capillary active fabric to continuously remove condensed water from the pipe surface to the environment; see [Annex B](#) for an example.

Which protection measure is chosen depends on the ambient climate, the temperature of the medium in the pipe and the water vapour diffusion resistance of the insulation layer. The success of any system is strongly dependent on workmanship and maintenance. In any case anti-corrosion measures should be applied to a metal pipe in severe conditions.

The expected economic lifetime of an insulation system, assuming a maximum acceptable accumulated moisture content, can be calculated using the methods in this standard.

STANDARDSISO.COM : Click to view the full PDF of ISO 15758:2014

# Hygrothermal performance of building equipment and industrial installations — Calculation of water vapour diffusion — Cold pipe insulation systems

## 1 Scope

This International Standard specifies a method for calculating the density of the water vapour flow rate in cold pipe insulation systems, and the total amount of water diffused into the insulation over time. The calculation method presupposes that water vapour can only migrate into the insulation system by diffusion, with no contribution from airflow. It also assumes the use of homogeneous, isotropic insulation materials so that the water vapour partial pressure is constant at all points equidistant from the axis of the pipe.

This International Standard is applicable when the temperature of the medium in the pipe is above 0 °C. It applies to pipes inside buildings as well as in the open air.

## 2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 9346, *Hygrothermal performance of buildings and building materials — Physical quantities for mass transfer — Vocabulary*

ISO 12241, *Thermal insulation for building equipment and industrial installations — Calculation rules*

ISO 12572, *Hygrothermal performance of building materials and products — Determination of water vapour transmission properties*

ISO 13788, *Hygrothermal performance of building components and building elements — Internal surface temperature to avoid critical surface humidity and interstitial condensation — Calculation methods*

## 3 Terms, definitions and symbols

For the purposes of this document, the terms and definitions given in ISO 9346, ISO 12572 and ISO 13788, and the following terms, definitions and symbols (see [Table 1](#)) apply.

### 3.1 exposed moist area

surface area of a capillary active fabric that is exposed to the ambient atmosphere

### 3.2 vapour retarder

material with high resistance to the flow of water vapour

### 3.3 corrected water vapour diffusion equivalent air layer thickness

thickness of an imaginary plane layer with  $\mu = 1$ , and an area of  $\pi D_j$  which has the same diffusion resistance as the layer  $j$  with  $\mu = \mu_j$

Note 1 to entry: See Formula (18).

Table 1 — Symbols and associated units

| Symbol                 | Quantity                                                                                                                    | Unit <sup>a</sup>         |
|------------------------|-----------------------------------------------------------------------------------------------------------------------------|---------------------------|
| $A'_e$                 | Surface area from which evaporation takes place per linear metre of the pipe                                                | m <sup>2</sup> /m         |
| $D_0$                  | Outside diameter of cold pipe                                                                                               | m                         |
| $D_j$                  | Outside diameter of $j$ -th layer of an insulation system                                                                   | m                         |
| $D_n$                  | Outside diameter of the outer layer of an insulation system                                                                 | m                         |
| $G$                    | Total moisture uptake over a period per linear metre of pipe [refer to Formula (2)]                                         | kg/m                      |
| $G'$                   | Total moisture uptake over a period per linear metre of pipe                                                                | kg/m                      |
| $P$                    | Actual atmospheric pressure                                                                                                 | Pa                        |
| $P_0$                  | Standard atmospheric pressure = 101 325                                                                                     | Pa                        |
| $R_v$                  | Gas constant for water vapour = 461,5                                                                                       | J/(kg·K)                  |
| $T$                    | Thermodynamic temperature                                                                                                   | K                         |
| $Z'_{fl}$              | Water vapour resistance of one thin foil, cladding or skin per linear metre of pipe                                         | m·s·Pa/kg                 |
| $Z'_j$                 | Water vapour resistance of $j$ -th layer of an insulation system per linear metre of pipe                                   | m·s·Pa/kg                 |
| $Z'_p$                 | Water vapour resistance of insulation system per linear metre of pipe                                                       | m·s·Pa/kg                 |
| $d$                    | Thickness of an insulation layer                                                                                            | m                         |
| $f_e$                  | Evaporation factor                                                                                                          | kg/(m <sup>2</sup> ·s·Pa) |
| $g'$                   | Water vapour flow rate within the insulation per linear metre of pipe                                                       | kg/(m·s)                  |
| $g'_c$                 | Rate of condensation per linear metre of pipe                                                                               | kg/(m·s)                  |
| $g'_e$                 | Evaporation rate per linear metre of pipe                                                                                   | kg/(m·s)                  |
| $h_c$                  | Convection heat transfer coefficient                                                                                        | W/(m <sup>2</sup> ·K)     |
| $p$                    | Partial water vapour pressure                                                                                               | Pa                        |
| $p_a$                  | Partial water vapour pressure of air                                                                                        | Pa                        |
| $p_{sat}$              | Saturated water vapour pressure                                                                                             | Pa                        |
| $s_d$                  | Water vapour diffusion equivalent air layer thickness                                                                       | m                         |
| $s_{df}$               | Water vapour diffusion equivalent air layer thickness of foils                                                              | m                         |
| $t$                    | Period of calculation (month or year)                                                                                       | Month, year               |
| $x$                    | Distance                                                                                                                    | m                         |
| $\delta$               | Water vapour permeability                                                                                                   | kg/(m·s·Pa)               |
| $\delta_0$             | Water vapour permeability of air                                                                                            | kg/(m·s·Pa)               |
| $\sigma_{d,j}$         | Corrected water vapour diffusion equivalent air layer thickness of layer $j$                                                | m                         |
| $\tilde{\sigma}_{d,j}$ | Total corrected water vapour diffusion equivalent air layer thickness from surface of cold pipe to the outside of layer $j$ | m                         |
| $\mu$                  | Water vapour resistance factor                                                                                              | —                         |
| $\theta_0$             | Temperature of the medium in the pipe                                                                                       | °C                        |

<sup>a</sup> For practical reasons, hours or days are often used instead of seconds as units of time.



## 4 Calculation formulae

### 4.1 General

The density of water vapour flow rate,  $g$ , through a material is calculated by the following formula:

$$g = -\delta \frac{dp}{dx} \quad (1)$$

where  $\delta$  is the water vapour permeability of the material.

The total moisture uptake during a period,  $G$ , is given by

$$G = \int_0^t g \, dt \quad (2)$$

In calculations the diffusion resistance factor,  $\mu$ , is commonly used instead of the permeability:

$$\mu = \frac{\delta_0}{\delta} \quad (3)$$

where  $\delta_0$  is the water vapour permeability of still air, which can be calculated from

$$\delta_0 = \frac{0,083P_0}{R_V \cdot T \cdot P} \left( \frac{T}{273} \right)^{1,81} \quad (4)$$

For approximate calculations,  $\delta_0$  can be assumed to be constant in the temperature range under consideration; the following value can therefore be used:

$$\delta_0 = 2,0 \times 10^{-10} \quad (5)$$

### 4.2 Homogeneous insulation

In the case of a cold pipe with a single homogeneous layer of insulation, the density of water vapour flow per metre of an insulated cold pipe is given by replacing the differential expression by the vapour pressure difference in Formula (1):

$$g' = \frac{p_a - p_{\text{sat}}(\theta_0)}{Z'_P} \quad (6)$$

where

$p_a$  is the vapour pressure of the ambient air, in Pa;

$p_{\text{sat}}(\theta_0)$  is the saturation vapour pressure at the outside surface of the pipe, in Pa;

$Z'_P$  is the water vapour resistance per linear metre of the pipe insulation, in m·s·Pa/kg, defined by Formula (7):

$$Z'_P = \frac{\ln\left(\frac{D_1}{D_0}\right)}{2\pi\delta} \quad (7)$$

If the actual vapour pressure,  $p$ , does not cross the saturation pressure,  $p_{\text{sat}}$ , condensation occurs only at the surface of the cold pipe. When the actual vapour pressure crosses the saturation vapour pressure, follow the procedure described in [Clause 6](#).

The total water uptake over a period  $t$  is then given by

$$G' = \int_0^t \frac{p_a(t) - p_{\text{sat}}[\theta_0(t)]}{Z'_p} dt \quad (8)$$

### 4.3 Multi-layer insulation systems

The water vapour resistance,  $Z'_p$ , of an insulation system with  $n$  different layers is given by

$$Z'_p = \sum_{j=1}^n \frac{\ln\left(\frac{D_j}{D_{j-1}}\right)}{2\pi\delta_j} \quad (9)$$

which gives

$$Z'_p = \frac{1}{2\pi\delta_0} \sum_{j=1}^n \mu_j \ln\left(\frac{D_j}{D_{j-1}}\right) \quad (10)$$

where

$$\mu_j = \frac{\delta_0}{\delta_j}$$

$j = 1$  to  $n$  defines the layers from the cold pipe outwards.

Formula (10) can be an approximate means of calculating water vapour resistance of a homogeneous insulation material with water vapour resistance highly dependent on temperature.

NOTE See the example given in [A.2](#).

If the outer layer,  $n$ , is a vapour retarder jacket, foil or skin, with negligible thickness, but with large water vapour diffusion-equivalent air layer thickness,  $s_{\text{df}}$ , the water vapour resistance of the retarder will be

$$Z'_n = \frac{1}{\pi\delta_0 D_n} s_{\text{df}} = \frac{1}{2\pi\delta_0} \frac{2s_{\text{df}}}{D_n} \quad (11)$$

The water vapour resistance of the whole system is then

$$Z'_p = \frac{1}{2\pi\delta_0} \left[ \sum_{j=1}^{n-1} \mu_j \ln\left(\frac{D_j}{D_{j-1}}\right) + \frac{2s_{\text{df}}}{D_n} \right] \quad (12)$$

The total water uptake over a period  $t$  is then given by Formula (8).

### 4.4 Systems with capacity for drying

For cold pipe systems with drying-out capacities the total water uptake  $G'$  in the system is given by

$$G' = \int_0^t (g' - g'_e) dt \quad (13)$$

where  $g'_e$  is the drying capacity per linear metre of pipe, in  $\text{kg}/(\text{m}\cdot\text{s})$ .

For insulation systems, where the drying capacity is obtained by utilizing the wicking action of a capillary active fabric, the capacity is determined by the evaporation from the freely exposed moist area of the fabric per metre length of pipe,  $A'_e$ :

$$g'_e = f_e (p_{\text{sat}}(\theta_a) - p_a) A'_e \quad (14)$$

where  $p_{\text{sat}}(\theta_a)$  is the saturation vapour pressure at the ambient temperature, in Pa.

The evaporation factor,  $f_e$ , can be determined by measurement or calculation:

$$f_e = \frac{h_c}{R_v T \rho c_p} \quad (15)$$

where

$h_c$  is the convection heat transfer coefficient, in  $\text{W}/(\text{m}^2 \cdot \text{K})$ ;

$R_v$  is the gas constant for water vapour =  $461,5 \text{ J}/(\text{kg} \cdot \text{K})$ ;

$\rho$  is the density of air =  $1,205 \text{ kg}/\text{m}^3$  at  $20^\circ \text{C}$ ;

$c_p$  is the specific heat capacity at constant pressure of air =  $1\,005 \text{ J}/(\text{kg} \cdot \text{K})$  at  $20^\circ \text{C}$ .

NOTE A method of measurement is given in B.2. Formula (14) is an approximate expression because the wick temperature is not equal to the ambient temperature due to the evaporation. Further information regarding Formula (15) is to be found in Reference [5] in the Bibliography.

For horizontal and vertical pipes in still air  $h_c = 10 \text{ W}/(\text{m}^2 \cdot \text{K})$ , giving  $f_e = 6 \times 10^{-8} \text{ kg}/(\text{m}^2 \cdot \text{s} \cdot \text{Pa})$ .

The total water uptake over a time,  $t$ , is then given by

$$G' = \int_0^t \left[ \frac{p_a - p_{\text{sat}}(\theta_0)}{Z'_p} - f_e (p_{\text{sat}}(\theta_a) - p_a) A'_e \right] dt \quad (16)$$

## 5 Boundary conditions

The following boundary conditions for temperature and vapour pressure shall be used to evaluate the formulae given in Clause 4.

### a) At surface of cold pipe

The surface temperature of the cold pipe shall be taken as the temperature of the medium in the pipe. The vapour pressure at the surface shall be taken as the saturated vapour pressure at that temperature, i.e. a relative humidity of 1,0.

### b) Ambient air

*Outside* buildings, use the monthly mean temperature and vapour pressure of the warmest month.

*Inside* buildings, use the temperature and vapour pressure representative of the use of the building in the warmest month of the year. Methods for deriving internal conditions are given in ISO 13788.

NOTE Use of the monthly mean vapour pressure gives results which are on the safe side.

## 6 Calculation procedure

### 6.1 General

The formulae given in [Clause 4](#) allow the calculation of the total amount of water condensing within the cold pipe insulation and determination of whether condensation occurs within the insulation material or only on the pipe surface.

For the evaluation of the amount of water vapour transported into an insulated cold pipe system the following procedures shall be followed step by step.

### 6.2 Calculation of rate of condensation in single homogenous insulation layer

- Define the service temperature of the cooling medium and the temperature and relative humidity of the environment.
- Determine the vapour pressure corresponding to the given climatic conditions.
- Calculate the amount of water uptake using Formula (8).

### 6.3 Calculation of rate of condensation in multi-layer insulation system

- Define the service temperature of the cooling medium and the temperature and relative humidity of the environment.
- Calculate the temperature distribution through the insulation in accordance with ISO 12241.
- Calculate the saturation pressure distribution as a function of temperature in accordance with ISO 13788.
- Calculate the value of the corrected water vapour diffusion equivalent air layer thickness,  $\sigma_{d,j}$ , for the boundaries between each layer  $j$  of the insulation.  $\sigma_{d,j}$  is defined as the thickness of an imaginary plane layer with  $\mu = 1$ , and an area of  $\pi D_j$  which has the same diffusion resistance as the layer  $j$  with  $\mu = \mu_j$ :

$$\frac{\sigma_{d,j}}{\delta_0 \pi D_j} = \frac{\ln\left(\frac{D_j}{D_{j-1}}\right)}{2\pi\delta_0/\mu_j} \quad (17)$$

which gives

$$\sigma_{d,j} = \mu_j \frac{D_j}{2} \ln\left(\frac{D_j}{D_{j-1}}\right) \quad (18)$$

- Calculate the total corrected water vapour diffusion equivalent air layer thickness,  $\tilde{\sigma}_{d,j}$ , from the outside surface of the cold pipe to each interface between materials:

$$\tilde{\sigma}_{d,j} = \sum_{i=1}^j \sigma_{d,i} \quad (19)$$

- Draw the saturated vapour pressure as a function of  $\tilde{\sigma}_{d,j}$ , for each layer of cold pipe system elements.

Then draw the actual vapour pressure profile as a straight line between the vapour pressure of the environment and that at the outer surface of the pipe.

- If the actual vapour pressure  $p$  does not cross the saturation pressure  $p_{\text{sat}}$ , condensation will occur only on the outer surface of the pipe. The condensation rate is then given by Formula (6).

- 2) If  $p$  crosses  $p_{\text{sat}}$  then condensation will occur within the insulation material. Determine the tangent to the outermost condensation point and calculate the condensation rate in the insulation material and at the pipe surface from

$$g'_c = \delta_0 \left( \frac{p_a - p_{\text{sat}}(\theta_c)}{\tilde{\sigma}_{d,T} - \tilde{\sigma}_{d,c}} \right) \quad (20)$$

where

$\theta_c$  is the temperature at the interface where the condensation is occurring, in °C;

$\tilde{\sigma}_{d,c}$  is the sum of the  $\sigma_{d,j}$  values from the pipe to the interface between materials where condensation is occurring;

$\tilde{\sigma}_{d,T}$  is the sum of the  $\sigma_{d,j}$  values from the pipe to outside of the insulation.

The condensation rate at the pipe surface can be approximately calculated as the product of the saturated vapour pressure gradient and the water vapour permeability. However the precision of this value should be regarded as low, since the liquid movement is not taken into account.


- g) If the water vapour resistance factor of an insulation material is strongly temperature dependent, the insulation layer should be divided into sub layers with different water vapour resistance factors.

NOTE An example of the calculation is given in [A.2](#).

- h) Calculate the total accumulation on the pipe and in the insulation system by integrating the individual condensation rates over time:

$$G' = \int_0^t g'_c(t) dt \quad (21)$$

See [Figure 1](#).

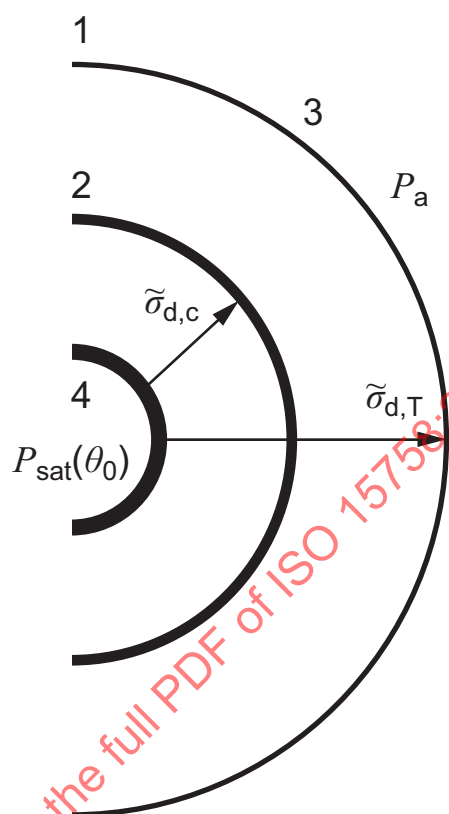

**Key**

- 1 outside surface of insulation system
- 2 condensation interface
- 3 ambient air
- 4 cold pipe

**Figure 1 — Cross-section of insulated cold pipe with condensation interface within the insulation system**

## Annex A (informative)

### Examples

#### A.1 Water uptake in insulated cold pipe with vapour retarder on outside

Water vapour resistance factor of the insulation  $\mu_1 = 50$ ;

Insulation thickness  $d_1 = 0,05$  m;

Pipe diameter without insulation  $D_0 = 0,1$  m;

Water vapour equivalent air layer thickness of vapour retarder  $s_{df} = 100$  m,

Climatic conditions:

- ambient temperature 20 °C, relative humidity 0,7, giving  $p_a = 1\,636$  Pa;
- pipe medium temperature 5 °C, giving  $p_{sat}(\theta_0) = 872$  Pa.

The vapour resistance of the whole insulation system is given as per Formula (12):

$$Z'_p = \frac{1}{2\pi \times 2 \times 10^{-10}} \left[ 50 \times \ln\left(\frac{0,2}{0,1}\right) + \frac{2 \times 100}{0,2} \right] = 8,23 \times 10^{11} \quad \text{m} \cdot \text{Pa} \cdot \text{s} / \text{kg} \quad (\text{A.1})$$

The density of water vapour flow rate is given as per Formula (6):

$$g' = \frac{1\,636 - 872}{8,23 \times 10^{11}} = 9,28 \times 10^{-10} \quad \text{kg} / (\text{m} \cdot \text{s}) \quad (\text{A.2})$$

The mass accumulated over a year is  $G' = 0,029$  kg/m.

#### A.2 Cold pipe insulated with one layer of material with highly temperature-dependent water vapour resistance factor

In this example it is assumed that a cold pipe is insulated by a 30 mm thick material with a water vapour resistance factor that varies linearly from 2 000 at 0 °C to 500 at 25 °C. This is treated as three layers of equal thickness with resistance factors of 1 750, 1 250, and 750.

Pipe diameter without insulation:  $D_0 = 0,088$  m;

Insulation layer 1:  $\mu_1 = 1\,750$ ,  $d_1 = 0,010$  m,  $D_1 = 0,108$  m;

Insulation layer 2:  $\mu_2 = 1\,250$ ,  $d_2 = 0,010$  m,  $D_2 = 0,128$  m;

Insulation layer 3:  $\mu_3 = 750$ ,  $d_3 = 0,010$  m,  $D_3 = 0,148$  m;

Climatic conditions:

- ambient temperature 25 °C, relative humidity 0,7, giving  $p_a = 2\,216$  Pa;
- pipe medium temperature 0 °C, giving  $p_{sat}(\theta_0) = 611$  Pa.

The total water vapour resistance is given by Formula (10) as:

$$Z'_p = \frac{1}{2\pi \times 2 \times 10^{-10}} \left( 1\,750 \times \ln\left(\frac{0,108}{0,088}\right) + 1\,250 \times \ln\left(\frac{0,128}{0,108}\right) + 750 \times \ln\left(\frac{0,148}{0,128}\right) \right) \quad (\text{A.3})$$

$$= 5,41 \times 10^{11} \quad \text{m} \cdot \text{Pa} \cdot \text{s} / \text{kg}$$

The density of water vapour flow rate is then calculated from Formula (6) as:

$$g' = \frac{(2\,216 - 611)}{5,41 \times 10^{11}} = 2,97 \times 10^{-9} \quad \text{kg} / (\text{m} \cdot \text{s}) \quad (\text{A.4})$$

The mass accumulated over a year is  $G' = 0,0845 \text{ kg/m}$ .

### A.3 Example of calculation when actual vapour pressure $p$ crosses saturation pressure $p_{\text{sat}}$

In this example, the condensation rate is calculated when the actual vapour pressure crosses the saturation pressure.

Determine the tangent to the outermost condensation point and calculate the condensation rate in the insulation material and at the pipe surface from: The condensation rate in the whole pipe system can be calculated as the product of the saturated vapour pressure gradient at the outermost condensation point and the water vapour permeability.



## Annex B (informative)

### System with capacity for drying and experimental determination of evaporation rate from surface of wet wick fabric

#### B.1 System with capacity for drying

As an alternate to the traditional approach, a method to remove condensed water from the system utilizing wicking material has been in use.[4][10][11] The approach accepts the fact that water vapour will enter the system and condense on the cold surface and provides a means to remove it from the system while keeping the insulation material substantially dry.[3][12]-[15]

A typical application of wicking technology is shown in [Figure B.1](#). A thin layer of hydrophilic wicking material is placed around the pipe. A layer of low conductivity insulation material is located around the wick to limit conduction heat transfer to the pipe. A vapour retarder is placed on the exterior surface of the insulation to limit the rate of water vapour diffusion into the system. The wicking material is extended downward through a slot in the insulation layer, and the tail of the wick is left exposed to the ambient air to serve as an evaporator section. Although the evaporator section of the wick is shown hanging straight down in a vertical position, this tail portion of the wick may be turned and adhered to the exterior of the vapour retarder in practice.

Any liquid water that condenses on the pipe surface is absorbed by the wicking material and transported via the combination of capillary forces and gravity through the slot and onto the exposed trail area where it can evaporate to the ambient air.