
**Remote handling devices for radioactive
materials —**

**Part 1:
General requirements**

*Dispositifs de manipulation à distance pour matériaux radioactifs —
Partie 1: Exigences générales*



PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

STANDARDSISO.COM : Click to view the full PDF of ISO 17874-1:2010



COPYRIGHT PROTECTED DOCUMENT

© ISO 2010

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword	iv
Introduction.....	v
1 Scope	1
2 Normative references	2
3 Terms and definitions	2
4 Application of multipurpose remote handling devices	3
4.1 General	3
4.2 Mechanical master-slave manipulators	3
4.3 Electrical master-slave manipulators	3
4.4 Power manipulators	4
4.5 Remote handling tongs.....	4
5 Kinematic systems for multipurpose remote handling devices	4
6 General requirements concerning the different categories of multipurpose remote handling devices	5
6.1 Mechanical master-slave manipulators	5
6.2 Electrical master-slave manipulators	8
6.3 Power manipulators	10
6.4 Remote handling tongs.....	11
7 Principal criteria for the selection of multipurpose remote handling devices	16
7.1 General	16
7.2 Load capacities of remote handling devices	17
7.3 Dexterity of remote handling devices	18
7.4 Reliability of remote handling devices	19
8 Other criteria	19
8.1 General	19
8.2 Working zone	20
8.3 Peripheral and auxiliary provisions.....	20
9 Design summary.....	21
Annex A (normative) Kinematic systems for remote handling devices.....	22
Bibliography.....	26

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 17874-1 was prepared by Technical Committee ISO/TC 85, *Nuclear energy*, Subcommittee SC 2, *Radiation protection*.

This second edition cancels and replaces the first edition (ISO 17874-1:2004), which has been technically revised.

ISO 17874 consists of the following parts, under the general title *Remote handling devices for radioactive materials*:

- *Part 1: General requirements*
- *Part 2: Mechanical master-slave manipulators*
- *Part 3: Electrical master-slave manipulators*
- *Part 4: Power manipulators*
- *Part 5: Remote handling tongs*

Introduction

This part of ISO 17874 deals mainly with multipurpose remote handling devices for nuclear applications.

These devices replace hands and arms in areas inaccessible to personnel (mostly behind shielding walls).

There are special remote handling devices designed for narrow fields of application or for special purposes only, but these are beyond the scope of this part of ISO 17874.

Multipurpose remote handling devices have five to ten, or even more, possibilities of movement in order to cope with the planned range of tasks.

Four categories of such remote handling devices are used worldwide for the handling of radioactive materials. These categories are the following:

- mechanical master-slave manipulators;
- electrical master-slave manipulators;
- power manipulators;
- remote handling tongs.

Various special designs, hydraulic or pneumatic machines, prototypes, experimental devices and obsolete types cannot be assigned to any category or do not correspond to all requirements of this part of ISO 17874. These devices are not covered by this part of ISO 17874.

The main applications of the different categories are explained in Clause 4.

Remote handling devices were originally developed for hot cells designed for research and development in nuclear power reactor fuel elements. They are now also in widespread use in other nuclear installations, such as plants for fabrication or reprocessing of fuel elements, waste treatment stations and decommissioning of nuclear facilities.

Remote handling devices are sometimes used for non-nuclear applications. This part of ISO 17874 does not address the special requirements of any of these fields, although designers can take advantage of standardized components from the nuclear sector to achieve cost-effective designs for other purposes, where appropriate.

STANDARDSISO.COM : Click to view the full PDF of ISO 17874-1:2010

Remote handling devices for radioactive materials —

Part 1: General requirements

1 Scope

This part of ISO 17874 describes requirements concerning devices for remote handling of radioactive materials. The classification of these devices (categories and different designs within a category) and the distribution in the different parts are shown in Figure 1.

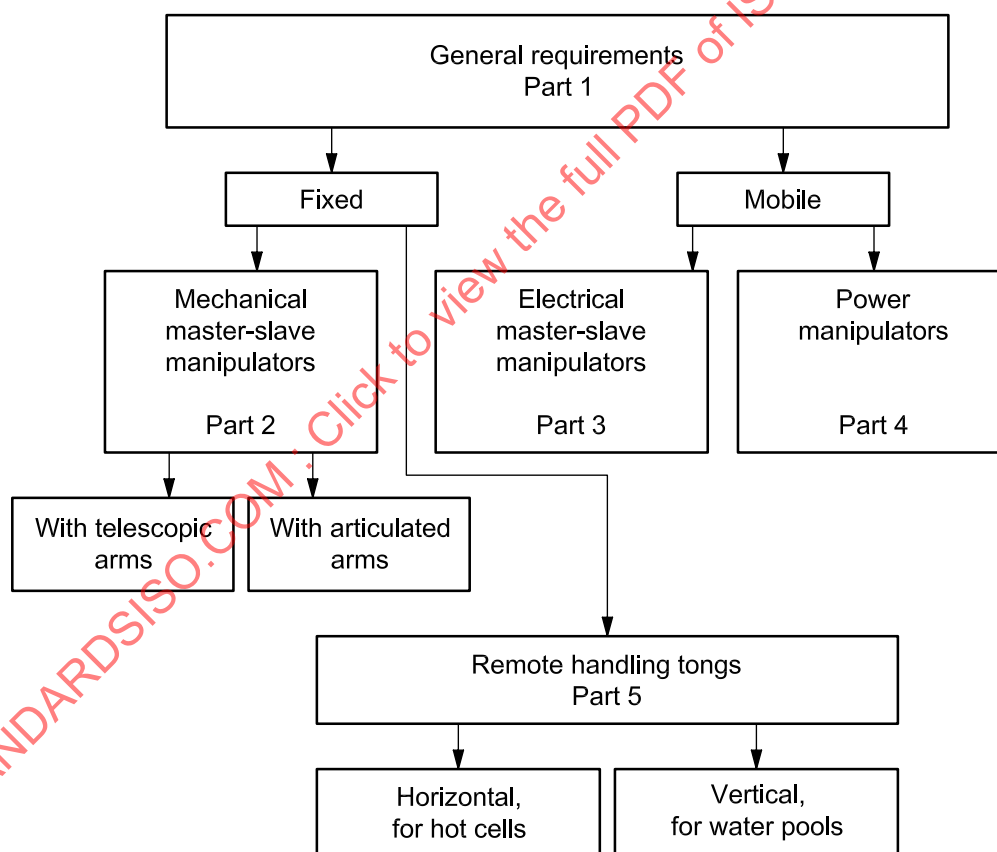


Figure 1 — Categories of remote handling devices and location in all parts of ISO 17874

Concerning the working volume, two principal designs are to be considered.

a) Fixed remote handling devices:

these devices are fitted in the shielding wall or sometimes in the ceiling of hot cells and accordingly can function only in a rather limited volume. Such devices are mechanical master-slave manipulators and remote handling tongs.

b) Mobile remote handling devices:

these devices are fitted on a transporter (e.g. a moveable bridge or a vehicle on the ground). The working volume depends mainly on the possible motion of the transporter. Such devices are electrical master-slave manipulators and power manipulators.

NOTE This part of ISO 17874 is intended to provide assistance to designers of nuclear process plants, as well as manufacturers, users and licensing authorities.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 7212, *Enclosures for protection against ionizing radiation — Lead shielding units for 50 mm and 100 mm thick walls*

ISO 9404-1, *Enclosures for protection against ionizing radiation — Lead shielding units for 150 mm, 200 mm and 250 mm thick walls — Part 1: Chevron units of 150 mm and 200 mm thickness*

ISO 11933-1, *Components for containment enclosures — Part 1: Glove/bag ports, bungs for glove/bag ports, enclosure rings and interchangeable units*

ISO 11933-2, *Components for containment enclosures — Part 2: Gloves, welded bags, gaiters for remote-handling tongs and for manipulators*

ISO 17874-2, *Remote-handling devices for radioactive materials — Part 2: Mechanical master-slave manipulators*

ISO 17874-3, *Remote handling devices for radioactive materials — Part 3: Electrical master-slave manipulators*

ISO 17874-4, *Remote handling devices for radioactive materials — Part 4: Power manipulators*

ISO 17874-5, *Remote handling devices for radioactive materials — Part 5: Remote handling tongs*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1

mechanical master-slave manipulator

manipulator reproducing the movements of the hand and arm of the operator by means of isokinematic master and slave arms with back-drivable mechanical transmissions

NOTE The manipulator is generally mounted on a shielding wall.

3.2

electrical master-slave manipulator

manipulator reproducing the movements of the hand and arm of the operator by means of isokinematic master and slave arms with bilateral electrical position control (force reflection)

NOTE 1 The word “bilateral” refers to the property of the system to be indifferently moved by acting on the master arm or on the slave arm.

NOTE 2 The slave arm is generally mounted on a transporter (mobile).

3.3**power manipulator**

manipulator driven by switch-operated motors

3.4**remote handling tongs**

mechanical device consisting of a gripper, a handle and a rod between them

NOTE Remote handling tongs are either installed in a shielding wall by using a mounting device or hung on a carrying system for use in a water pool or carried by an operator.

3.5**isokinematic**

property of a manipulator, where from base to free end, master arm and slave arm, presents the same type of motion (rotation or translation) in the same order and with the same relative orientations

4 Application of multipurpose remote handling devices**4.1 General**

The different categories of remote handling devices are used for various applications, as described in this clause.

4.2 Mechanical master-slave manipulators**4.2.1 Mechanical master-slave manipulators with telescopic arms**

These manipulators allow the transmission of forces up to the maximum magnitude required for the tasks to be achieved manually by an unaided operator. Depending on the type of manipulator, maximum load capacities up to 45 kg can be reached (see 7.2). They are suitable for complicated tasks and are usually installed in pairs on a working station. They are designed for hot cells of all sizes with shielding walls of concrete or also of lead in some cases. They constitute the main working devices in such kinds of cells.

Different lengths of arms are available according to the size of the hot cell to be equipped. However, versions with short arms provide higher forces and, reversely, versions with long arms reduce the forces to be applied. There also exist compact manipulators with a double telescope in the slave arm, available for hot cells with restricted height.

4.2.2 Mechanical master-slave manipulators with articulated arms

These manipulators allow not only the execution of forces equivalent to those an unaided operator can achieve, but also forces up to a much higher level. Depending on the type of manipulator, maximum load capacities up to 100 kg can be reached (see 7.2). They are suitable for complicated tasks, and are usually installed in pairs on a working station. They are designed for hot cells of all sizes with shielding walls typically of lead or also of cast iron in some cases. They are also used in containment enclosures. They have small dimensions and therefore provide a relatively small working volume. They are used instead of remote handling tongs as described in 4.5, if a larger working volume and/or more dexterity are needed.

4.3 Electrical master-slave manipulators

These manipulators allow not only the execution of forces equivalent to those an unaided operator can achieve, but also (depending on the type) forces up to a much higher level. They are suitable for complicated tasks, and often they are installed in pairs. They allow the performance of complicated work throughout the whole volume of large hot cells and not only near the operation walls, by means of the mobility of the slave arm. As a result of their load capacities they can be used also in place of light and medium load capacity power manipulators. They can be used, not only inside facilities, but also on vehicles (also in the open air).

4.4 Power manipulators

These manipulators allow the execution of high forces and therefore the handling of heavy objects, typifying their application. According to the load capacity of their hoist, they can also be used like a crane of light load capacity. They are not suitable for complicated tasks. They are used in medium-sized or large hot cells. Normally, they have large dimensions and are used to assist mechanical master-slave manipulators. They are used for tasks to be performed in areas that cannot be reached by mechanical master-slave manipulators and for transportation of objects over significant distances. They can also be used on vehicles (also in the open air).

4.5 Remote handling tongs

4.5.1 Remote handling tongs, used horizontally

These devices allow the transmission of forces of a low level, which any operator working unaided would consider small. They can be used only if a moderate level of dexterity and a small working volume are required. In the horizontal mode of use, remote handling tongs are mostly installed in pairs. They are typically used in hot cells with shielding walls made of lead. The installation on the shielding wall is realized using standardized ball mountings called sphere units (see ISO 7212 and ISO 9404-1).

NOTE These remote handling tongs can also be used without any mounting and shielding. In this case, protection is achieved by the operator maintaining an appropriate distance from the radioactive sources.

4.5.2 Remote handling tongs, used vertically

These devices allow the transmission of forces up to a high level (depending on the type), close to the maximum magnitude that an operator would employ in unaided manual activity. They can be used if dexterity only up to a moderate level is required. In this mode of use, remote handling tongs are typically installed above water pools. They can be handled manually by the operator or fixed in a carrying system, which would typically have three positioning motions.

NOTE To facilitate understanding in this part of ISO 17874, only the four common categories of remote handling devices listed above and their usual applications are considered. This does not exclude the development of equipment with more specialist features.

5 Kinematic systems for multipurpose remote handling devices

A multipurpose remote handling device shall have several possibilities of movement (termed motions) so as to be able to achieve a great variety of remotely handling tasks. The motions are executed mechanically either by the hands and arms of the operator or by electric motors.

A fully articulate remote handling device, which should in principle not be limited concerning its motions, shall have at least seven independent motions. It shall be able to execute three independent translation movements (and forces) on an object in the directions of the three coordinate axes throughout the working volume. It shall also be able to execute three independent rotation movements (and torques) on an object around the three coordinate axes without any special prior adjustment, again throughout the working volume. The seventh motion corresponds to the gripping movement.

NOTE Specific aspects of kinematic systems for handling are described in Annex A.

6 General requirements concerning the different categories of multipurpose remote handling devices

6.1 Mechanical master-slave manipulators

A mechanical master-slave manipulator shall consist of three main components: a master arm and a slave arm connected by a connection tube incorporating mechanical transmission elements (see Figures 2 and 4). The master arm and the slave arm shall have the same number, geometry and arrangement of motions. The connection shall be made in such a manner that the motions, forces and torques respectively executed by the hand of the operator on the handle of the master arm are transmitted faithfully to the slave arm.

The manipulator shall have seven motions: three positioning motions, three orientation motions and one gripping motion, corresponding to the requirements of Clause 5. The manipulator shall ensure force reflection between the slave arm and the master arm. The transmission elements shall communicate motions, forces and torques reversibly. The connection tube can be unsealed for β - γ -hot cells or sealed for α - γ -hot cells. The jaws of the tong and/or the complete tong shall be exchangeable remotely.

The slave arm can be equipped with a gaiter (American: booting). Gaiters are already standardized in ISO 11933-2. Concerning mechanical master-slave manipulators, two different designs shall be distinguished: master-slave manipulators with telescopic arms and master-slave manipulators with articulated arms. Both constructions are typically installed in shielding walls (see Figures 2 and 4).

Mechanical master-slave manipulators shall conform to ISO 17874-2.

NOTE For task observation during work carried out inside a hot cell, shielding windows are used and viewing geometry constraints can be considered in the overall design.

6.1.1 Mechanical master-slave manipulators with telescopic arms

The kinematics of mechanical master-slave manipulators with telescopic arms shall correspond to Figure 3. Depending on the type of manipulator, the load capacities range from 4,5 kg to 45 kg.

Key

- 1 through-wall tube
- 2 connection tube
- 3 counterweights
- 4 master arm
- 5 handle
- 6 loudspeaker
- 7 operating room
- 8 shielding window
- 9 shielding wall
- 10 sound signal transmission cable
- 11 microphone
- 12 tong with parallel jaws
- 13 hot cell
- 14 slave arm

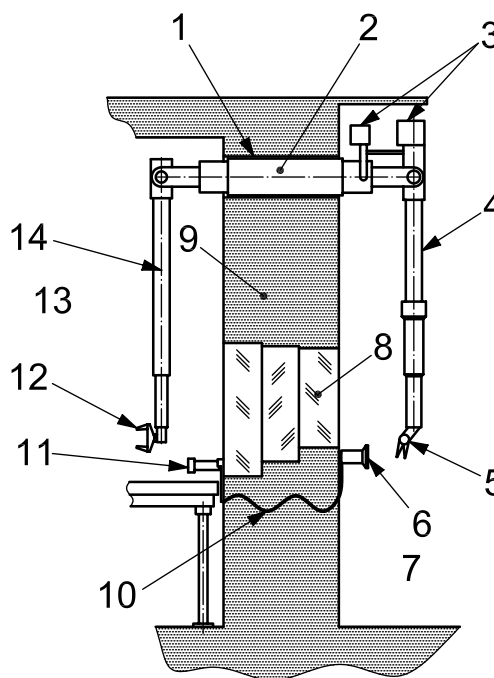


Figure 2 — Mechanical master-slave manipulator with telescopic arms

The positioning motions for the x and y directions of the slave arm should be adjustable relative to the master arm by electrically actuated indexing to enlarge the working volume and minimize operator strain. Extended reach versions feature a double telescope in the slave arm with an additional electrically actuated positioning motion in the z direction.

In some types, the slave arm can be disconnected and removed remotely.

For hot cells with restricted height (and/or with a small working volume), compact types are required, with a manually operated double telescope in the slave arm.

In addition to visual feedback, transmission of sound from the hot cell into the operating room can be helpful.

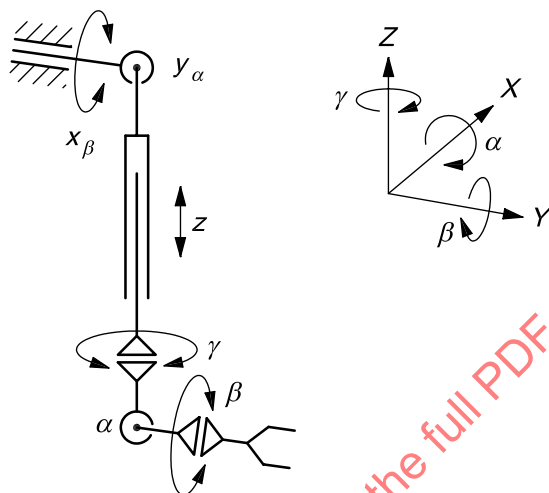
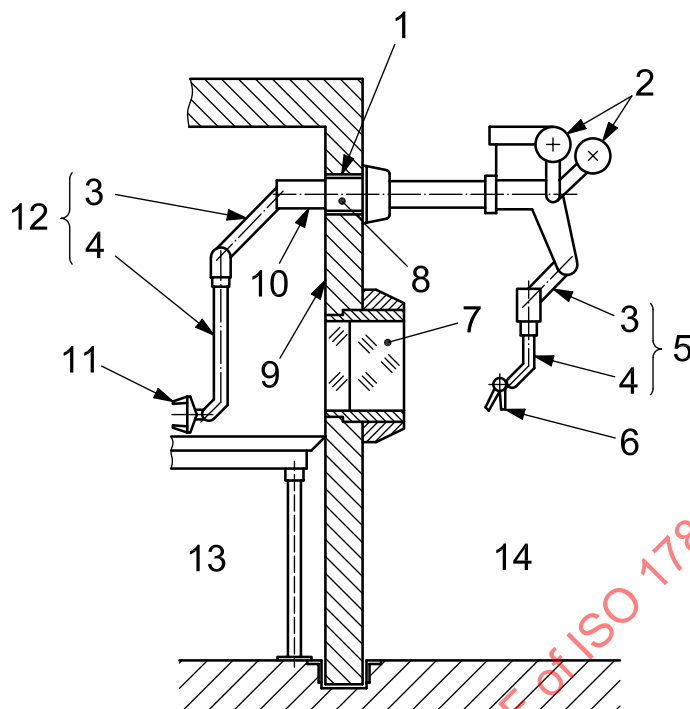


Figure 3 — Mechanical master-slave manipulators with telescopic arms (kinematic diagram)

6.1.2 Mechanical master-slave manipulators with articulated arms

The kinematics of mechanical master-slave manipulators with articulated arms shall correspond to Figure 5. Depending on the type of manipulator, the load capacities range from 2,3 kg to 12 kg.

**Key**

1	through-wall tube	6	handle	11	tong with parallel jaws
2	counterweights	7	shielding window	12	slave arm
3	upper arm	8	connection tube	13	hot cell
4	forearm	9	shielding wall	14	operating room
5	master arm	10	overhang		

Figure 4 — Mechanical master-slave manipulator with articulated arms

The master arm may have the same length as the slave arm or may be shorter than the slave arm.

A lever at the handle may be provided to lock the gripping motion. Brakes may be provided to lock the positioning and orientation motions.

Electrically actuated indexing of the inclination of the upper arm of the slave arm may also be provided by a switch-operated electric motor, to minimize operator strain. The overhang of the slave arm in the hot cell can be varied in some types to increase the reach by moving the whole manipulator along the axis of the through-wall tube.


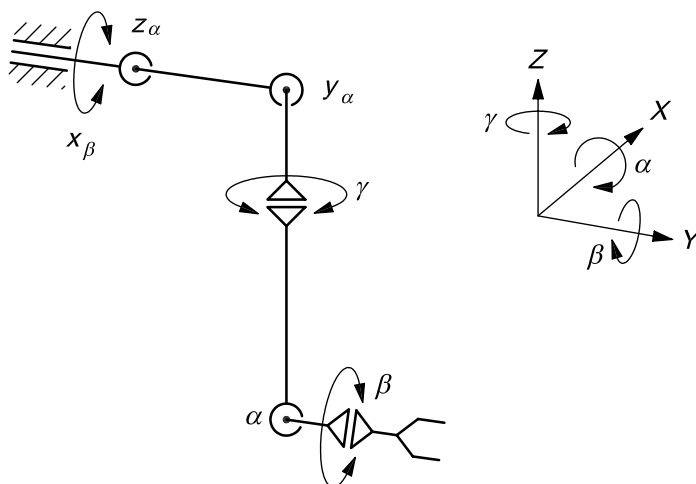


Figure 5 — Mechanical master-slave manipulator with articulated arms (kinematic diagram)

6.2 Electrical master-slave manipulators

An electrical master-slave manipulator shall consist of a master arm and a slave arm connected by an electrical system, including electric motors and a control computer (see Figure 6).

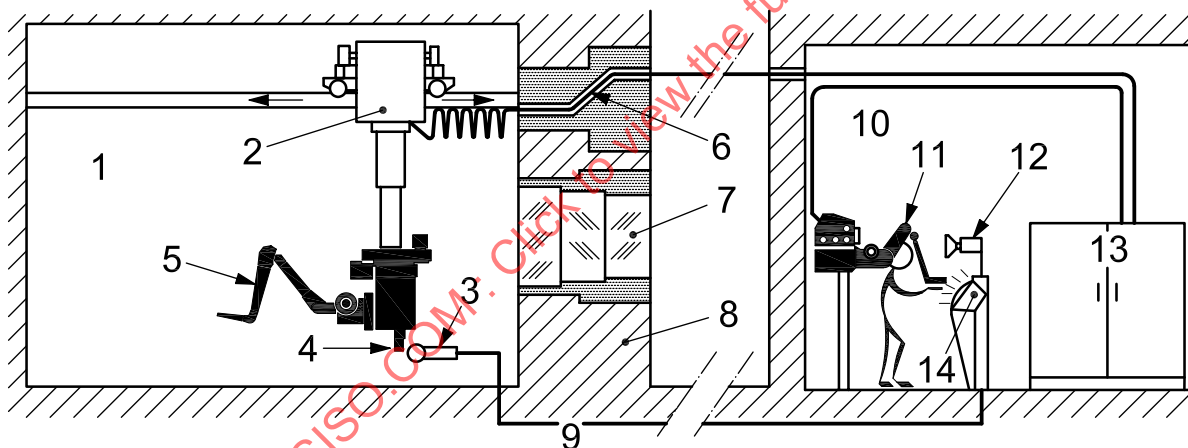

Key

- | | |
|---|--|
| 1 hot cell | 8 shielding wall |
| 2 transporter for slave arm | 9 sound signal transmission cable |
| 3 microphone | 10 operating room |
| 4 TV camera | 11 master arm |
| 5 slave arm | 12 loudspeaker |
| 6 transmission cables for manipulator and transporter | 13 control cabinet for manipulator and transporter |
| 7 shielding window | 14 TV monitor |

Figure 6 — Electrical master-slave manipulator

The motions of the operator's hand on the handle of the master arm shall be transmitted to the slave arm. The electrical system shall feature feedback of the load as force reflection felt by the operator at the master arm and this shall be reversible. Depending on the type of manipulator, the load capacities range from 10 kg to 100 kg.

The forces executed on the master arm can be amplified on the slave arm. In order to achieve a wide range of positions inside the working volume, the slave arm is generally installed on a transporter. The operating room can be located at some distance from the hot cell.

Like mechanical master-slave manipulators, electrical master-slave manipulators shall each have seven motions accommodated by the master arm and the slave arm, corresponding to the requirements of Clause 5. The master arm and the slave arm shall be connected by bilateral position controls.

The kinematics of the electrical master-slave manipulators shall correspond to Figure 7. The difference between versions A and B is the exchange of the motions z_α and x_β . The transporter typically has four additional electrically switch-operated motions, (x , y , z and γ).

The parallel jaws of the tong or the complete tong shall be exchangeable remotely.

The gripping motion shall be capable of being locked by a switch at the handle. The positioning and orientation motions shall be able to be locked by brakes. A pair of slave arms is often installed on each transporter, in order to increase the dexterity.

In addition to visual and tactile feedback, there should be a system for transmitting sounds from the hot cell to the operating room.

Electrical master-slave manipulators shall conform to ISO 17874-3.

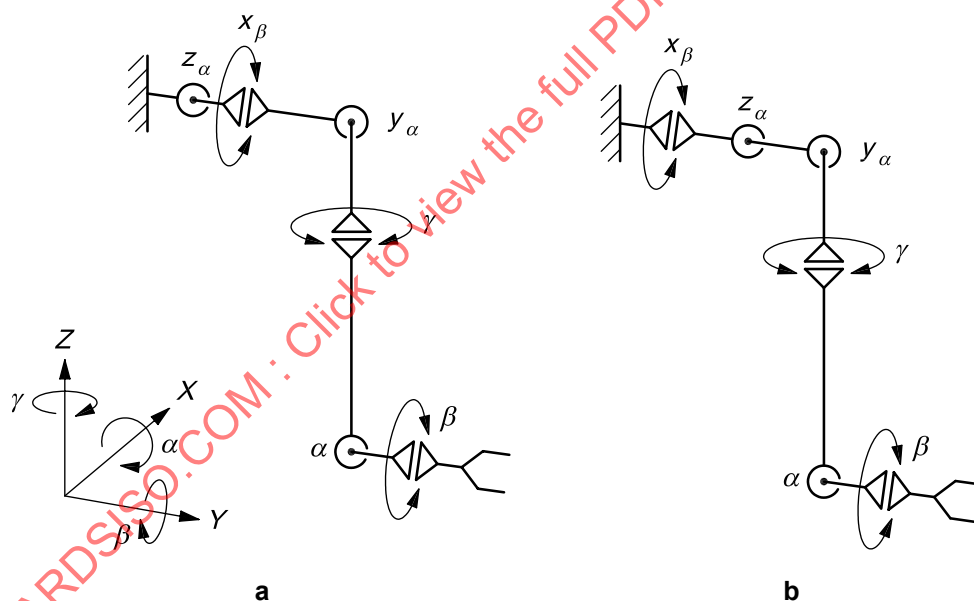


Figure 7 — Electrical master-slave manipulator (kinematic diagram)

NOTE 1 The motions of the transporter are only used for positioning the slave arm.


NOTE 2 For task observation during work carried out inside the hot cell, TV cameras or in some cases shielding windows are generally used.

6.3 Power manipulators

A power manipulator consists of a mechanical arm combined with a transporter. The manipulator is driven by electric motors and operated by switches or potentiometers and speed control. Different designs of operating devices are in use: press buttons, single switches for one motion each, joysticks for two to four motions and in a few cases one device for six motions. In contrast to the electrical master-slave manipulators, power manipulators have no master arm to transmit force reflection.

For hot cell applications, the operating console and the control cabinet are located in an operating room (Figure 8). A transmission cable passing through the shielding wall connects the power manipulator in the hot cell and the control console.

The mechanical arm, including the transporter, typically has seven to ten motions for designs appropriate to hot cells (see Figures 9 and 10).

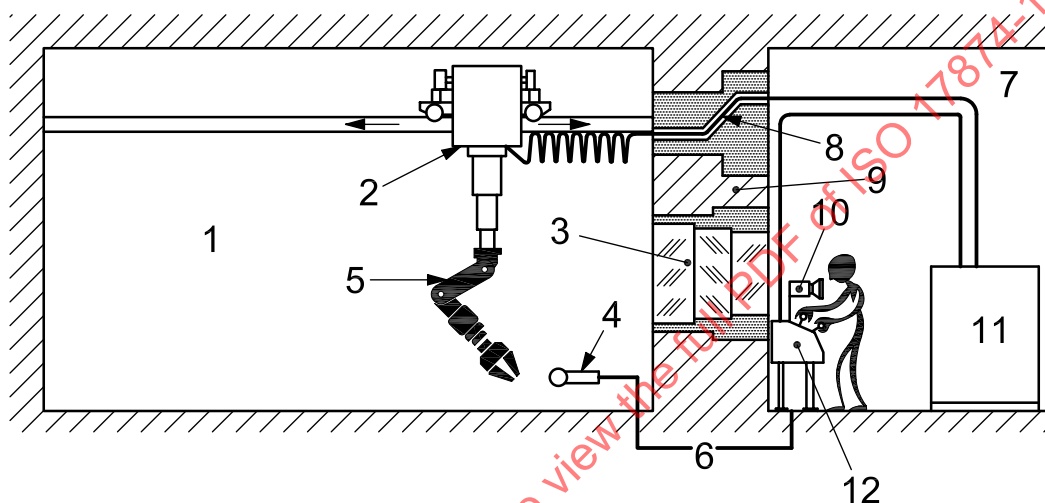

Key

- | | |
|-----------------------------------|----------------------|
| 1 hot cell | 7 operating room |
| 2 transporter | 8 transmission cable |
| 3 shielding window | 9 shielding wall |
| 4 microphone | 10 loudspeaker |
| 5 mechanical arm | 11 control cabinet |
| 6 sound signal transmission cable | 12 operating console |

Figure 8 — Power manipulator (designed for hot cells)

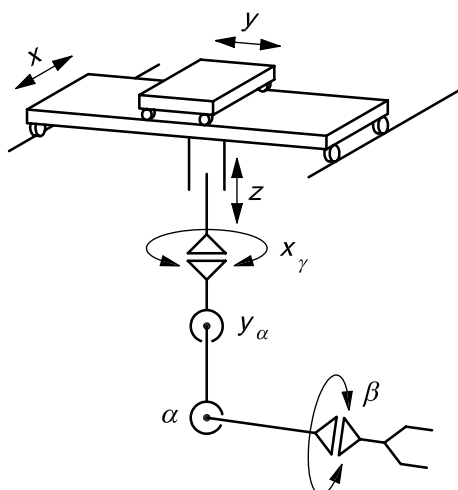


Figure 9 — Power manipulator with preferred design (kinematic diagram)

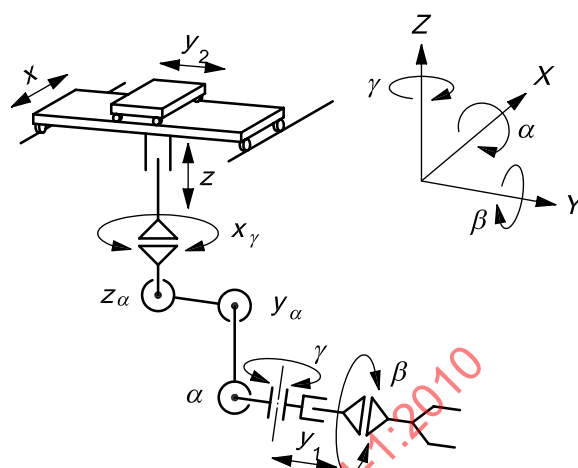


Figure 10 — Power manipulator with additional motions (kinematic diagram)

The preferred design (see Figure 9) with eight motions (the arm supporting five motions and the bridge transporter three) is available in a number of types. The most common design of the transporter consists of a moveable bridge, a cross-travel carriage and a vertical multiple telescope that provides a hoist action.

There are many different designs addressing the specific kinematics of the required system, some with more than eight motions, depending on need. The mechanical arm shown in Figure 10 fulfils the requirements of Clause 5. The load capacities of the different types have a wide range (5 kg to 500 kg, generally only 50 kg to 200 kg), as do the various physical dimensions.

The standard tong (with parallel jaws) should be exchangeable remotely, typically by means of an in-cell fixture. For several types of power manipulators, the gripping force can be controlled. In addition to visual feedback, there should be a system transmitting sounds from the hot cell to the operating room.

Power manipulators shall conform to ISO 17874-4.

NOTE 1 With power manipulators, the motions of the transporter are also used for positioning of objects.

NOTE 2 For task observation during work carried out inside the hot cell, shielding windows or in some cases TV cameras are used.

6.4 Remote handling tongs

6.4.1 General

Remote handling tongs are hand-operated. They are designed for two different applications: hot cells and water pools. They ensure one to four motions intrinsically and five to seven motions together with their mounting device. There are different classes of load capacity. Force reflection shall be ensured.

Remote handling tongs shall conform to ISO 17874-5.

6.4.2 Remote handling tongs, used horizontally

In this configuration, remote handling tongs are installed with sphere units (ball-mountings), typically in small hot cells with lead shielding walls. Two different designs are in use, with a rigid or an articulated rod (see Figures 11 and 13). Their kinematics shall correspond to Figures 12 and 14, respectively. The motions x_γ and z_α correspond to the movement possibilities of the sphere unit. The motions y and β correspond to the movement possibilities of the rod in the tube of the sphere unit.

In some types, the gripper can be exchanged remotely by means of a fixture.


It shall be ensured that the rods provide the same shielding effect as the shielding comprising the wall.

The diameters of the rods and the sphere units corresponding to these types of remote handling tongs are standardized in ISO 7212 and ISO 9404-1. Gaiters (American: bootings) and enclosure rings for these remote handling tongs are described respectively in ISO 11933-1 and ISO 11933-2.

Special remote handling devices exist, which are derived from remote handling tongs with rigid rods equipped with different tools instead of the gripper.

Remote handling tongs featuring a rigid rod are in some cases carried and held in the working position by the operator.

NOTE For task observation during work carried out inside the shielded containment enclosure, small shielding windows are generally used.

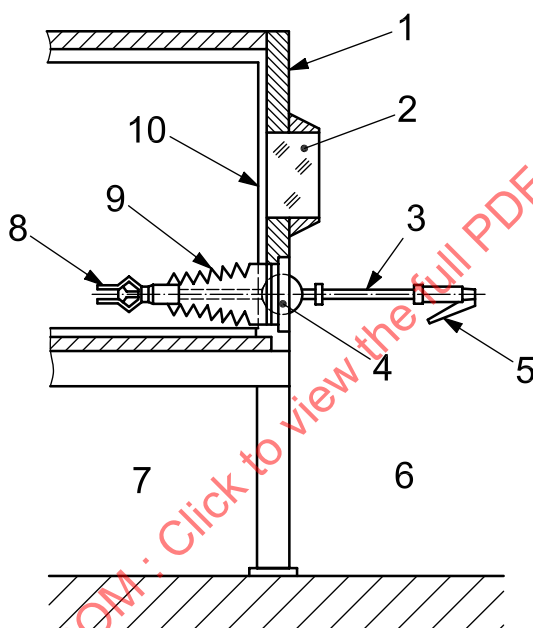

Key

- | | |
|--------------------|--------------------------|
| 1 shielding wall | 6 operating room |
| 2 shielding window | 7 hot cell |
| 3 rod (rigid) | 8 gripper |
| 4 sphere unit | 9 gaiter |
| 5 handle | 10 containment enclosure |

Figure 11 — Remote handling tongs (rigid), horizontal, in a hot cell [example shown is with gaiter and containment enclosure (α - γ hot cell); options without gaiter or containment enclosure are possible]


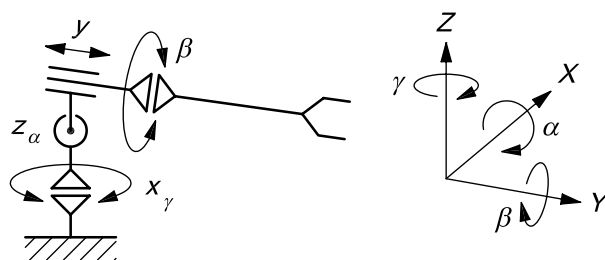


Figure 12 — Remote handling tongs (rigid), horizontal (kinematic diagram)

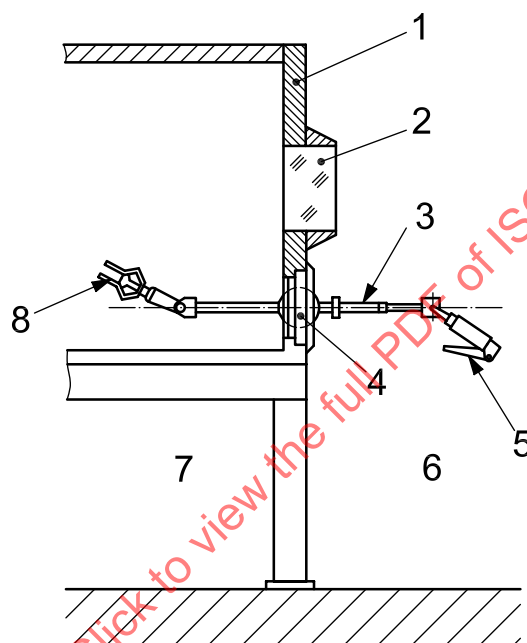

Key

- | | |
|---------------------|------------------|
| 1 shielding wall | 5 handle |
| 2 shielding window | 6 operating room |
| 3 rod (articulated) | 7 hot cell |
| 4 sphere unit | 8 gripper |

Figure 13 — Remote handling tongs (articulated), horizontal, in a hot cell

[example shown is without gaiter or containment enclosure (β - γ hot cell), options with gaiter and containment enclosure are also possible]


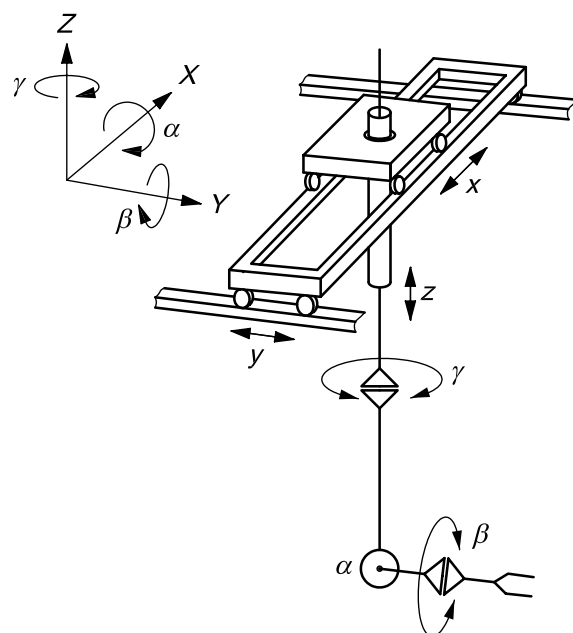


Figure 14 — Remote handling tongs (articulated), horizontal (kinematic diagram)

NOTE The motions x , y , and z are functionally combined in the spherical bearing of the sphere unit. The motions α , β , and γ are provided via axial and rotational movements of the rod in a tube running through the sphere unit. In Figures 12 and 14, the combined motions are drawn separately to facilitate understanding.

6.4.3 Remote handling tongs, used vertically

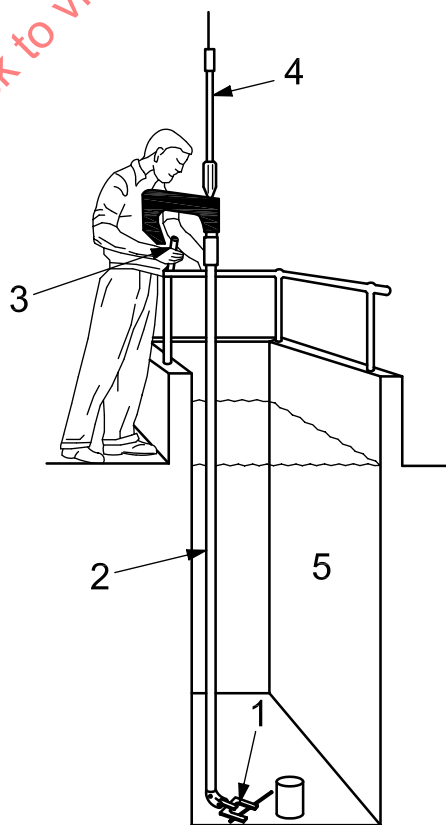

Key

- 1 gripper
- 2 rod (articulated)
- 3 handle
- 4 carrying system
- 5 water pool

Figure 15 — Remote handling tongs, articulated and with hand rotation, vertical, for water pools

In this configuration (unlike that described in the previous paragraph), the remote handling tongs are equipped with a long vertical rod between the gripper and the handle to make their use possible in water pools. These types of remote handling tongs are available in three different designs:

- with a rigid rod;
- with a simple articulated rod;
- with an articulated gripper and additional hand rotation (see Figure 15).


Remote handling tongs for water pools with rigid or articulated rods are similar to those intended for horizontal mounting in hot cells. The differences are only in the detailed design of the rods, which are much longer and therefore larger in diameter.

Remote handling tongs for water pools usually have a support system to carry the weight and to enable precise positioning. Such a system typically has four motions (x , y , z and γ) (see Figure 16). The kinematics are shown in Figure 17.

NOTE 1 The motions z and γ are provided by independent arrangements, via axial and rotational movement of the rod in a tube passing through the cross-travel carriage.

Variations from the arrangement shown in Figure 17 are possible, e.g. remote handling tongs with a rigid rod (which have no α - and β -motion) or with an articulated rod (in which case there is no β -motion). In every case, it shall be ensured that the rods have the same shielding effect as the water they displace (e.g. a gas-filled hollow structure would not generally be advisable).

NOTE 2 Observation of the working region is made by direct sight, taking advantage of the transparency of the shielding water or by TV cameras.

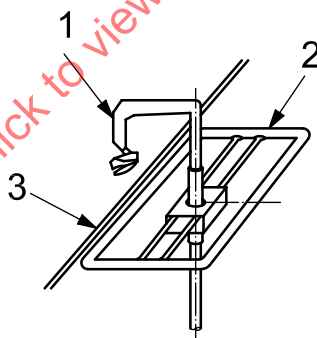

Key

- 1 remote handling tongs
- 2 carrying system
- 3 walk-way railing

Figure 16 — Example of carrying system for vertical remote handling tongs

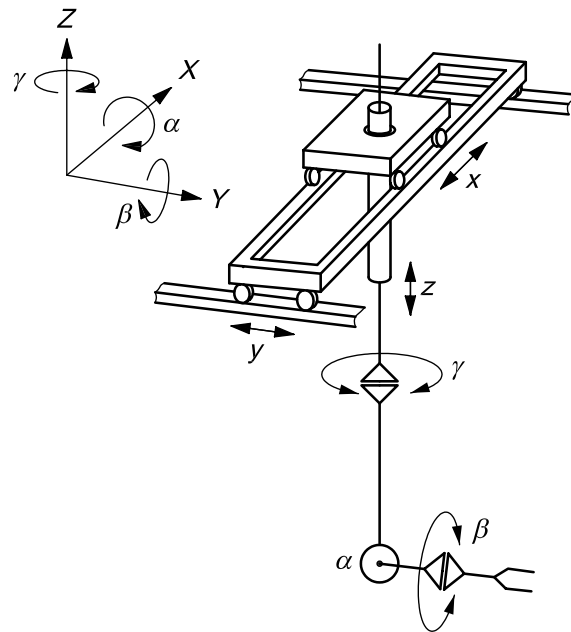


Figure 17 — Remote handling tongs, articulated and with hand rotation, vertical (kinematic diagram)

7 Principal criteria for the selection of multipurpose remote handling devices

7.1 General

This subclause explains how to select manipulators or remote handling tongs of different designs. One or other (or both) of the following methodologies can be adopted.

- The process equipment in the hot cell is designed and procured independently of remote handling considerations. Subsequently, the remote handling system components are specified to achieve the required overall functionality. Remote handling devices are selected from available proprietary items and/or by modification or by the design and construction of bespoke components.
- The required handling devices are selected from available proprietary items. The design of the hot cell and process equipment is modified and/or adapted to suit the end-effectors, motions, load capacities, working volumes, etc. of the selected remote handling device.

To be able to perform a task, three criteria are paramount:

- load capacity;
- dexterity (considering the number of motions and the no-load forces);
- reliability.

Besides these, many other features of the remote handling devices, the accessories, the assisting devices and the boundary conditions have a strong influence on the operational efficiency of remote handling systems. Some of these are addressed in Clause 8.

7.2 Load capacities of remote handling devices

For each task, it is a prerequisite to analyse the stress to be applied on the remote handling devices:

- the maximum weights of the loads (objects, tools) to be handled or lifted, including acceleration effects;
- the forces to be exerted;
- the torques to be applied by hand rotation or the arm;
- the reaction forces of tools (e.g. hydraulic shears, impact wrenches, high pressure jets for decontamination, compressed air chisels and any sources of vibration).

Based on the results of this analysis, choices concerning the load capacities of the necessary remote handling devices are made.

To increase the reliability and effective lifetime of remote handling devices, it is recommended to keep the normal working loads at no more than two thirds of the maximum load capacities specified by the manufacturer, apart from a few exceptional cases. The maximum load capacities reached in the different categories of remote handling devices are shown in Figure 18.

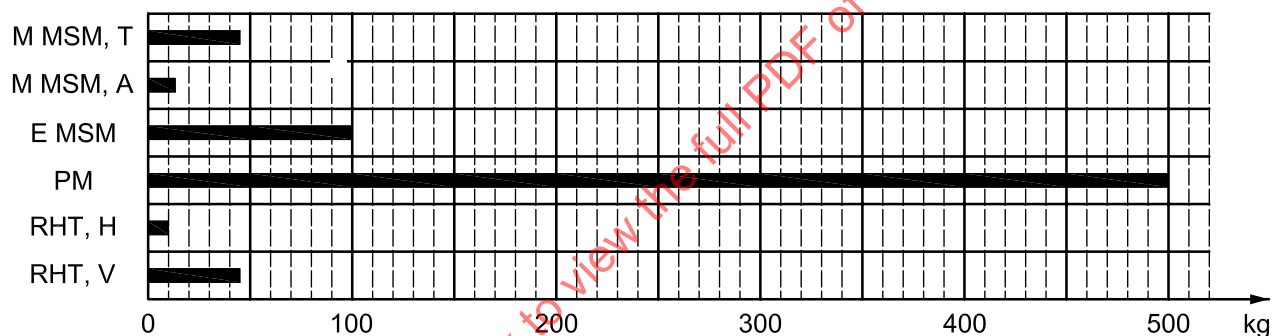


Figure 18 — Maximum load capacities in the tong of remote handling devices reached in the different categories

Abbreviations used:

M MSM, T	Mechanical master-slave manipulator with telescopic arms
M MSM, A	Mechanical master-slave manipulator with articulated arms
E MSM	Electrical master-slave manipulator
PM	Power manipulator
RHT, H	Remote handling tongs, horizontal
RHT, V	Remote handling tongs, vertical

7.3 Dexterity of remote handling devices

The dexterity of a remote handling device is the ability to execute tasks up to a defined level in a scale of tasks with different degrees of difficulty. The dexterity achieved in remote handling systems is a complex property, in which a series of parameters shall be considered, including a few that are independent of the remote handling devices themselves. The dexterity depends upon the following factors:

- the principles of the control system and the operating devices;
- the way of executing the motions:
 - sequential (one motion after the other, e.g. power manipulators);
 - combined (several simultaneous motions, e.g. mechanical or electrical master-slave manipulators);
- the design of the kinematic system (number, type and arrangement of the motions);
- the design of the tong (in particular the shape and size relative to the objects to be handled);
- the forces to be overcome when moving the manipulator in the no-load condition (only a concern with master-slave manipulators);
- the number of remote handling devices located in the working station (whether two devices, normally of the same type, or only one device is available);
- the quality of visual feedback (which depends upon distance, angle and the intensity, spectral characteristics and any flicker or irregularity of the illumination);
- the qualifications and experience of the operators.

The choices concerning the necessary dexterity of the remote handling devices should be made on the basis of the requirements and characteristics of the considerations mentioned above.

The addition of a second remote handling device increases the dexterity of the overall system, but provides no other new feature, in terms of load capacities. However, the use of two remote handling devices can be necessary in some cases needing no high dexterity, e.g. for holding the workpiece.

The dexterity of the various categories of remote handling devices is very different and is qualitatively indicated in Figure 19.



Figure 19 — Dexterity of remote handling systems

Abbreviations used:

- PM Power manipulator
- MSM Master-slave manipulator (mechanical or electrical)
- RHT Remote handling tongs

7.4 Reliability of remote handling devices

Although the reliability of the remote handling equipment is a very important feature of the system, it is not readily possible to evaluate the reliability deterministically. Therefore, it is essential that the user specifies the conditions and accordingly the requirements, defining the intended application as precisely as possible, e.g.:

- the load profile (forces and occurrence frequencies over a typical operational year);
- the number of load changes for critical component parts, which shall be admissible under defined loads;
- the admissible maintenance intervals;
- the environmental conditions (radiation, corrosion, etc.).

The experiences learned by the manufacturers in different applications as well as those of established users are very important and should be considered in the selection process.

The selected manufacturer should furnish a maintenance plan specific to the intended use, i.e. accounting for the conditions listed above.

Concerning the reliability of the manipulators, the following additional aspects shall be taken into account:

- intended use in laboratories;
- intended use in production installations.

For various reasons, such as fatigue of the operators and limited reliability of the equipment, mechanical and electrical master-slave manipulators and power manipulators should not be used for very repetitive operations (such as industrial-scale mass production). The use of manipulators in production processing systems should be reserved for maintenance and intervention operations.

There are, however, two possible methods to enhance the reliability:

- the design can incorporate greater margins between the intended operational loads and the manufacturer's recommended maximum loads (but designers should note remarks in 7.3 concerning dexterity, particularly no-load forces);
- more intensive development can be undertaken to eliminate weak points (identified in a design and/or as a result of proving trials of prototypes).

In addition, the value of properly respected maintenance schedules and more sophisticated maintenance techniques, such as ongoing failure mode analysis and condition monitoring (where appropriate), should not be underestimated.

8 Other criteria

8.1 General

Apart from the principal criteria (Clause 7), there are many other issues influencing the overall efficiency of remote handling systems and accordingly playing a role in the selection process. These other issues can be divided into two sets, concerning the remote handling devices themselves (mostly in the working zone) and the peripheral/auxiliary provisions.

8.2 Working zone

The issues of interest are the following.

- a) **Dimensions of the remote handling devices:** some key dimensions shall be fixed to suit the corresponding dimensions of any existing hot cells, e.g. the arm length of mechanical master-slave manipulators or the width of the moveable bridge of a power manipulator. Consistent with 7.1, the alternative approach is to fix the dimensions of new hot cells in the design stage, to suit the standard dimensions of available remote handling devices.
- b) **Working speed:** the necessary working speed depends on the quantity of work to be performed in a given time. Overall system output may be improved by sharing the task stream between more hot cells, reducing the speed demanded in any one of them.
- c) **Handling safety.**
- d) **Minimized operator fatigue.**
- e) **Leak-tightness of the housings and of the containment structure.**
- f) **Ease of decontamination.**
- g) **Maintainability:** these features c) to g) shall be given careful consideration and appropriate tests shall be carried out where prior knowledge is insufficient.
- h) **Durability:** materials shall be specified which are resistant to (or protected from) the corrosive fluids, radiation, etc. anticipated in the working environment.
- i) **Accessibility:** it shall be possible to mount and to remove mechanical master-slave manipulators and remote handling tongs for horizontal use safely from the operator side. With master-slave manipulators equipped with a sealed connection tube, it shall also be possible to remount the slave arm from the inside of the hot cell. When electrical master-slave manipulators or power manipulators are used in a ceiling of a hot cell, suitable transfer systems and/or airlocks are necessary to move them in and out safely.
- j) **Necessary working volume including lay-down areas:** the remote handling system shall permit tasks to be undertaken in a good situation. The objects to be handled shall be in the working volume of any mechanical master-slave manipulator intended to be used. Accordingly, it should be possible to transport the workpiece objects and any relevant tools into the working volume. The working volume shall be kept clear of objects which do not require maintenance, and should incorporate space to lay down tools and components of the workpiece, as appropriate.
- k) **Manoeuvring space:** in the case of mobile manipulators, it shall be possible to move them safely to the objects to be handled.
- l) **Working environment on the operator side:** when using a mechanical master-slave manipulator, it is important to ensure that the movements of the master arm are not limited by other equipment such as instruments, monitors, electrical conduit and junction boxes, lights, ventilation ducts and so on.

8.3 Peripheral and auxiliary provisions

Issues concerning the auxiliary equipment and the periphery region that are to be considered within the system design include the following:

- a) **Visibility of the tasks:** the spectral characteristics of the working volume illumination and viewing system should suit the colours of the workpieces and tools intended, to ensure good reflectance and transmission of the view. The relative light intensities of the operator's view of the working zone and immediate operator-side environment should be appropriately balanced to avoid problems of glare.

- b) **Quality of visual feedback:** further to the consideration of 8.2, the design process should also address the adequacy of viewing angles, resolution of optical trains, cameras and screens, optical distortion, build-up of dust on optical surfaces, crazing and opacifying due to radiological and chemical attack and similar image-degrading effects.
- c) **Sound signal transmission:** transmission of the working zone sounds to the operator(s) will often be of benefit but care should be taken to choose an appropriate bandwidth for each element of the system, to minimize signal contamination by electronic interface or vibration of the microphone mounting, and to ensure a relatively low-noise listening environment.
- d) **Special grippers and tools:** special grippers can be needed to handle particularly delicate or awkwardly-shaped workpieces or tools which cannot be replaced by more appropriate designs (see 7.1).
- e) **Adaptation of the process components to the tongs, grippers and tools:** again following 7.1, the alternative approach is to (re)design the workpiece and process equipment or parts of them so that they suit available proprietary tongs, grippers and tools.
- f) **Lifting devices, especially cranes:** in addition to working volume access, maintenance access and issues of operational loading versus reliability, lifting devices such as cranes introduce a range of safety considerations such as fail-safe grabs, automatic cable-drum brakes and, depending on the application, seismic qualification requirements. Control issues such as operator interfaces, visual feedback, soft-start of the crane motions and movement limit switches are also likely to be features of the design.
- g) **Maintenance concepts** (rooms, equipment): maintenance issues will generally include means of access, extent of remote handling for the maintenance tasks, provision of airlocks to minimize the spread of contamination, temporary and/or mobile shielding, development of recommended spares and of holdings of consumables, schedules, failure feedback databases (as discussed above), as well as dedicated facilities as near as practicable to the hot cell for the non-local maintenance activities.

9 Design summary

From the beginning of the project, the following shall be studied in parallel:

- the remote handling equipment;
- the design of the process equipment;
- the maintenance requirements for the process equipment;
- the means for maintenance and intervention.

Before deciding on the definitive overall design of the hot cell plant and the associated process equipment, the operations planned for the manipulators should be precisely defined.

During the project, all the chosen means for manipulation should be compatible with the likely evolution of the process equipment and with the working environments. Exceptional interventions to rectify any component failures of the process equipment, workpieces, remote handling devices, tools and auxiliary systems should be planned for.